



## Installation Instructions

### POINT I/O One-piece Terminal Bases

Catalog Numbers 1734-TOP, 1734-TOPS, 1734-TOP3, 1734-TOP3S

Topic	Page
About This Publication	1
Important User Information	2
Environment and Enclosure	3
Prevent Electrostatic Discharge	4
Install a Base	5
Remove a Base	6
Specifications	7

#### About This Publication




Read this publication for information about these terminal bases.

Catalog Number	Number of Terminations	Termination Type
1734-TOP	8	Screw-clamp
1734-TOPS	8	Spring-clamp
1734-TOP3	12	Screw-clamp
1734-TOP3S	12	Spring-clamp

### Important User Information

Solid state equipment has operational characteristics differing from those of electromechanical equipment. Safety Guidelines for the Application, Installation and Maintenance of Solid State Controls (publication SGI-1.1 available from your local Rockwell Automation sales office or online at <http://literature.rockwellautomation.com>) describes some important differences between solid state equipment and hard-wired electromechanical devices. Because of this difference, and also because of the wide variety of uses for solid state equipment, all persons responsible for applying this equipment must satisfy themselves that each intended application of this equipment is acceptable. In no event will Rockwell Automation, Inc. be responsible or liable for indirect or consequential damages resulting from the use or application of this equipment.

The examples and diagrams in this manual are included solely for illustrative purposes. Because of the many variables and requirements associated with any particular installation, Rockwell Automation, Inc. cannot assume responsibility or liability for actual use based on the examples and diagrams. No patent liability is assumed by Rockwell Automation, Inc. with respect to use of information, circuits, equipment, or software described in this manual. Reproduction of the contents of this manual, in whole or in part, without written permission of Rockwell Automation, Inc., is prohibited. Throughout this manual, when necessary, we use notes to make you aware of safety considerations.

<p><b>WARNING</b></p> 	<p>Identifies information about practices or circumstances that can cause an explosion in a hazardous environment, which may lead to personal injury or death, property damage, or economic loss.</p>
<p><b>IMPORTANT</b></p>	<p>Identifies information that is critical for successful application and understanding of the product.</p>
<p><b>IMPORTANT</b></p>	<p>Identifies information about practices or circumstances that can lead to personal injury or death, property damage, or economic loss. Attentions help you to identify a hazard, avoid a hazard and recognize the consequences.</p>
<p><b>SHOCK HAZARD</b></p> 	<p>Labels may be located on or inside the equipment, for example, a drive or motor, to alert people that dangerous voltage may be present.</p>
<p><b>BURN HAZARD</b></p> 	<p>Labels may be located on or inside the equipment, for example, a drive or motor, to alert people that surfaces may be dangerous temperatures.</p>

---

**Environment and Enclosure**

---

**ATTENTION**

This equipment is intended for use in a Pollution Degree 2 industrial environment, in overvoltage Category II applications (as defined in IEC publication 60664-1), at altitudes up to 2000 meters (6561 ft) without derating.

This equipment is considered Group 1, Class A Industrial equipment according to IEC/CISPR Publication 11. Without appropriate precautions, there may be potential difficulties ensuring electromagnetic compatibility in other environments due to conducted as well as radiated disturbance.

This equipment is supplied as open-type equipment. It must be mounted within an enclosure that is suitably designed for those specific environmental conditions that will be present and appropriately designed to prevent personal injury resulting from accessibility to live parts. The enclosure must have suitable flame-retardant properties to prevent or minimize the spread of flame, complying with a flame spread rating of 5VA, V2, V1, V0 (or equivalent) if non-metallic. The interior of the enclosure must be accessible only by the use of a tool.

Subsequent sections of this publication may contain additional information regarding specific enclosure type ratings that are required to comply with certain product safety certifications.

Besides this publication, see:

- Industrial Automation Wiring and Grounding Guidelines, for additional installation requirements, Allen-Bradley publication 1770-4.1.
  - NEMA Standards publication 250 and IEC publication 60529, as applicable, for explanations of the degrees of protection provided by different types of enclosure.
-

**Prevent Electrostatic Discharge****ATTENTION**

This equipment is sensitive to electrostatic discharge, which can cause internal damage and affect normal operation. Follow these guidelines when you handle this equipment:

- Touch a grounded object to discharge potential static.
  - Wear an approved grounding wriststrap.
  - Do not touch connectors or pins on component boards.
  - Do not touch circuit components inside the equipment.
  - Use a static-safe workstation, if available.
  - Store the equipment in appropriate static-safe packaging when not in use.
- 

**ATTENTION**

POINT I/O is grounded through the DIN rail to chassis ground. Use zinc plated yellow-chromate steel DIN rail to assure proper grounding.

The use of other DIN rail materials (such as aluminum, plastic) that can corrode, oxidize, or are poor conductors, can result in improper or intermittent grounding.

Secure DIN rail to mounting surface approximately every 200 mm (7.8 in.) and use end-anchors appropriately.


---

**Install a Base**

To install a base on DIN rail, proceed as follows, referring to the figures to identify major parts of the base.


**1734-TOP and 1734-TOPS**

Typical pinout for terminations - see installation instructions for I/O module for specific termination definition.

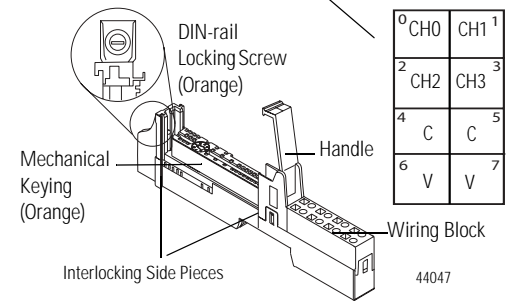

**1734-TOP3 and 1734-TOP3S**

Typical pinout for terminations - see installation instructions for I/O module for specific termination definition.

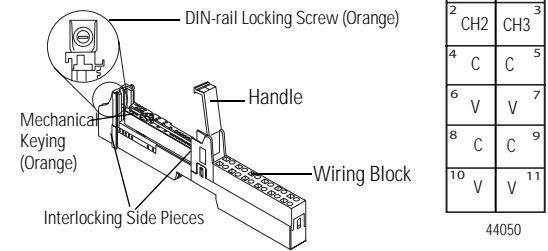

Refer to your I/O module user manual for keying information and information on how to configure your module.

1. Position the base vertically above the installed units, such as an adapter, power supply, or existing module.
2. Slide the base down, allowing the interlocking side pieces to engage the adjacent installed unit.
3. Press firmly to seat the base on the DIN rail until the base snaps into place.
4. Verify that the DIN-rail locking screw is in a horizontal, locked position before inserting an I/O module.



DIN-rail locking screw is in horizontal, locked position.



DIN-rail locking screw is in vertical, unlocked position.

### Remove a Base

**WARNING**



**Explosion Hazard**

Do not disconnect or replace component unless power is switched off or area is known to be nonhazardous. Do not pull on the installed wiring to remove a terminal base. A shock hazard exists if power is applied to the terminal base.

To remove a wiring base from the DIN rail, you must remove the module installed to the right of the base, proceeding as follows.

1. Squeeze the module locking mechanism of the module to the right of the base, pulling up to remove the module.
2. Turn the orange locking screw to a vertical position to unlock the base from the DIN rail.
3. Slide the base up to release it from its mating units.

## Specifications

### One-piece Terminal Bases - 1734-TOP, 1734-TOPS, 1734-TOP3, 1734-TOP3S

Attribute	Value
Dimensions (HxWxD), Approx.	1734-TOP, 1734-TOPS 49 x 12 x 144 mm (1.93 x 0.47 x 5.67 in.) 1734-TOP3, 1734-TOP3S 49 x 12 x 168 mm (1.93 x 0.47 x 6.61 in.)
Weight, Approx.	1734-TOP 63.8 g (2.25 oz), 1734-TOP3 79.2 g (2.79 oz), 1734-TOPS 55.68 g (1.96 oz), 1734-TOP3S 66.8 g (2.36 oz)
Wire Size	0.25...2.5 mm <sup>2</sup> (22...14 AWG) solid or stranded copper wire rated at 75 °C (167 °F) or greater 1.2 mm (3/64 in.) insulation max
Category	Dependent on I/O module installed in terminal base <sup>(1)</sup>
Isolation Voltage	240V ac, Reinforced Insulation Type Tested at 3250 V dc for 60 s, field-side to system
Enclosure Type Rating	None (open-style)
Field Power Bus Supply Voltage	28.8V dc, 120/240V ac
Terminal Base Screw Torque	1734-TOP and 1734-TOP3 0.6 Nm (7 lb-in)

<sup>(1)</sup> Use this conductor category information for planning conductor routing as described in Industrial Automation Wiring and Grounding Guidelines, publication 1770-4.1.

## Environmental Specifications

Attribute	Value
Operating Temperature	IEC 60068-2-1 (Test Ad, Operating Cold), IEC 60068-2-2 (Test Bd, Operating Dry Heat), IEC 60068-2-14 (Test Nb, Operating Thermal Shock): -20...55 °C (-4...131 °F)
Relative Humidity	IEC 60068-2-30 (Test Db, Unpackaged Damp Heat): 5...95% noncondensing
Shock, Nonoperating	IEC 60068-2-27 (Test Ea, Unpackaged Shock): 50 g

## Environmental Specifications

Attribute	Value
Shock, Operating	IEC 60068-2-27 (Test Ea, Unpackaged Shock): 30 g
Storage Temperature	IEC 60068-2-1 (Test Ab, Unpackaged Nonoperating Cold), IEC 60068-2-2 (Test Bb, Unpackaged Nonoperating Dry Heat), IEC 60068-2-14 (Test Na, Unpackaged Nonoperating Thermal Shock); -40...85 °C (-40...185 °F)
Vibration	IEC 60068-2-6 (Test Fc, Operating): 5 g @ 10...500 Hz

## Certifications

Attribute	Value
Certification (when product is marked) <sup>(1)</sup>	C-Tick Australian Radiocommunications Act, compliant with: AS/NZS CISPR 11: Industrial Emissions c-UR-us UL Recognized Component Terminal Blocks, certified for US and Canada. See UL File E195367. CE European Union 89/336/EEC EMC Directive, compliant with: EN 50082-2: Industrial Immunity EN 61326: Meas./Control/Lab., Industrial Requirements EN 61000-6-2: Industrial Immunity EN 61000-6-4: Industrial Emissions EN 61131-2: Programmable Controllers (Clause 8, Zone A & B) European Union 73/23/EEC LVD, compliant with: EN 61131-2: Programmable Controllers (Clause 11).

<sup>(1)</sup> See the Product Certification link at [www.ab.com](http://www.ab.com) for Declarations of Conformity, Certificates, and other certification details.

Allen-Bradley, POINT I/O, and Rockwell Automation are trademarks of Rockwell Automation, Inc. Trademarks not belonging to Rockwell Automation are property of their respective companies.

[www.rockwellautomation.com](http://www.rockwellautomation.com)

### Power, Control and Information Solutions Headquarters

Americas: Rockwell Automation, 1201 South Second Street, Milwaukee, WI 53204-2496 USA, Tel: (1) 414.382.2000, Fax: (1) 414.382.4444  
Europe/Middle East/Africa: Rockwell Automation, Vorstlaan/Boulevard du Souverain 36, 1170 Brussels, Belgium, Tel: (32) 2.663.0000, Fax: (32) 2.663.0640  
Asia Pacific: Rockwell Automation, Level 14, Core F, Cyberport 5, 100 Cyberport Road, Hong Kong, Tel: (852) 2887.4788, Fax: (852) 2568.1846

Publication 1734-IN028A-EN-P - June 2006

PN 957955-36

Copyright © 2006 Rockwell Automation, Inc. All rights reserved. Printed in the U.S.A