


TRIONIC, CLASS RK5 TIME DELAY FUSE
 PEAK LET THRU CURRENT DATA
 30-600 AMPS 250 VOLTS
 CAT. NO. TR(AMP RATING)R(ID)
 MERSEN USA NEWBURYPORT-MA, LLC
 NEWBURYPORT, MA 01950

7669

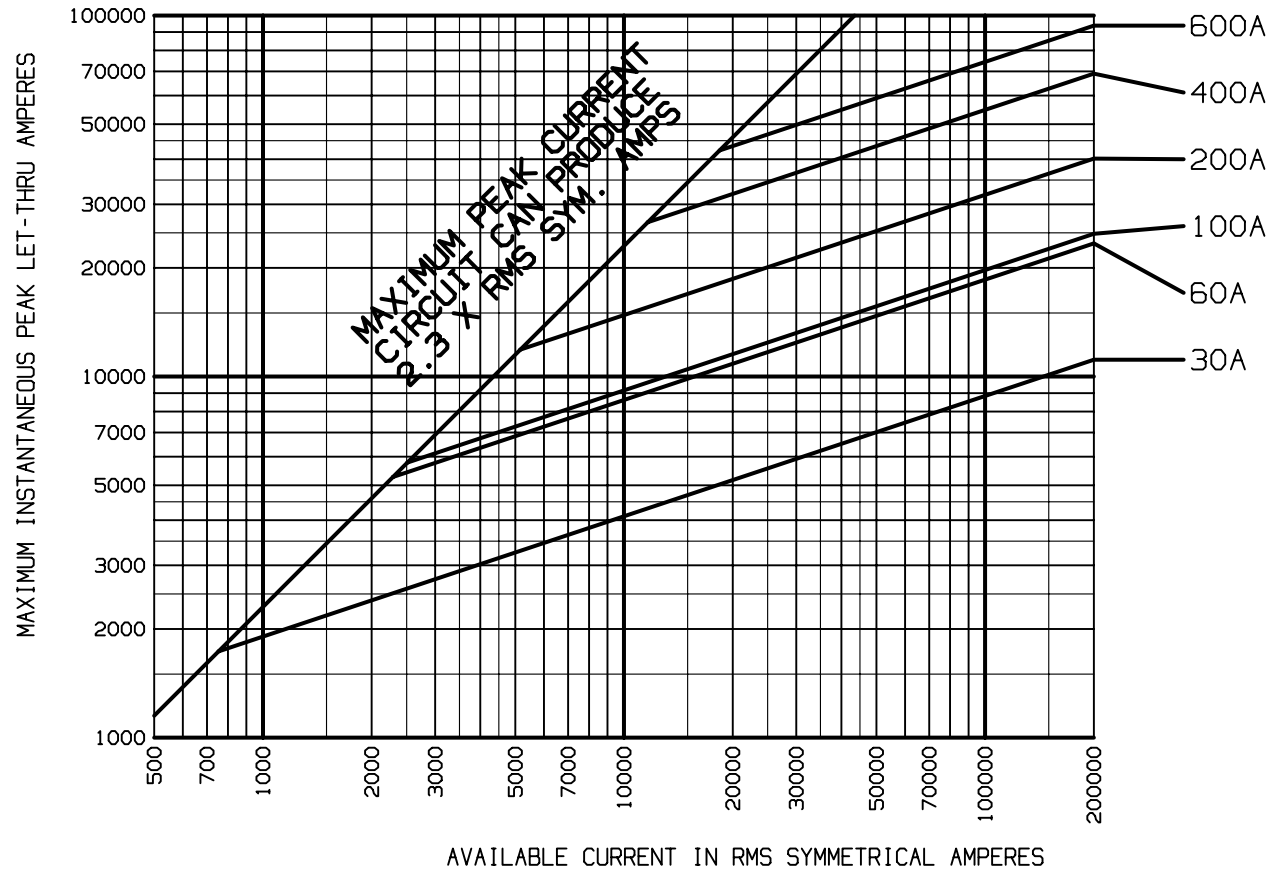

CONTROL NO.: 1259
 REV.: G
 FOLDER NO.: 38
 DATE: 12-30-09