

Instruction leaflet for ground fault protector/earth leakage protector for LG circuit breakers and motor circuit protectors

El protector de fallas a tierra y escapes a tierra para interruptores de circuito y protectores de circuito de motores

⚠ CAUTION

DO NOT ATTEMPT TO INSTALL OR PERFORM MAINTENANCE ON EQUIPMENT WHILE IT IS ENERGIZED. DEATH OR SEVERE PERSONAL INJURY CAN RESULT FROM CONTACT WITH ENERGIZED EQUIPMENT. ALWAYS VERIFY THAT NO VOLTAGE IS PRESENT BEFORE PROCEEDING.

⚠ ADVERTENCIA

NO INTENTE INSTALAR O LLEVAR A CABO TRABAJOS DE MANTENIMIENTO EN EL EQUIPO MIENTRAS TENGA ENERGIA. EL CONTACTO CON EQUIPO CON ENERGIA PUEDE PROVOCAR LA MUERTE O LESIONES PERSONALES SEVERAS. ANTES DE PROCEDER, VERIFIQUE SIEMPRE QUE NO HAYA VOLTAJE PRESENTE.

Attach Endcap.
Coloque el cubrefalta.




Figure 1.

Push Down.
Presione hacia abajo.

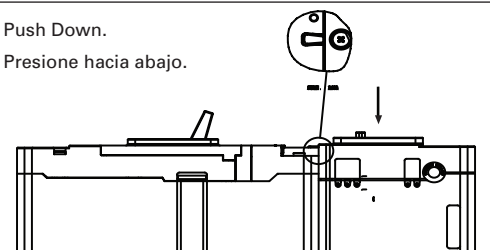


Figure 3.

Breaker Must Be in OFF Position for Assembly.

Antes de conectar el Interruptor debe estar en la posición de apagado (OFF).

ⓑ Insert Unit Into Breaker.

Coloque la unidad en el interruptor.

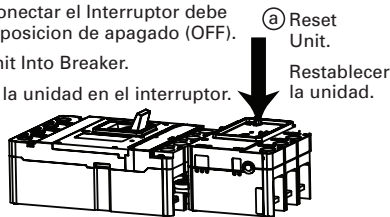


Figure 2.

Insert Screws in Retainers.

Coloque los tornillos en los retenedores.




Figure 4.

EAT•N

Powering Business Worldwide

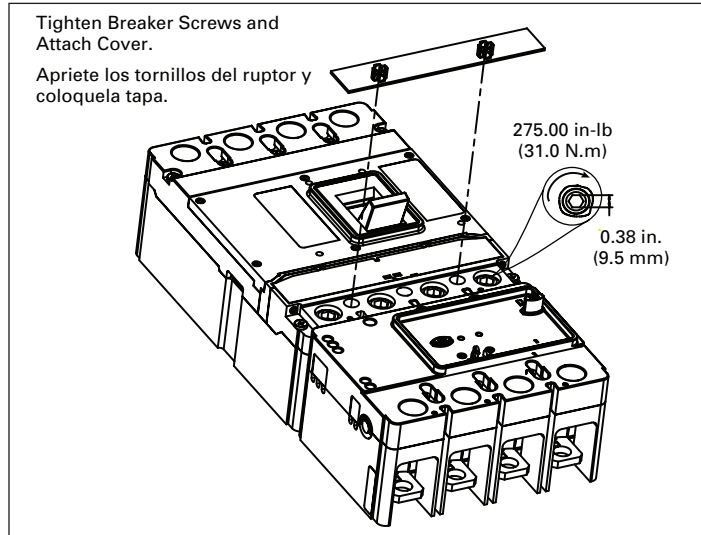


Figure 5.

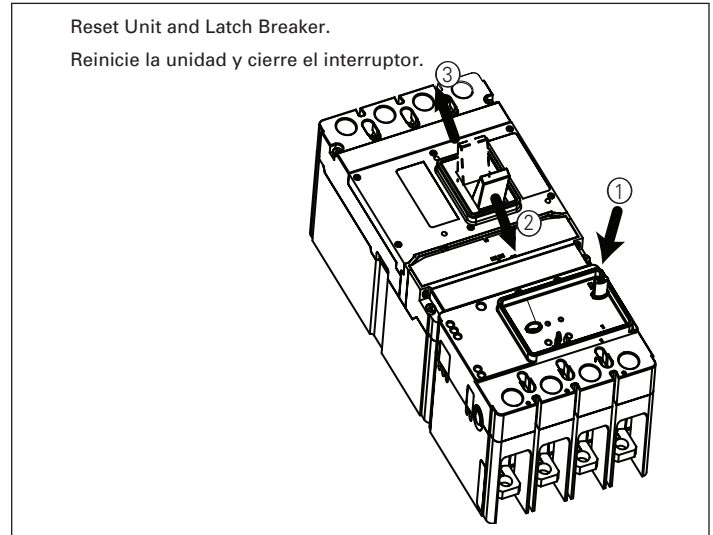


Figure 8.

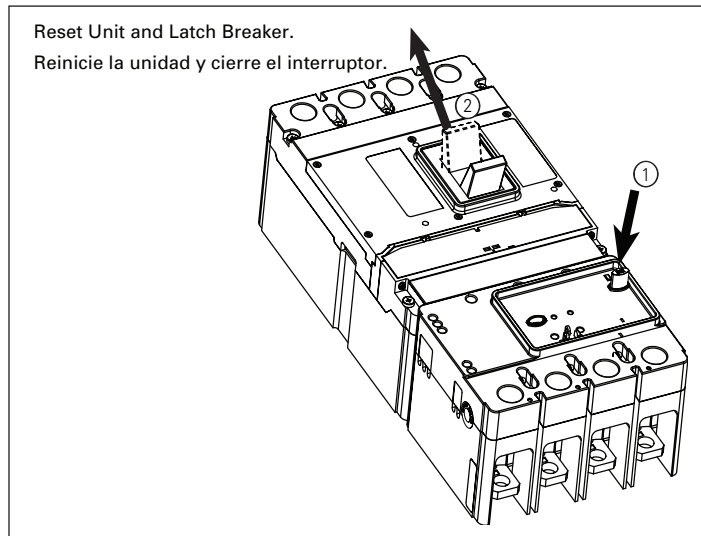


Figure 6.

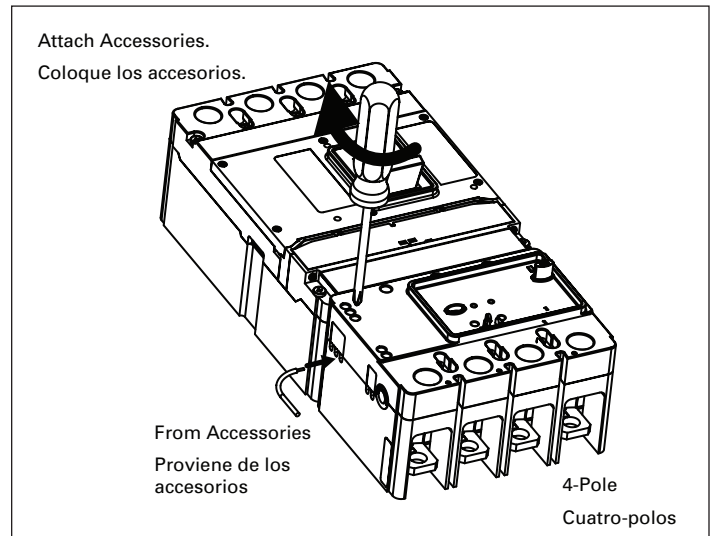


Figure 9.

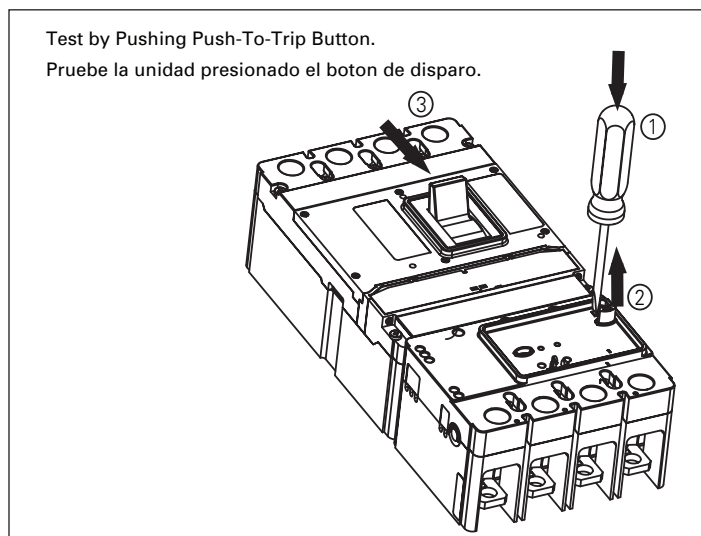


Figure 7.

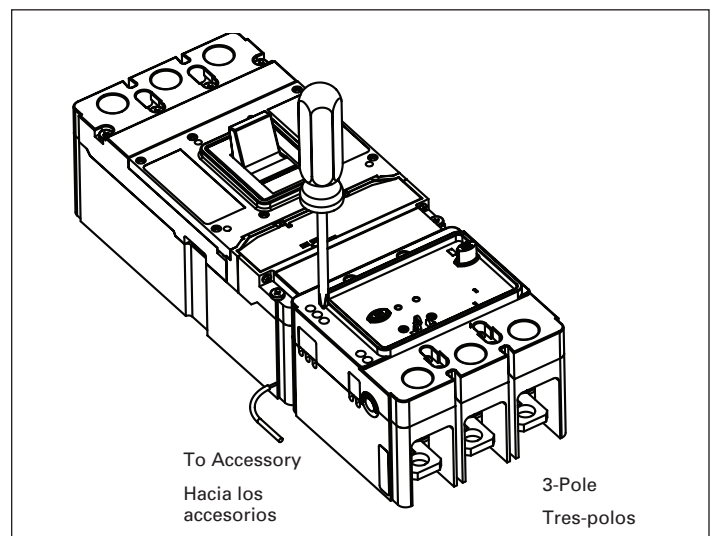


Figure 10.

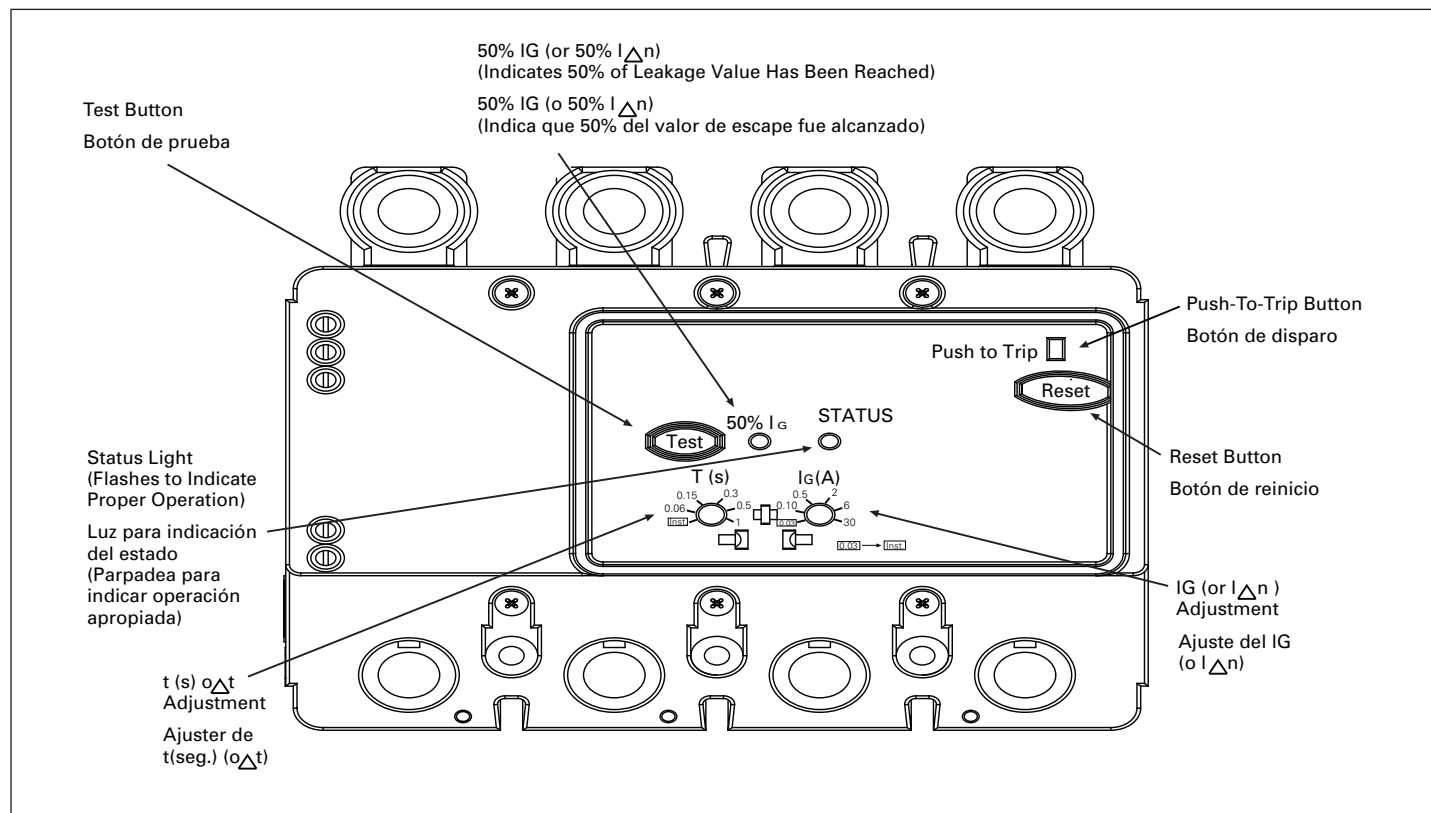


Figure 11.

Table 1a. LG-Frame Line and Load Terminations

Frame Type	Wire Type	Wire Size		Terminal Materials	Catalog Number	Torque	
		AWG	mm ²			Lb In	Nm
LG-Frame	Cu/Al	500–750 ①	240–380 ①	Aluminum	TA631L ②	550	62
LG-Frame	Cu	500–750 ①	240–380 ①	Copper	T631L ②	500	57
LG-Frame	Cu/Al	2–500 ②	35–240 ②	Aluminum	TA632L ① ②	375	42
LG-Frame	Cu	2–500 ②	35–240 ②	Copper	T632L ②	375	42
LG-Frame	Cu/Al	2–500 ①	35–240 ①	Aluminum	TA350L	375	42
LG-Frame	Cu	2–500 ①	35–240 ①	Copper	T350L	375	42

① Standard collars mounted on line and load end.

② Terminal shield required for TA631L, T631L, TA632L AND T632L.

Table 1b. Terminaciones de línea y carga del marco LG

Tipo de marco	Tipo de alambre	Tamano de alambre		Materials de la terminal	Numero de catalogo	Torsion	
		AWG	mm ²			Lb In	Nm
Marco LG	Cu/Al	500–750 ①	240–380 ①	Aluminio	TA631L ②	550	62
Marco LG	Cu	500–750 ①	240–380 ①	Cobre	T631L ②	500	57
Marco LG	Cu/Al	2–500 ②	35–240 ②	Aluminio	TA632L ① ②	375	42
Marco LG	Cu	2–500 ②	35–240 ②	Cobre	T632L ②	375	42
Marco LG	Cu/Al	2–500 ①	35–240 ①	Aluminio	TA350L	375	42
Marco LG	Cu	2–500 ①	35–240 ①	Cobre	T350L	375	42

① Lleva terminales estandar montados en los extremos de línea y carga.

② Protector de terminales son requeridos para TA631L, T631L, TA632L and T632L.

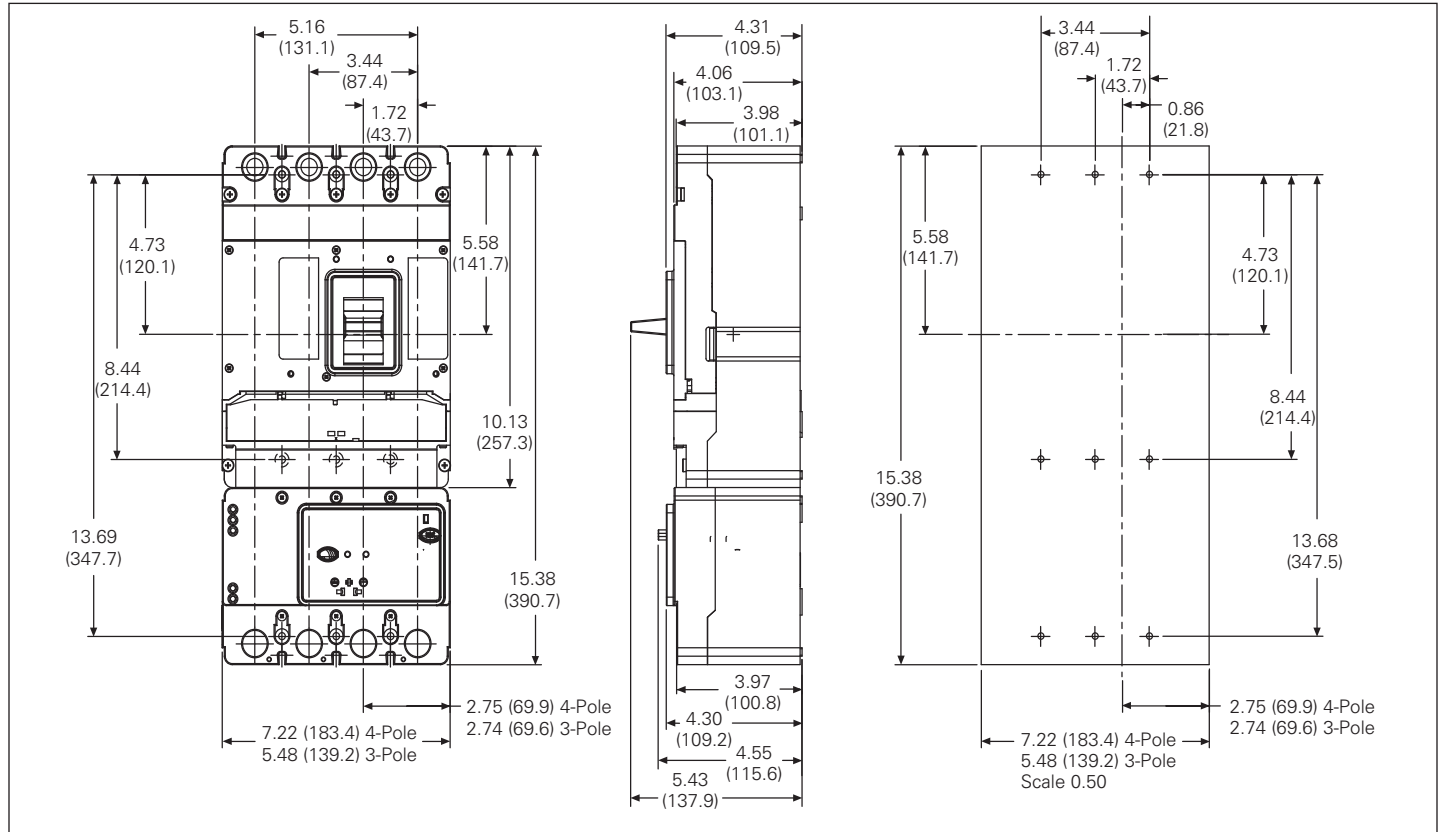


Figure 12.

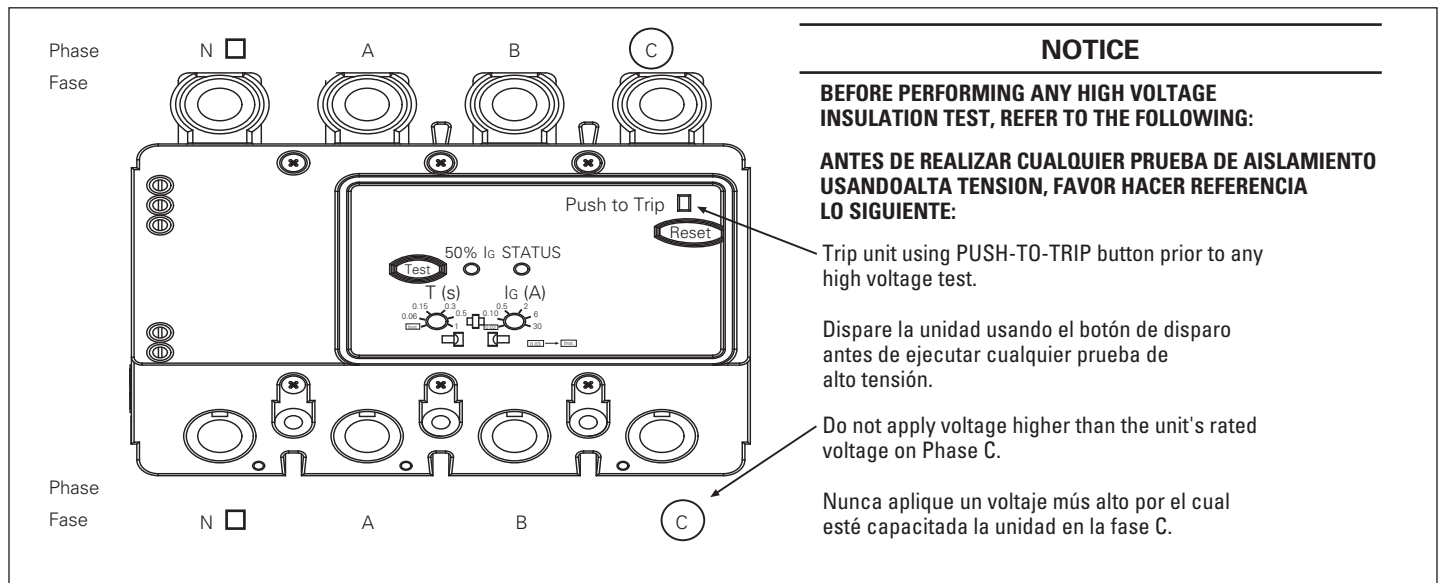


Figure 13.

Eaton Corporation
Electrical Sector
1111 Superior Ave.
Cleveland, OH 44114
United States
877-ETN-CARE (877-386-2273)
Eaton.com

© 2010 Eaton Corporation
All Rights Reserved
Printed in USA
Publication No. IL01216001E / Z9925
May 2010