



KILLARK®

INSTALLATION, OPERATION & MAINTENANCE DATA SHEET

MOUNTING PAN HOLE KEY – STARTER ENCLOSURE
NEMA SIZE 0 AND 1; CATALOG NO. B7011



MOUNTING PAN HOLE KEY – STARTER ENCLOSURE

CAUTION:

Before installing, make sure you are compliant with area classifications, failure to do so may result in bodily injury, death and property damage. Do not attempt installation until you are familiar with the following procedures. All installation must comply with the applicable Electrical Code.

Make sure that the circuit is de-energized before starting installation or maintenance.

Verify that the installation is grounded. Failure to ground will create electrical shock hazards, which can cause serious injury and or death.


Technical information, advice and recommendations contained in these documents is based upon information that Killark believes to be reliable. All the information and advice contained in these documents is intended for use only by persons having been trained and possessing the requisite skill and know-how and to be used by such persons only at their own discretion and risk. The nature of these instructions is informative only and does not cover all of the details, variations or combinations in which this equipment may be used, its storage, delivery, installation, check out, safe operation and maintenance. Since conditions of use of the product are outside of the care, custody and control of Killark, the purchaser should determine the suitability of the product for his intended use, and assumes all risk and liability whatsoever in connection therewith.

KILLARK®



3940 Dr. Martin Luther King Drive
St. Louis, MO 63113

P/N 00911623 FORM NO. K1056 R01/02 ECO 4-6-01

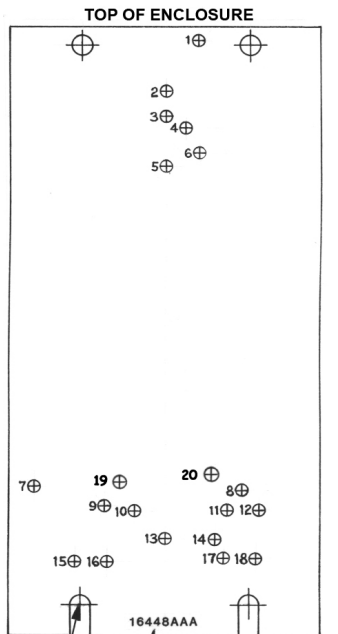

PAN IDENTIFICATION
NUMBER

INSTALL PAN IN ENCLOSURE,
USING (4) 1/4 - 20 x 1/2" SCREWS

STARTER MANUFACTURER	CATALOG SERIES	USE MOUNTING HOLE NOS.
ALLEN-BRADLEY	509	2, 15, 18
CUTLER-HAMMER	A10, AN16	2, 9, 11
FURNAS	14	6, 10, 12
GENERAL ELECTRIC	CR306	2, 9, 11
SQUARE D	8536	4, 13, 14
TELEMECANIQUE	A20	3, 7, 8
WESTINGHOUSE	A200	5, 16, 17
WESTINGHOUSE	W200	2, 19, 20

Notes:


1. Mount Starters, using #10-24 thread-forming screws, as indicated in above chart and as follows:
FURNAS (Qty. 2) 5/8" long
(Qty. 1) 3/8" long
ALL OTHERS (Qty. 3) 3/8" long
2. Mount Optional Ground Lug in Hole No. 1, using a 1/4-20 screw. (Order Killark Cat. No. KIT-345.)

NOTE: Westinghouse (Cutler-Hammer) W200 Series Starters are electrically reset and do not use this manual reset.

STARTER MANUFACTURER	CATALOG SERIES	SPACER		RESET PLATE HOLE NUMBERS
		LENGTH	QTY.	
ALLEN-BRADLEY	509	NONE REQUIRED	—	—
CUTLER-HAMMER	A10	5/8"	1	4
FURNAS	14	1-3/8"	1	7
GENERAL ELECTRIC	CR306	5/8"	1	1
SQUARE D	8536	5/8"	1	6, 7
TELEMECANIQUE	A20	5/8"	3	2, 3, 4
WESTINGHOUSE	A200	NONE REQUIRED	—	—
CUTLER-HAMMER	AN16	5/8"	1	9

RESET PLATE HOLE KEY

STARTER ONLY AND COMBINATION SIZE 0 AND 1
CATALOG NUMBERS B7011 & B7021

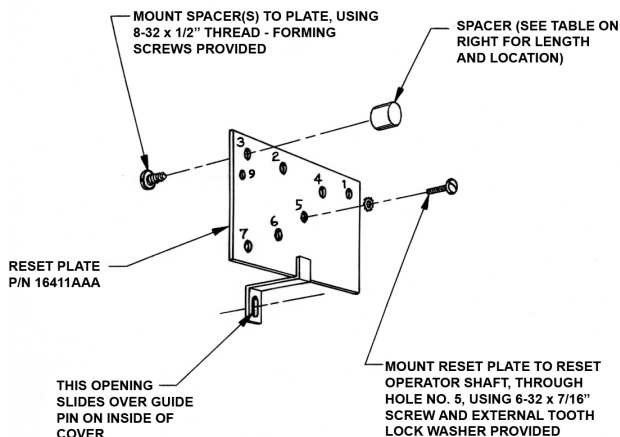

KILLARK® Chalmert

Victor
Lighting

Vantage
Technology

RIG POWER

HAWKE
International

3940 Dr. Martin Luther King Drive
St. Louis, MO 63113

P/N 00911623 FORM NO. K1056 R01/02 ECO 4-6-01