

INSTRUCTIONS FOR SINGLE RECEPTACLE

NOTICE: For installation by a qualified electrician in accordance with national and local electrical codes and the following instructions.

CAUTION: RISK OF ELECTRIC SHOCK. Disconnect power before installing.

CAUTION: USE COPPER CONDUCTORS ONLY.

Check that the device's type and rating are appropriate for the application.

Select conductors having 90°C or higher rated insulation having sufficient ampacity in accordance with the 60°C column of National Electrical Code® Table 310-16 or Canadian Electrical Code Table 2.

Remove 9/16 in. insulation from conductors. Strip gauge is on device.

DO NOT TIN CONDUCTORS.

Loosen terminal screws. Insert conductors fully into proper terminals as identified in the chart.

TERMINAL:	CONDUCTOR:
Green Hex Screw	Equipment grounding conductor (green or green/yellow)
White Screw	Grounded circuit conductor, Neutral (white or gray)
Brass/Black Screw	Ungrounded circuit conductor, (NOT white, NOT green)

CAUTION: Mounting not grounded. CONNECT GREEN (OR BARE) GROUNDING WIRE.

Tighten terminal screws to 18 pound-inch(2.0 N·m) of torque.

TAKE CAUTION THAT THERE ARE NO STRAY WIRE STRANDS.

This device is designed for type 3R applications when mounted to Hubbell Non-Metallic Back Box catalog number BB2030N, Hubbell Pin and Sleeve metal back boxes catalog numbers FT202W or FT302W, SPIDER II catalog numbers SBTL1, SBTL2, SBSB1 or SBSB2.

If this device is mounted to other enclosures or equipment, the Type designation may not apply. See figure for mounting dimensions.


Receptacle must be mounted with hinge up.

Install the gasket and mounting screws.

Four #10 Plastite® type screws (not provided) are required to mount this device to non-metallic enclosures and BB2030N. (Plastite® is a registered trade mark of Camcar division of Textron, Inc.)

Four #10-24 UNC screws (not provided) are required to mount this device to metal enclosures FT202W, FT302W, BB201W, or BB301W.

Four #10-32 screws (not provided) are required to mount this device to Spider II enclosures SBTL1, SBTL2, SBSB1 or SBSB2. Tighten Screws to 20 pound-inch (2.2N·m) of Torque

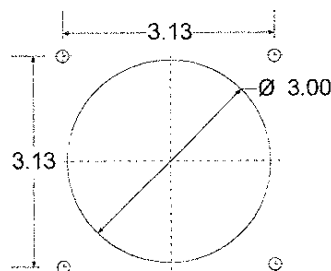

MOUNTING DIMENSIONS



Wiring Device-Kellems

PD1449 12/97

Hubbell Incorporated (Delaware) 185 Plains Road • Milford, CT 06460-8897 • (203) 882-4800