


Preventa safety modules

For electrical monitoring of two-hand control stations

XPSBAE, XPSBCE, XPSBF

Catalog

October 2015



How can you fit a 6000-page catalog in your pocket ?


Schneider Electric provides you with the complete set of industrial automation catalogs all on a handy USB key for PC or in an application for tablets



Digi-Cat, a handy USB key for PC



- > Convenient to carry
- > Always up-to-date
- > Environmentally friendly
- > Easy-to-share format

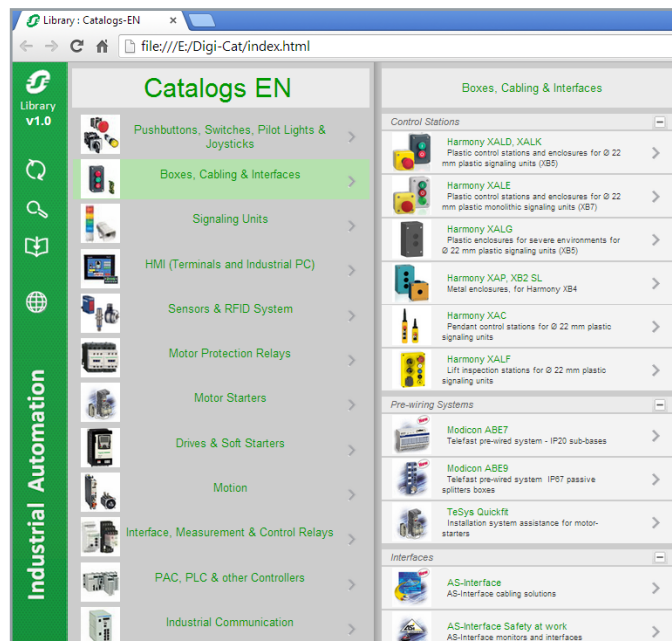

Contact your local representative to get your own Digi-Cat



e-Library, the app for tablets


If you have an iPad®:

- > Go to the App Store and search for e-Library
- > or scan the QR code



If you have an Android tablet:


- > Go to the Google Play Store™ and search for eLibrary
- > or scan the QR code

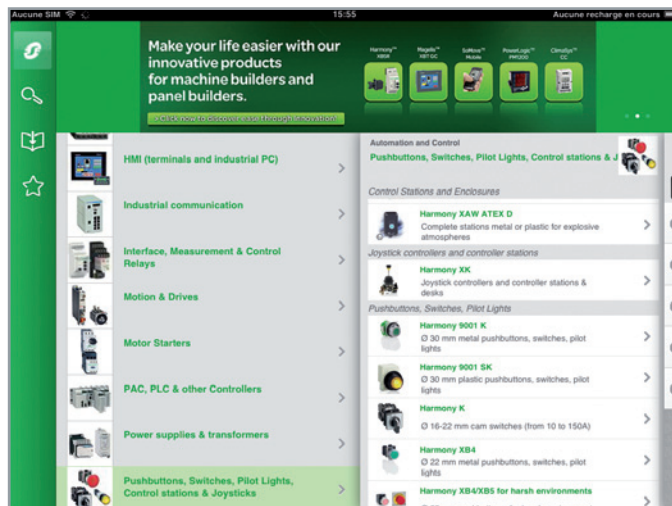

General contents

Preventa safety modules for electrical monitoring of two-hand control stations

■ Type XPSBAE, For electrical monitoring of two-hand control stations	
- Operating principle,	
- References	page 4
■ Type XPSBCE, For electrical monitoring of two-hand control stations	
- Operating principle,	
- References	page 5
■ Type XPSBF, For electrical monitoring of two-hand control stations	
- Operating principle,	
- References	page 6
■ Product reference index	
- Index	page 7



Operating principle

Two-hand control stations are designed to provide protection against hand injury. They require machine operators to keep their hands clear of the dangerous movement zone. The use of two-hand control is an individual protective measure, which can safely protect only one operator. Separate two-hand control stations must be provided for each operator in a multiple-worker environment.

Safety modules **XPSBAE** for two-hand control stations comply with the requirements of European standard EN 574/ISO 13851 for two-hand control systems.

The control stations must be designed and installed such that they cannot be activated involuntarily or easily rendered inoperative. Depending on the application, the requirements of type C standards specific to the machinery involved must be met (additional personal protection methods may have to be considered).

To initiate a dangerous movement, both operators (two-hand control pushbuttons) must be activated within an interval ≤ 0.5 s (synchronous activation). If one of the two pushbuttons is released during a dangerous operation, the control sequence is cancelled. Resumption of the dangerous operation is possible only if both pushbuttons are returned to their initial position and reactivated within the required time interval.

The safety distance between the control units and the hazardous zone must be sufficient to ensure that when only one operator is released, the hazardous zone cannot be reached before the dangerous movement has been completed or stopped.

Maximum achievable safety level

- PL c/Category 1 conforming to EN/ISO 13849-1
- SILCL1 conforming to EN/IEC 62061

Product certifications

- UL
- CSA
- TÜV

Selection

Requirements of standard EN 574/ISO 13851

Standard EN 574/ISO 13851 defines the selection of two-hand controls according to its behavior. The following table details the 3 types of two-hand control conforming to EN 574/ISO 13851. For each type, it lists the operating characteristics and minimum requirements.

	Type I	Type II	Type III		
			A	B	C
Use of both hands (simultaneous action)					
Link between input and output signals					
Output signal inhibited					
Prevention of accidental operation					
Tamper-proof					
Output signal reinitialised					
Synchronous action (specified time limit)					
Use of proven components (Category 1 conforming to EN/ISO 13849-1)			XPSBAE		
Redundancy with partial error detection (Category 3 conforming to EN/ISO 13849-1)				XPSBCE XPSBF	
Redundancy + Self-monitoring (Category 4 conforming to EN/ISO 13849-1)					XPSBCE XPSBF
Two-hand control station	XY2SB●●				

Conforming to standard EN/ISO 13849-1

Meets the requirements of standard EN 574/ISO 13851

References


Description	Type conforming to standard EN 574	Connection	Number of safety circuits	Additional outputs	Supply	Reference	Weight kg/ lb
Safety modules for electrical monitoring of two-hand control stations	III A	Captive screw clamp terminals Terminal block removable from module	1 NO	1 NC	~ and 24 V $\square$	XPSBAE5120P	0.100/ 0.220
					~ 115/230V	XPSBAE3920P	0.100/ 0.220
		Spring terminals Terminal block removable from module	1 NO	1 NC	~ and 24 V $\square$	XPSBAE5120C	0.100/ 0.220
					~ 115/230V	XPSBAE3920C	0.100/ 0.220



XPSBAE5120P



XPSBAE5120C



Operating principle

Two-hand control stations are designed to provide protection against hand injury.

They require machine operators to keep their hands clear of the dangerous movement zone.

The use of two-hand control is an individual protective measure, which can safely protect only one operator.

Separate two-hand control stations must be provided for each operator in a multiple-worker environment.

Safety modules **XPSBCE** for two-hand control stations comply with the requirements of European standard EN 574/ISO 13851 for two-hand control systems.

The control stations must be designed and installed such that they cannot be activated involuntarily or easily rendered inoperative. Depending on the application, the requirements of type C standards specific to the machinery involved must be met (additional personal protection methods may have to be considered).

To initiate a dangerous movement, both operators (two-hand control pushbuttons) must be activated within an interval ≤ 0.5 s (synchronous activation). If one of the two pushbuttons is released during a dangerous operation, the control sequence is cancelled. Resumption of the dangerous operation is possible only if both pushbuttons are returned to their initial position and reactivated within the required time interval.

The safety distance between the control units and the hazardous zone must be sufficient to ensure that when only one operator is released, the hazardous zone cannot be reached before the dangerous movement has been completed or stopped.

Maximum achievable safety level

- PL e/Category 4 conforming to EN/ISO 13849-1
- SILCL3 conforming to EN/IEC 61508 and EN/IEC 62061

Product certifications

- UL
- CSA
- BG

Selection

Requirements of standard EN 574/ISO 13851

Standard EN 574/ISO 13851 defines the selection of two-hand controls according to its behavior. The following table details the 3 types of two-hand control conforming to EN 574/ISO 13851. For each type, it lists the operating characteristics and minimum requirements.

	Type I	Type II	Type III		
			A	B	C
Use of both hands (simultaneous action)					
Link between input and output signals					
Output signal inhibited					
Prevention of accidental operation					
Tamper-proof					
Output signal reinitialised					
Synchronous action (specified time limit)					
Use of proven components (Category 1 conforming to EN/ISO 13849-1)			XPSBAE		
Redundancy with partial error detection (Category 3 conforming to EN/ISO 13849-1)				XPSBCE XPSBF	
Redundancy + Self-monitoring (Category 4 conforming to EN/ISO 13849-1)					XPSBCE XPSBF
Two-hand control station	XY2SB●●				

Conforming to standard EN/ISO 13849-1

Meets the requirements of standard EN 574/ISO 13851

References


Description	Type conforming to standard EN 574	Connection	Number of safety circuits	Additional outputs	Supply	Reference	Weight kg/ lb
Safety modules for electrical monitoring of two-hand control stations	III C	Captive screw clamp terminals Terminal block removable from module	2 NO	1 NC relay	~ and 24 V ---	XPSBCE3110P	0.272/ 0.600
					~ 115/120 V	XPSBCE3410P	0.322/ 0.710
					~ 230 V	XPSBCE3710P	0.322/ 0.710
		Spring terminals Terminal block removable from module	2 NO	1 NC relay	~ and 24 V ---	XPSBCE3110C	0.272/ 0.600
					~ 115 /120 V	XPSBCE3410C	0.322/ 0.710
					~ 230 V	XPSBCE3710C	0.322/ 0.710



XPSBCE●●●●P



XPSBCE●●●●C



Operating principle

Two-hand control stations are designed to provide protection against hand injury. They require machine operators to keep their hands clear of the dangerous movement zone. The use of two-hand control is an individual protective measure, which can safely protect only one operator. Separate two-hand control stations must be provided for each operator in a multiple-worker environment.

Safety modules **XPSBF** for two-hand control stations comply with the requirements of European standard EN 574/ISO 13851 for two-hand control systems.

The control stations must be designed and installed such that they cannot be activated involuntarily or easily rendered inoperative. Depending on the application, the requirements of type C standards specific to the machinery involved must be met (additional personal protection methods may have to be considered).

To initiate a dangerous movement, both operators (two-hand control pushbuttons) must be activated within an interval ≤ 0.5 s (synchronous activation). If one of the two pushbuttons is released during a dangerous operation, the control sequence is cancelled. Resumption of the dangerous operation is possible only if both pushbuttons are returned to their initial position and reactivated within the required time interval.

The safety distance between the control units and the hazardous zone must be sufficient to ensure that when only one operator is released, the hazardous zone cannot be reached before the dangerous movement has been completed or stopped.

Maximum achievable safety level

- PL e/Category 4 conforming to EN/ISO 13849-1
- SILCL3 conforming to EN/IEC 61508 and EN/IEC 62061

Product certifications

- UL
- CSA
- TÜV

Selection

Requirements of standard EN 574/ISO 13851		Type I	Type II	Type III		
				A	B	C
Standard EN 574/ISO 13851 defines the selection of two-hand controls according to its behavior. The following table details the 3 types of two-hand control conforming to EN 574/ISO 13851. For each type, it lists the operating characteristics and minimum requirements.	Use of both hands (simultaneous action)					
	Link between input and output signals					
	Output signal inhibited					
	Prevention of accidental operation					
	Tamper-proof					
	Output signal reinitialised					
	Synchronous action (specified time limit)					
	Use of proven components (Category 1 conforming to EN/ISO 13849-1)			XPSBAE		
	Redundancy with partial error detection (Category 3 conforming to EN/ISO 13849-1)				XPSBCE XPSBF	
	Redundancy + Self-monitoring (Category 4 conforming to EN/ISO 13849-1)					XPSBCE XPSBF
Two-hand control station		XY2SB●●				

Conforming to standard EN/ISO 13849-1

Meets the requirements of standard EN 574/ISO 13851

References

Description	Type conforming to standard EN 574	Connection	Number of safety circuits	Additional outputs	Supply	Reference	Weight kg/ lb
Safety modules for electrical monitoring of two-hand control stations	III C	Captive screw clamp terminals Terminal block removable from module	2 NO	2 solid-state	— 24 V	XPSBF1132	0.150/ 0.331
			2 NO	2 solid-state	— 24 V	XPSBF1132P	0.150/ 0.331



XPSBF1132

XPSBAE3920C	4
XPSBAE3920P	4
XPSBAE5120C	4
XPSBAE5120P	4
XPSBCE3110C	5
XPSBCE3110P	5
XPSBCE3410C	5
XPSBCE3410P	5
XPSBCE3710C	5
XPSBCE3710P	5
XPSBF1132	6
XPSBF1132P	6



More information on
<http://www.schneider-electric.com/machinesafety>

Schneider Electric Industries SAS

Head Office
35, rue Joseph Monier
F-92500 Rueil-Malmaison
France

The information provided in this documentation contains general descriptions and/or technical characteristics of the performance of the products contained herein. This documentation is not intended as a substitute for and is not to be used for determining suitability or reliability of these products for specific user applications. It is the duty of any such user or integrator to perform the appropriate and complete risk analysis, evaluation and testing of the products with respect to the relevant specific application or use thereof. Neither Schneider Electric nor any of its affiliates or subsidiaries shall be responsible or liable for misuse of the information contained herein.

Design: Schneider Electric
Photos: Schneider Electric