


## PREFAB CONFIGURATION-6

PREFAB FRAME SIZE (KW)	MAX IT LOAD (KW)	PREFAB MODULE DIMENSIONS (APPROXIMATE)			MDP-100 SYSTEM VOLTAGE LEVEL (V)	UPS SYSTEM MODEL	SERVICE ENTRANCE PANEL MODEL	SERVICE ENTRANCE PANEL(A)	WALL MOUNT COOLING UNIT WITH DAMPER (MODEL)	NO. OF WALL MOUNT COOLING UNITS WITH DAMPER	IT RACK (MODEL)	NO. OF IT RACKS	RACK DENSITY (KW/RACK)	NUMBER OF SINGLE PHASE POLES IN MBP	IT RACK DIMENSIONS (APPROXIMATE)			RACK PDU (MODEL)
		DEPTH (FT)	WIDTH (FT)	HEIGHT (FT)											DEPTH (FT)	WIDTH (FT)	HEIGHT (FT)	
40	25	20	8	9.5	208	SYMMETRA PX40	I-LINE	800	BARD #W72AAP(OR #W72LAP)-B09W1XXV W/DAMPER	3	AR3100	5	5	42	3.5	2	6.5	AP8865

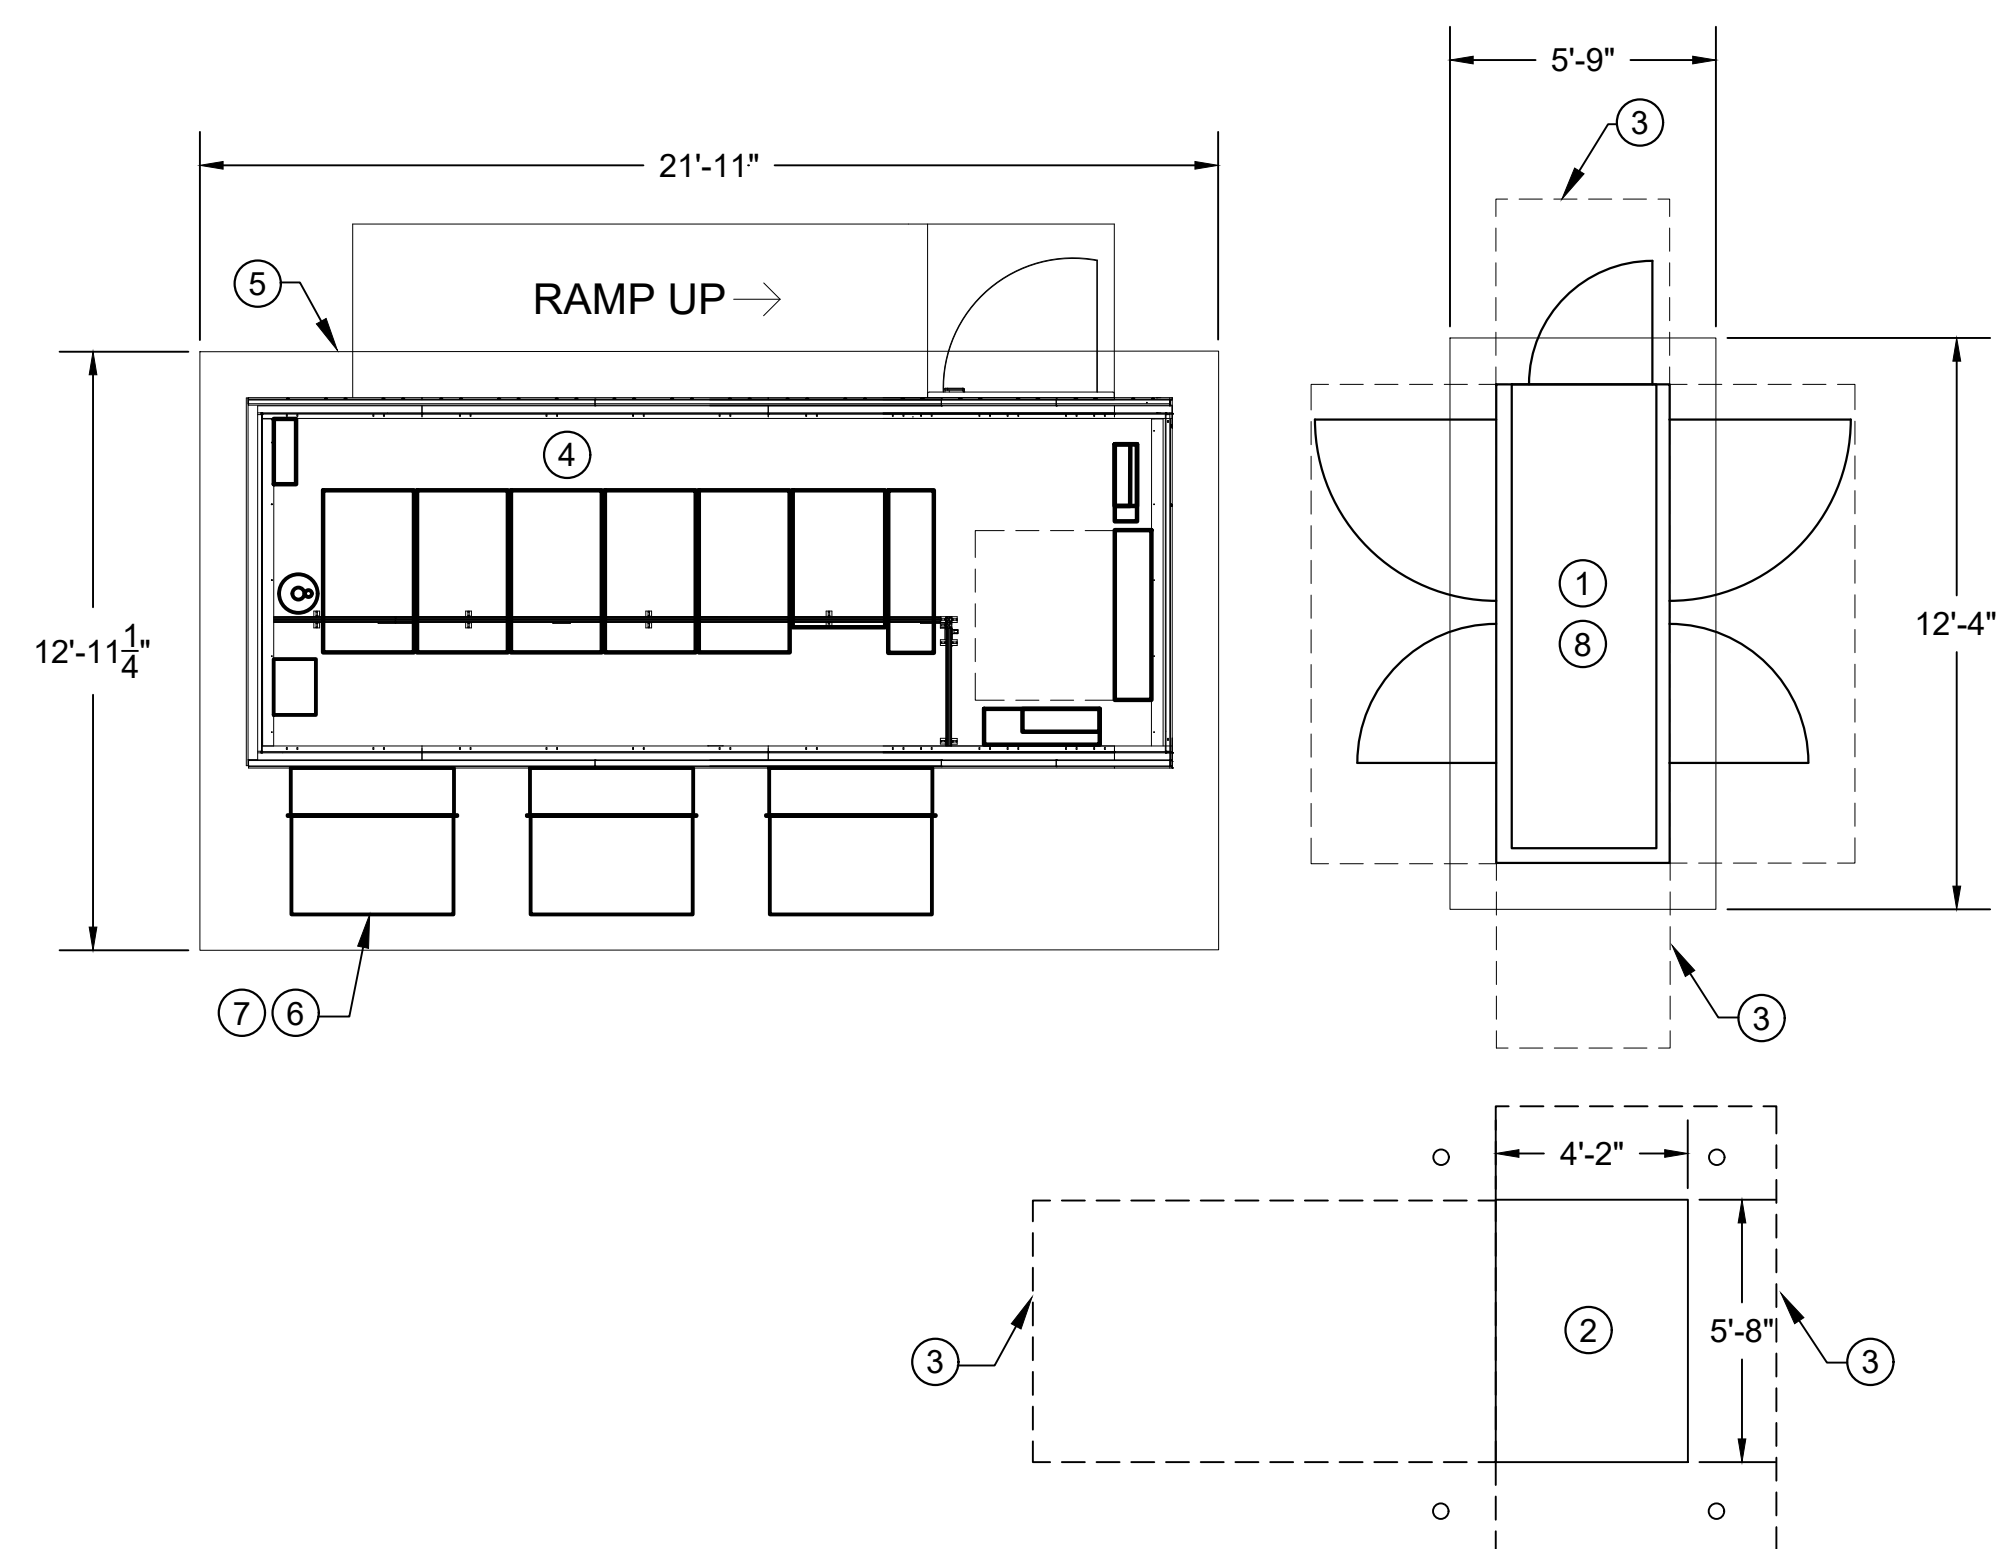

**GENERAL NOTES:**


1. REFER TO ONE LINE DIAGRAM ON SHEET E400 FOR ADDITIONAL DETAILS ON THE ELECTRICAL SYSTEM.
2. FOR ELECTRICAL SCHEDULES, SEE DRAWINGS ON SHEETS E600 AND E601.

**PLAN NOTES:**

- |                                    |  |
|------------------------------------|--|
| ① 100KW/125KVA STAND BY GENERATOR. | ④ REFER TO DRAWING E102 FOR PREFAB MODULE DETAILS.     |
| ② UTILITY TRANSFORMER.             | ⑤ CONCRETE PAD(TYPICAL).                               |
| ③ REQUIRED CLEARANCE (TYPICAL).    | ⑥ BARD W72 WALL MOUNT COOLING UNIT(TYPICAL OF 3 UNITS) |

- ⑦ A BUILT-IN DISCONNECT SHALL BE INCLUDED WITH EACH BAR W72 WALL MOUNT COOLING UNIT(TYPICAL OF 3).
- ⑧ GENERATOR SHALL INCLUDE A BUILT-IN CIRCUIT BREAKER. SEE ONE LINE DRAWING E400 FOR DETAILS.

CONSULTANTS:

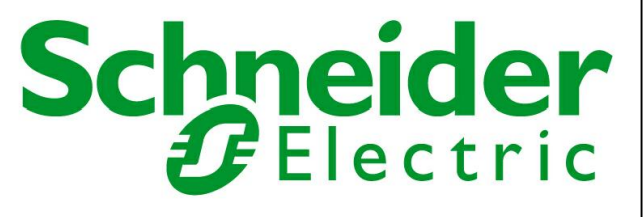

**IT MISSION CRITICAL SERVICES, INC.**  
12150 MONUMENT DRIVE SUITE 150 FAIRFAX, VA. 22033  
PH: 703-968-0300 FX: 703-654-3680

Schneider Electric IT  
Mission Critical Services, Inc.  
Proprietary use pursuant to company policy

IT IS A VIOLATION FOR ANY PERSON TO ALTER THIS DOCUMENT THAT BEARS THE SEAL OF A PROFESSIONAL ENGINEER, UNLESS THE PERSON IS ACTING UNDER THE DIRECTION OF A LICENSED PROFESSIONAL ENGINEER IN THE STATE OF WORK. THE ALTERING ENGINEER SHALL AFFIX THEIR SEAL AND THE NOTATION "ALTERED BY" FOLLOWED BY THEIR SIGNATURE AND THE DATE OF SUCH ALTERATION, AND A SPECIFIC DESCRIPTION OF THE ALTERATION TO THE DOCUMENT.

SEAL:

**NOT FOR  
CONSTRUCTION**

PROJECT INFORMATION:

25KW DATA CENTER  
REFERENCE DESIGN  
PREFAB CONFIGURATION-6

**KEYPLAN:**

[illegible]

SHEET TITLE:  
**ELECTRICAL  
SITE LAYOUT PLAN  
CONFIGURATION-6**

DATE: 05/2/2019

DRAWING NUMBER:


# E101

# ELECTRICAL SITE LAYOUT PLAN CONFIGURATION-6

SCALE: 1/4" = 1'-0"

PREFAB CONFIGURATION-6

PREFAB FRAME SIZE (KW)	MAX IT LOAD (KW)	PREFAB MODULE DIMENSIONS (APPROXIMATE)			MDP-100 SYSTEM VOLTAGE LEVEL (V)	UPS SYSTEM MODEL	SERVICE ENTRANCE PANEL MODEL	SERVICE ENTRANCE PANEL(A)	WALL MOUNT COOLING UNIT WITH DAMPER (MODEL)	NO. OF WALL MOUNT COOLING UNITS WITH DAMPER	IT RACK (MODEL)	NO. OF IT RACKS	RACK DENSITY (KW/RACK)	NUMBER OF SINGLE PHASE POLES IN MBP	IT RACK DIMENSIONS (APPROXIMATE)			RACK PDU (MODEL)
		DEPTH (FT)	WIDTH (FT)	HEIGHT (FT)											DEPTH (FT)	WIDTH (FT)	HEIGHT (FT)	
40	25	20	8	9.5	208	SYMMETRA PX40	I-LINE	800	BARD #W72AAP(OR #W72LAP)-B09W1XXV W/DAMPER	3	AR3100	5	5	42	3.5	2	6.5	AP8865

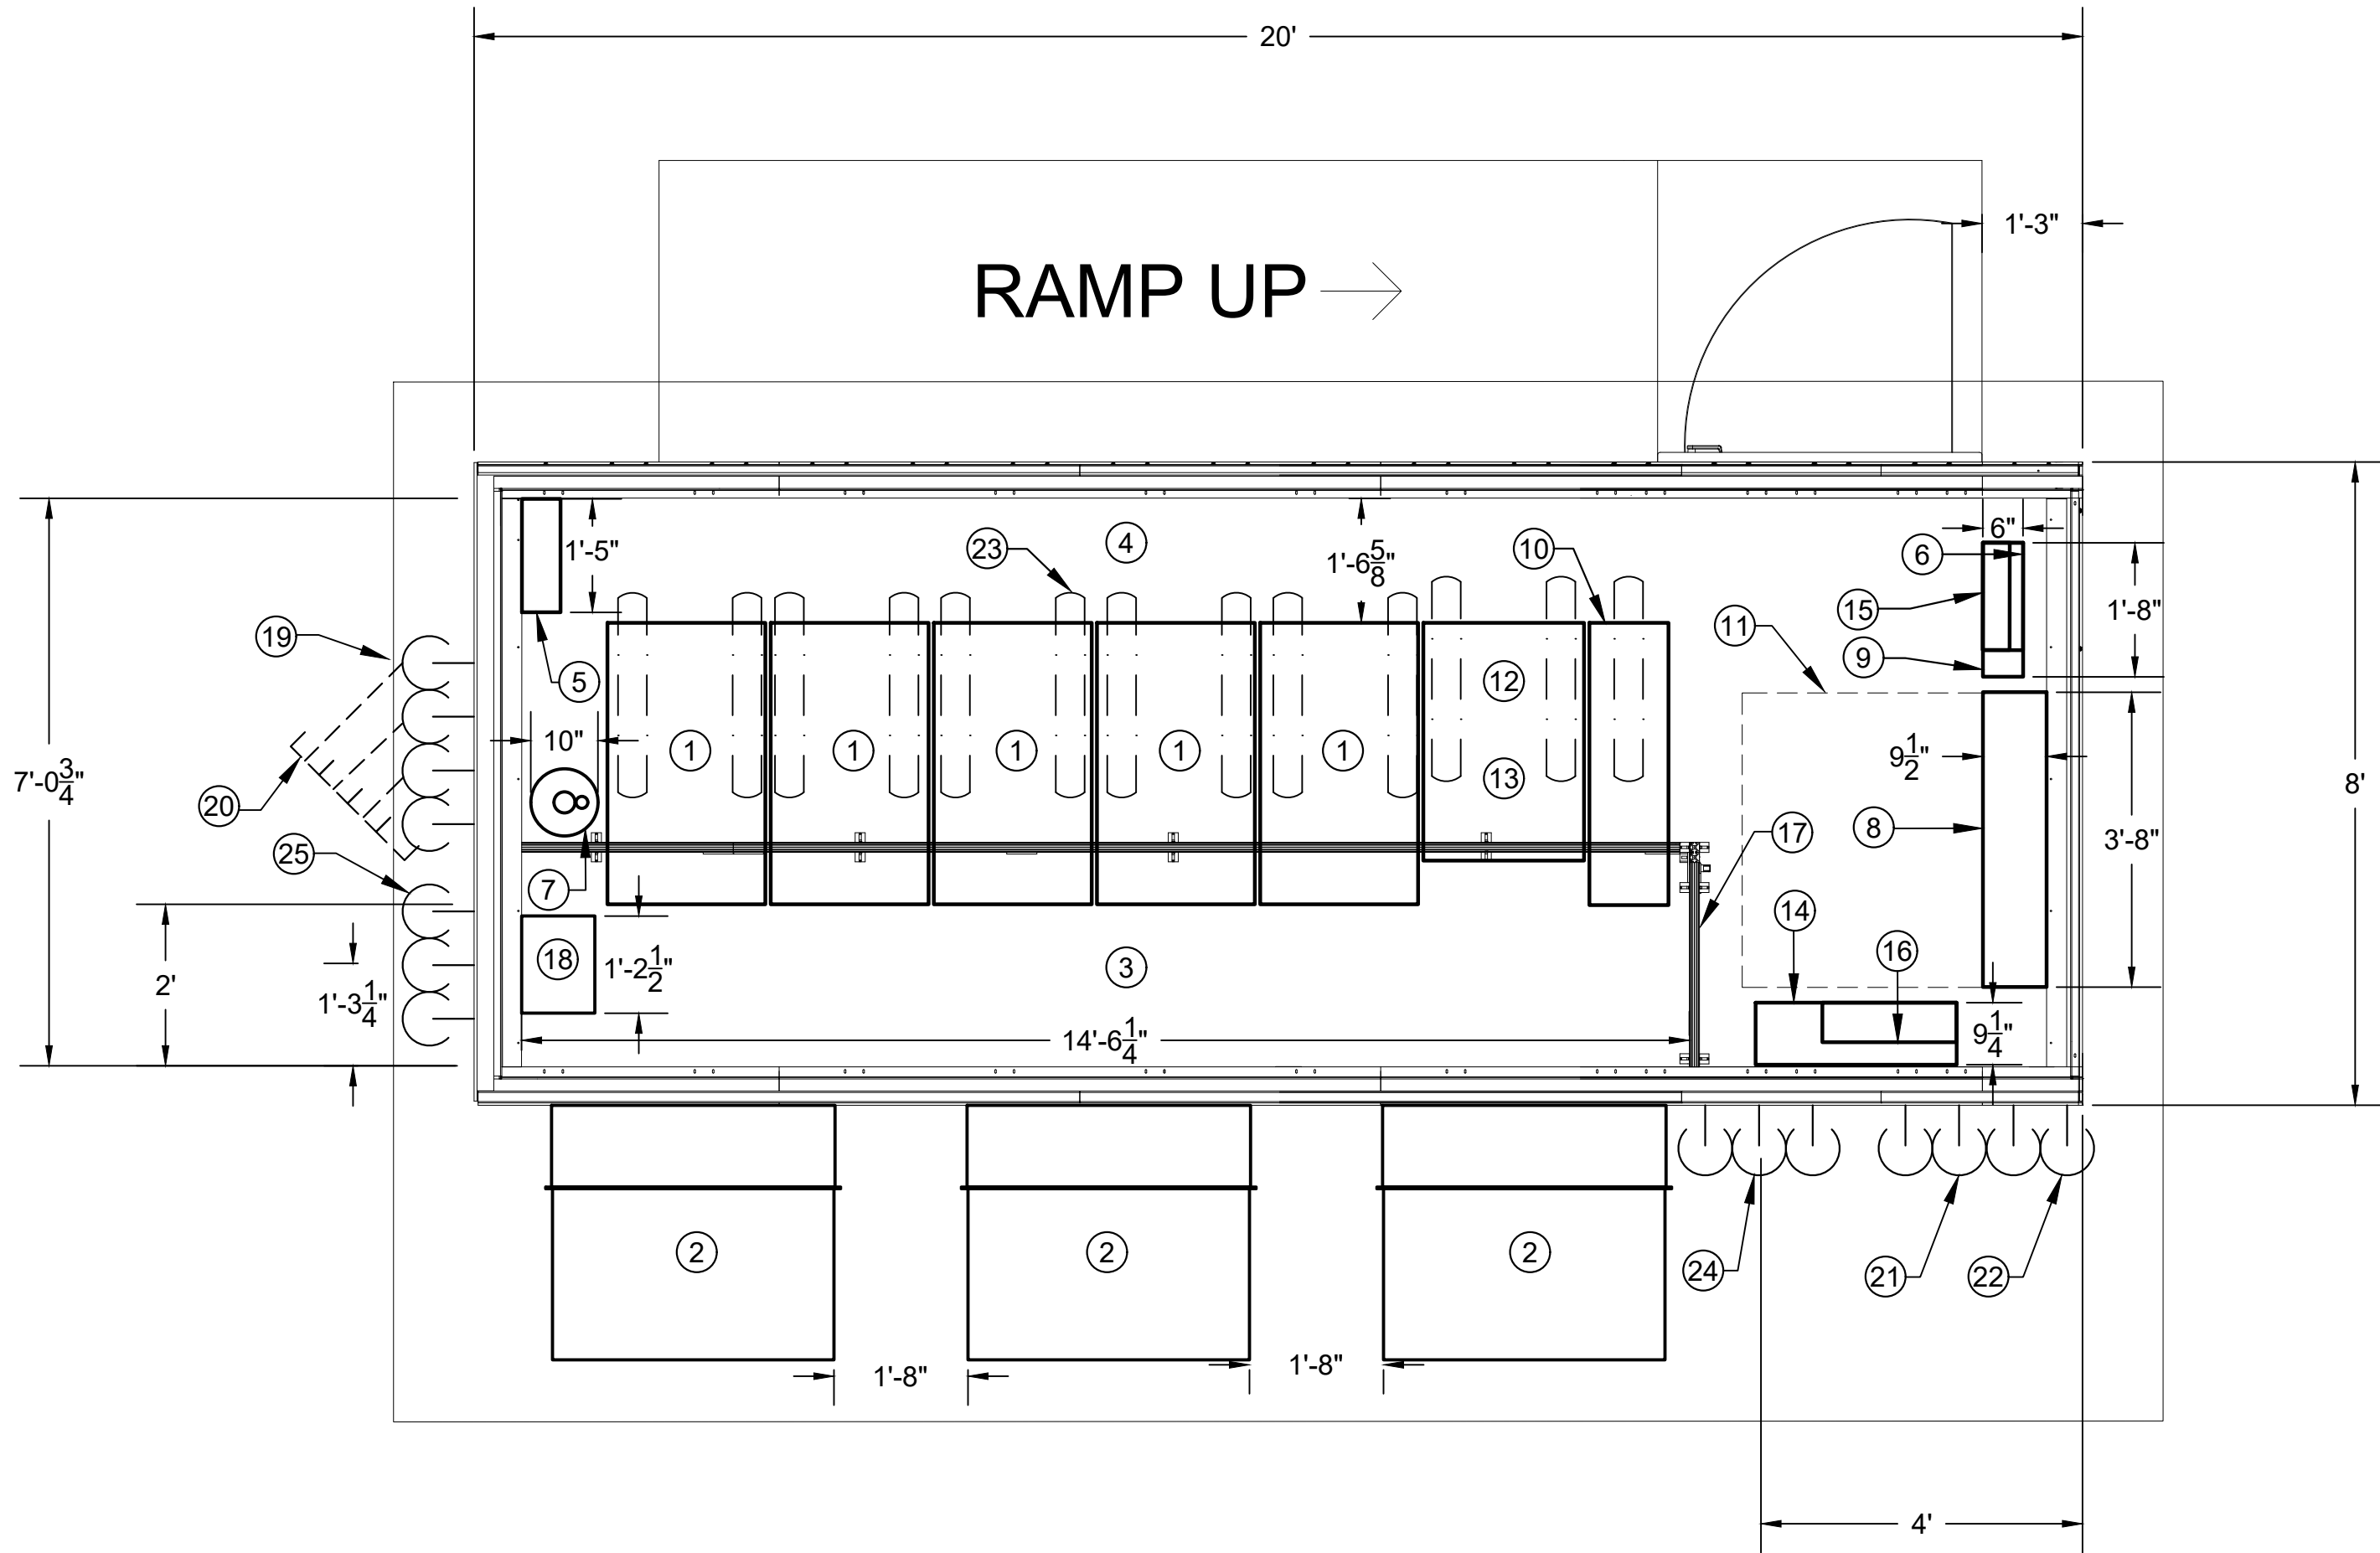

GENERAL NOTES:

- REFER TO THE ONE LINE DIAGRAM ON SHEET E400 FOR ADDITIONAL DETAILS ON THE ELECTRICAL SYSTEM.
- FOR ELECTRICAL SCHEDULES, SEE DRAWINGS ON SHEETS E600 AND E601.

PLAN NOTES:

- 1 IT RACK.

2 BARD(208V) #W72XXX-B09W1XXV WALL MOUNT COOLING UNIT W/DAMPER.

3 HOT AISLE.

4 COLD AISLE.

5 FIRE ALARM CONTROL PANEL. INSTALLATION SHALL BE AS PER NFPA 72 REQUIREMENTS.

6 GENERATOR ANNUNCIATOR PANEL (OPTIONAL).
- 7 FIRE SUPPRESSION CYLINDER.

8 208V SERVICE ENTRANCE MAIN DISTRIBUTION PANEL(MDP-100).

9 SOURCE TRANSFER CONTROL PANEL(CP-100).

10 SIDE CAR MODEL (SYBFF) FOR ROUTING POWER TO UPS.

11 REQUIRED CLEARANCE(TYPICAL).

12 PX40 UPS MODULE.
- 13 PX40 UPS BATTERY CABINET.

14 PX40 MAINTENANCE/SERVICE BYPASS PANEL.

15 ACCESS CONTROL PANEL (OPTIONAL).

16 DISTRIBUTION PANEL FED BY MAINTENANCE/SERVICE BYPASS PANEL. SEE PANEL MBP-300 SCHEDULE ON DRAWING E-601 FOR DETAILS.

17 SLIDING DOOR.

18 HUMIDIFIER(OPTIONAL).

- 19 PROVIDE FOUR(4) 3" CONDUITS FOR DATA/FIBER OPTICS. CONDUITS SHALL BE CONNECTED PERPENDICULARLY TO MODULE WALL AT 100-1/2" ABOVE FINISHED SLAB AT LOCATION SHOWN. TURN VERTICALLY WITH A 36" RADIUS DOWN TO SLAB FOR UNDERGROUND RUN. PROVIDE UNDERGROUND PORTION TO JUST OUTSIDE OF SLAB EDGE AS SHOWN. PROVIDE STRUCTURAL SUPPORT FOR ABOVEGROUND PORTION. CO-ORDINATE HEIGHT OF CONDUITS ABOVE FINISHED SLAB AS REQUIRED.

20 RUN UNDERGROUND PORTION DIAGONALLY AT 45 DEGREES TO THE LEFT, AS SHOWN, TO EXTEND 48" BEYOND THE EDGE OF THE PAD TO BE CONTINUED BY OTHERS. CAP CONDUIT ENDS AT THIS POINT.

21 PROVIDE ONE(1) 3" CONCRETE ENCASED UNDERGROUND PVC SCH-80 CONDUITS FOR POWER FROM UTILITY.

22 PROVIDE ONE(1) 3" AND TWO(2) 3/4" CONCRETE ENCASED UNDERGROUND PVC SCH-80 CONDUITS FOR POWER AND CONTROLS FROM GENERATOR.

23 E-CHAINS(TYP.) FOR PROVIDING RACK MOVEMENT FOR PROVIDING WORKING DEPTH ADJUSTMENT ON FRONT AND REAR SIDE OF THE RACK AS REQUIRED.

24 CONDUITS FOR POWER CONNECTIONS TO WALL MOUNT COOLING UNITS. CONDUITS SHALL BE CONNECTED PERPENDICULARLY TO MODULE WALL AT 100-1/2" ABOVE FINISHED SLAB AT LOCATION SHOWN.CO-ORDINATE HEIGHT OF CONDUITS ABOVE FINISHED SLAB AS REQUIRED.

25 PIPES FOR HUMIDIFICATION AND DEHUMIDIFICATION. PIPES SHALL BE CONNECTED PERPENDICULARLY TO MODULE WALL AT 7-1/2"ABOVE FINISHED SLAB AT LOCATION SHOWN.

ELECTRICAL PREFAB MODULE DETAILS CONFIGURATION-6

SCALE: 1/2" = 1'-0"

CONSULTANTS:



IT MISSION CRITICAL SERVICES, INC.  
12150 MONUMENT DRIVE SUITE 150 FAIRFAX, VA. 22033  
PH: 703-968-0300 FX: 703-654-3680

Schneider Electric IT  
Mission Critical Services, Inc.  
Proprietary use pursuant to company policy

IT IS A VIOLATION FOR ANY PERSON TO ALTER THIS DOCUMENT THAT BEARS THE SEAL OF A PROFESSIONAL ENGINEER, UNLESS THE PERSON IS ACTING UNDER THE DIRECTION OF A LICENSED PROFESSIONAL ENGINEER IN THE STATE OF WORK. THE ALTERING ENGINEER SHALL AFFIX THEIR SEAL AND THE NOTATION "ALTERED BY" FOLLOWED BY THEIR SIGNATURE AND THE DATE OF SUCH ALTERATION. AND A SPECIFIC DESCRIPTION OF THE ALTERATION TO THE DOCUMENT.

SEAL:

NOT FOR CONSTRUCTION

PROJECT INFORMATION:

25KW DATA CENTER  
REFERENCE DESIGN  
PREFAB CONFIGURATION-6

KEYPLAN:

REV.	DATE	DESCRIPTION
0	05/2/2019	CONCEPTUAL DRAWINGS

DRAWN BY: GR

CHECKED BY: MN

PROJECT NUMBER: DMP-XXXXXX

DRAWING SCALE: NONE

SHEET TITLE:  
**ELECTRICAL  
PREFAB MODULE DETAILS  
CONFIGURATION-6**

DATE: 05/2/2019

DRAWING NUMBER:

E102



1. REFER TO ELECTRICAL GROUNDING DIAGRAM ON SHEET E401 FOR ADDITIONAL INFORMATION.
2. SEE DRAWING E500 FOR DETAILS ON MAIN GROUNDING SYSTEM AND GROUND BUS.
3. ALL GROUNDING CONNECTIONS AND BONDINGS SHALL BE BY ARTICLE 250 OF NFPA 70.
4. ALL GROUND WIRES SHALL BE #2 AWG BARE COPPER, STRANDED.
5. ALL LIGHTNING PROTECTION WIRES SHALL BE #2 AWG BARE COPPER, STRANDED.
6. ALL LIGHTNING PROTECTION COMPONENTS SHALL BE PROPERLY SUPPORTED TO THE STRUCTURE PER NFPA 780.
7. ALL LIGHTNING PROTECTION CONNECTIONS AND BONDINGS SHALL BE PER NFPA 780.

- ① MAIN GROUNDING ELECTRODE SYSTEM. SEE GROUNDING DETAIL ON SHEET E500.
- ② MAIN GROUNDING ELECTRODE CONDUCTOR.
- ③ GENERATOR NEUTRAL AND UTILITY TRANSFORMER NEUTRAL SHALL BE INTERCONNECTED AT THE NEUTRAL BUS OF SERVICE ENTRANCE ATS (SOLID NEUTRAL SYSTEM). MAIN BONDING JUMPER SHALL CONNECT NEUTRAL BUS TO THE GROUND BUS. SEE ELECTRICAL GROUNDING ONE LINE DIAGRAM ON SHEET E401 FOR DETAILS.

**NOT FOR  
CONSTRUCTION**


## 25KW DATA CENTER REFERENCE DESIGN PREFAB CONFIGURATION-6

REV.	DATE	DESCRIPTION
0	05/2/2019	CONCEPTUAL DRAWINGS

DRAWING SCALE: NONE

DATE: 05/2/2019

# E103

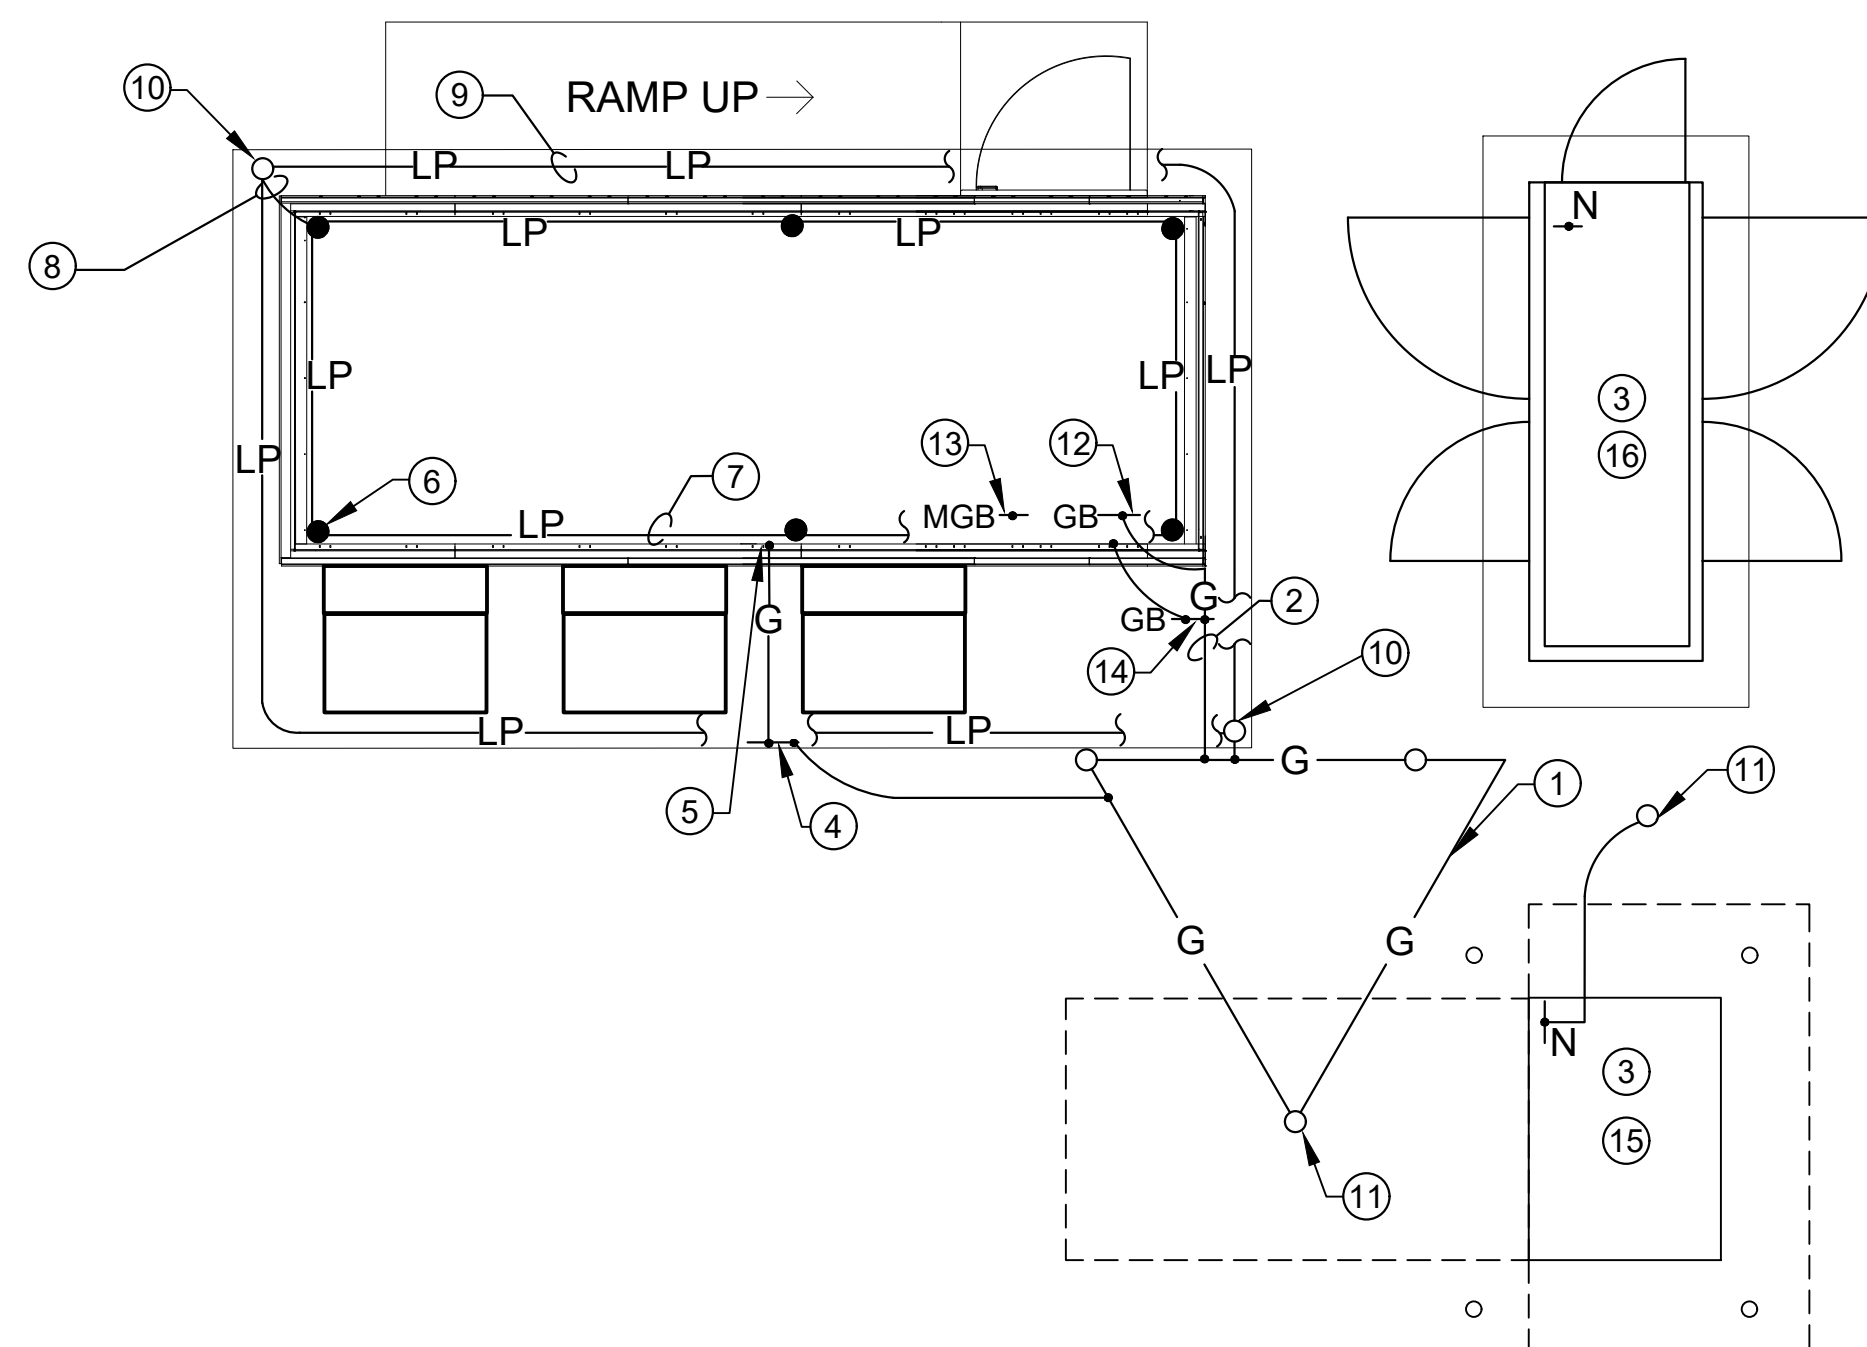

—— G ——	GROUND WIRE.
—— LP ——	LIGHTNING PROTECTION WIRE.
GB	GROUND BAR.
MGB	MAIN GROUNDING BUS.

SCALE: 1/4" = 1'-0"




## LIGHTING FIXTURE SCHEDULE

SCALE: 1/2" = 1'-0"

### PLAN NOTES:

1. REFER TO ONE LINE DIAGRAM ON SHEET E400 FOR ADDITIONAL DETAILS ON THE ELECTRICAL SYSTEM.
2. FOR ELECTRICAL SCHEDULES, SEE DRAWINGS ON SHEETS E600 AND E601.
- ① OCCUPANCY SENSOR(TYP.) MODEL DT-305 OR CX-100-3 OR SIMILAR.

## CONSULTANTS

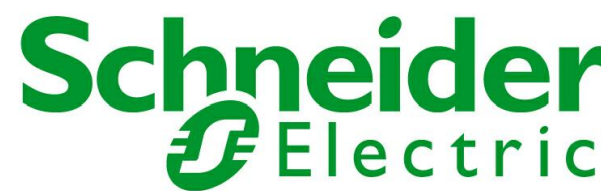

IT MISSION CRITICAL SERVICES, INC.  
12150 MONUMENT DRIVE SUITE 150 FAIRFAX, VA. 22033  
PH: 703-968-0300 FX: 703-654-3680

Schneider Electric IT  
Mission Critical Services, Inc.  
Proprietary use pursuant to company policy

IT IS A VIOLATION FOR ANY PERSON TO ALTER THE DOCUMENT THAT BEARS THE SEAL OF A PROFESSIONAL ENGINEER, UNLESS THE PERSON IS ACTING UNDER THE DIRECTION OF A LICENSED PROFESSIONAL ENGINEER IN THE STATE OF WORK. THE ALTERING ENGINEER SHALL AFFIX THEIR SEAL AND THE NOTATION "ALTERED BY" FOLLOWED BY THEIR SIGNATURE AND THE DATE OF SUCH ALTERATION, AND A SPECIFIC DESCRIPTION OF THE ALTERATION TO THE DOCUMENT.

SEAL

**NOT FOR  
CONSTRUCTION**

## PROJECT INFORMATION

# 25KW DATA CENTER REFERENCE DESIGN PREFAB CONFIGURATION-6

## KEYPLAN

REV.	DATE	DESCRIPTION
0	05/2/2019	CONCEPTUAL DRAWINGS

DRAWN BY: GR

CHECKED BY: MN

PROJECT NUMBER: DMP-XXXXXX

DRAWING SCALE: NONE

SHEET TITLE:  
**ELECTRICAL  
LIGHTING PLAN  
CONFIGURATION-6**


DATE: 05/2/2019

DRAWING NUMBER

# E104



ELECTRICAL ONE LINE DIAGRAM:

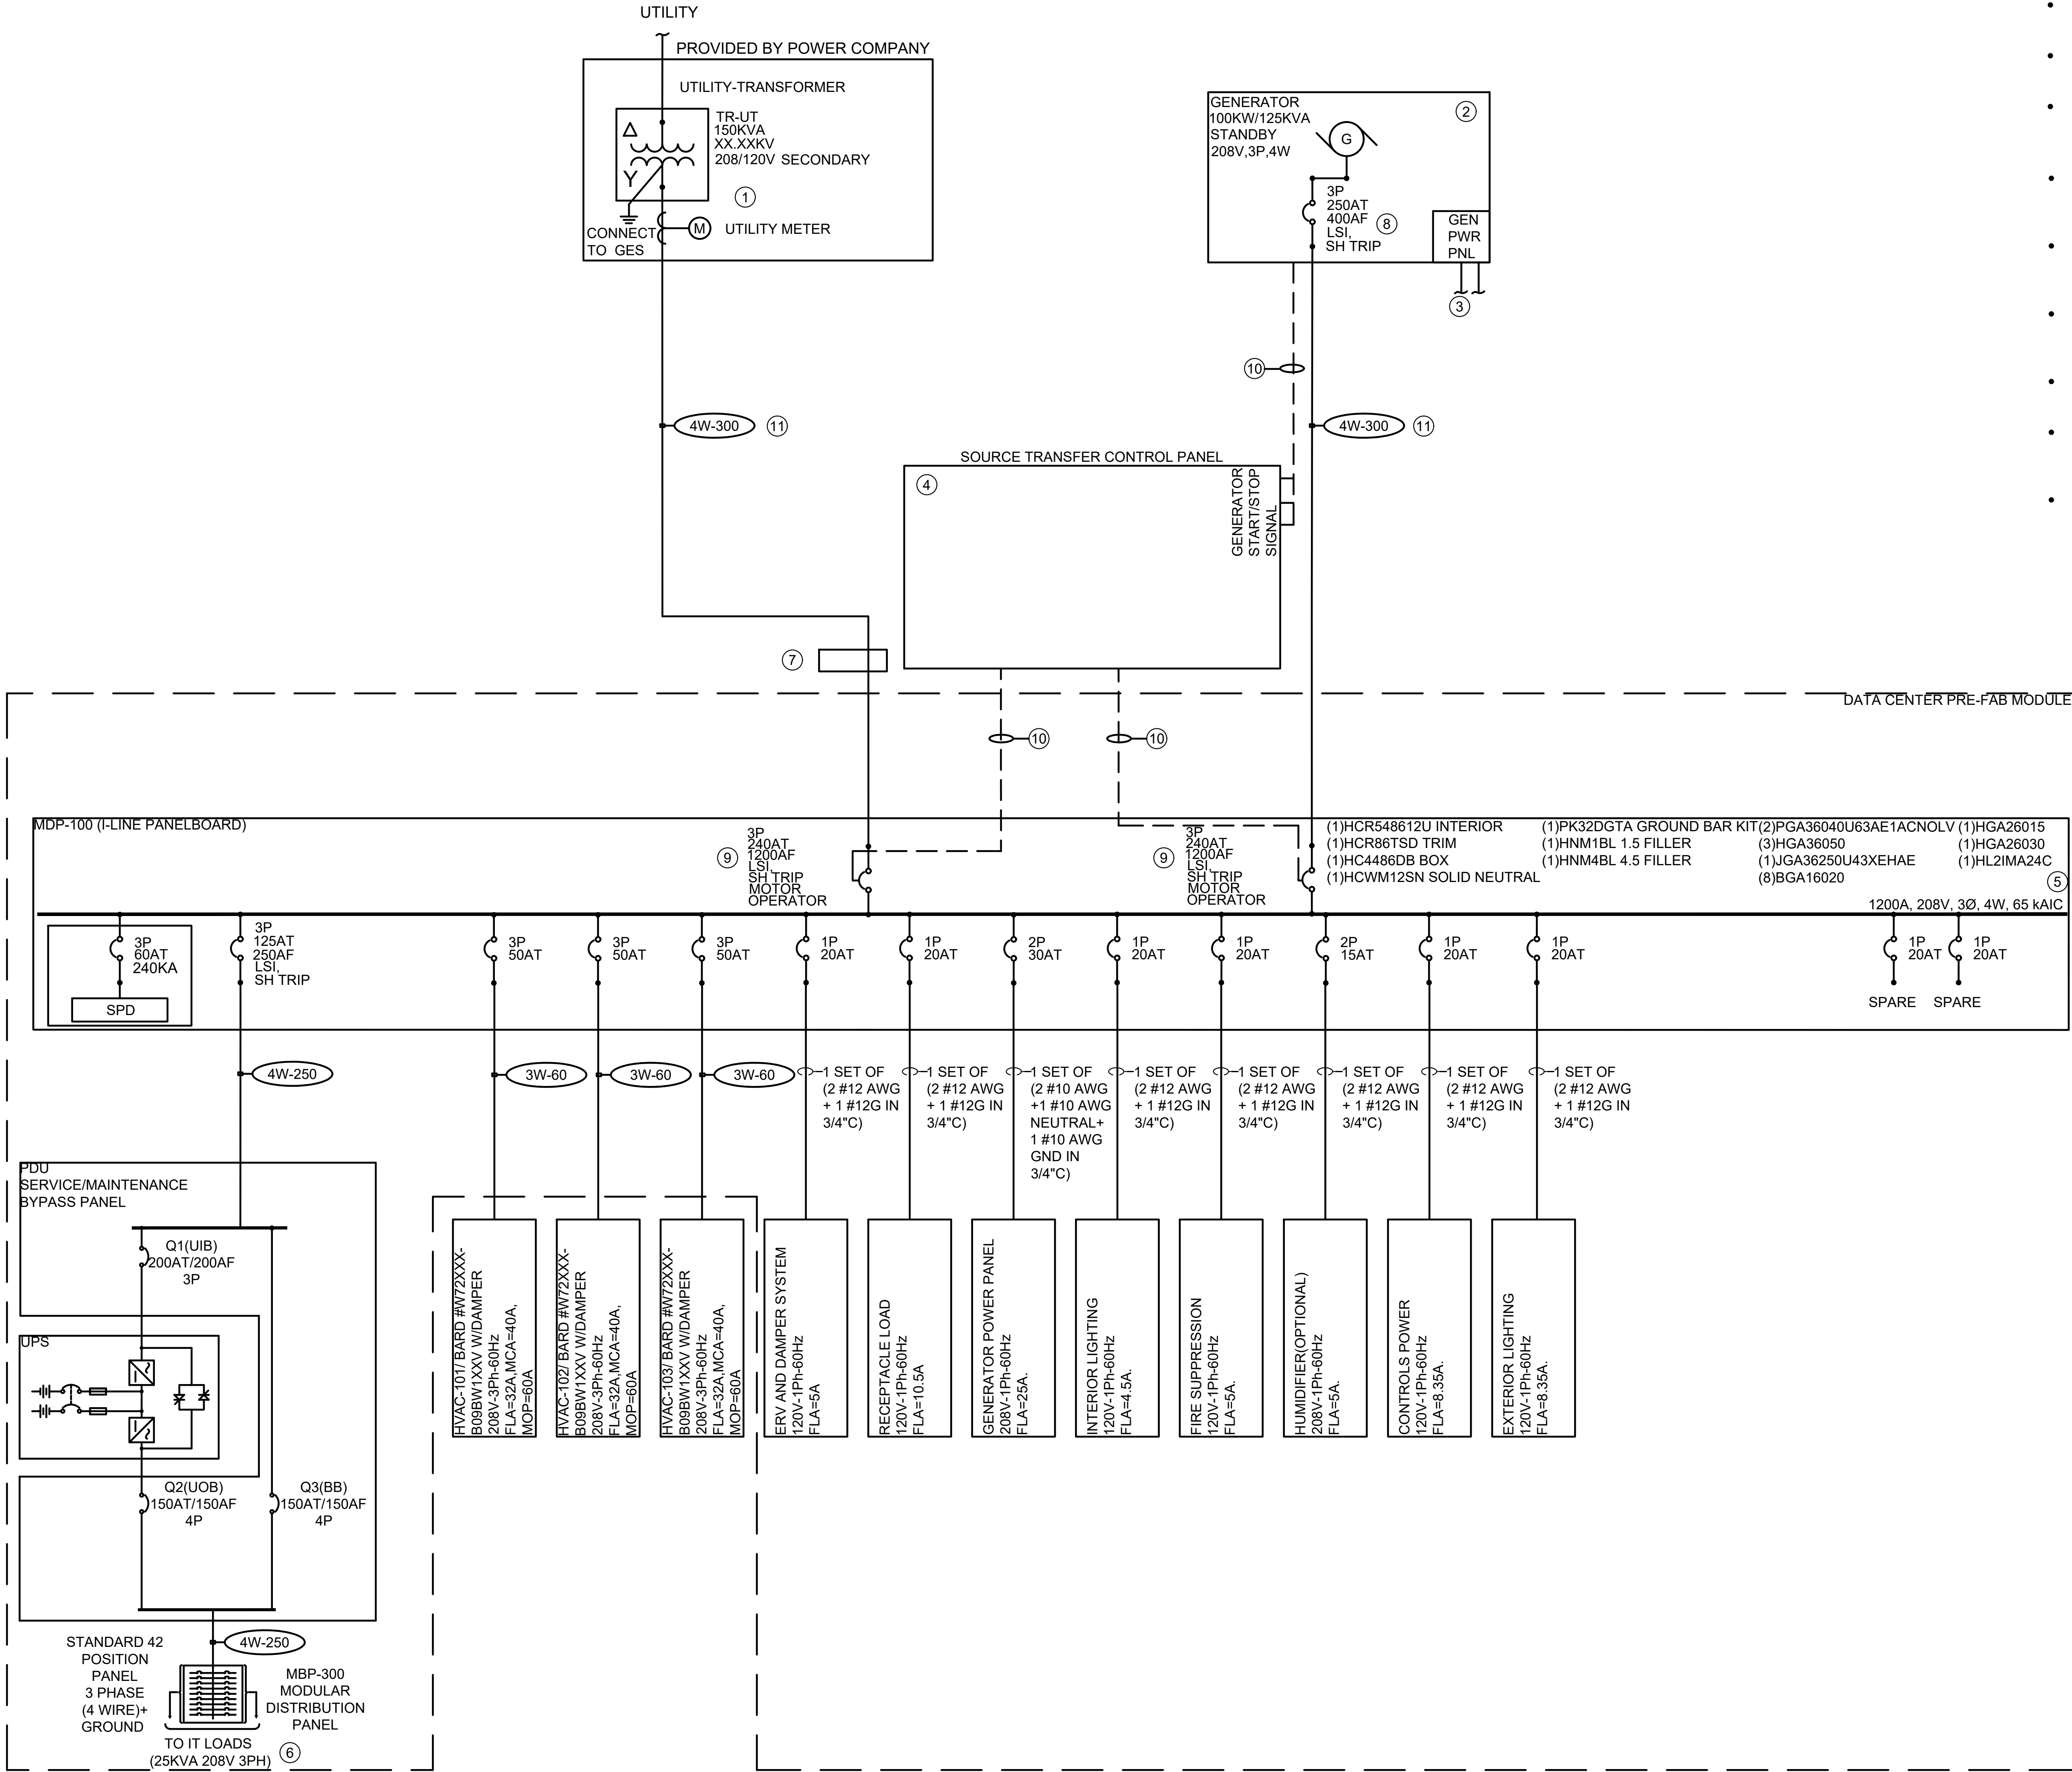

GENERAL NOTES:

- SEE DRAWING E001 FOR ABBREVIATIONS AND SYMBOLS.
- SEE DRAWING E002 AND E003 FOR ELECTRICAL SPECIFICATIONS.
- SEE DRAWING E600 AND E601 FOR ELECTRICAL SCHEDULES.
- SUPPLY OF CONTROL PANELS ALONG WITH THEIR INTEGRATION SERVICES WITH THE DATA CENTER SYSTEM SHALL BE PROVIDED BY SCHNEIDER EPMS DIVISION.
- PROVIDE A SEPARATE CONDUIT FOR CONNECTING THE SPD WITH POWER QUALITY METER(IF PROVIDED) FOR SPD FAILURE MONITORING.
- PROVIDE A 1KVA 480V/120V CPT FOR PROVIDING 120V CONTROL POWER TO CONTROL EQUIPMENT ON 120V AC SUPPLY.
- PROVIDE A 120V AC TO 24V DC POWER SUPPLY FOR 24V DC CONTROL POWER REQUIREMENTS.
- THE CIRCUIT BREAKER INSIDE THE GENERATOR ENCLOSURE SHALL BE EQUIPPED WITH A 24V DC SHUNT TRIP UNIT. SHUNT TRIPS ARE TO BE WIRED TO EPO PANEL.
- PROVIDE AN ETHERNET SWITCH WITH SUFFICIENT PORTS FOR CONNECTING THE POWER QUALITY METER(IF PROVIDED), UPS SYSTEM COMPONENTS AND ALL OTHER COMPONENTS THAT REQUIRE REMOTE MONITORING AND CONFIGURATION.

PLAN NOTES:

- UTILITY METER (TO BE PROVIDED BY POWER COMPANY).
- 100KW/125KVA STANDBY GENERATOR.
- RUN TWO PHASE WIRES, A NEUTRAL WIRE AND A GROUND WIRE IN A 3/4" CONDUIT FROM MDP-100 PANEL TO GENERATOR POWER PANEL. REFER TO PANEL SCHEDULE ON DRAWING E-600 FOR DETAILS.
- AUTOMATIC TRANSFER BETWEEN UTILITY BREAKER AND GENERATOR BREAKER IS ACHIEVED USING THE SOURCE TRANSFER CONTROL PANEL.
- 1200A SERVICE ENTRANCE I-LINE PANELBOARD.
- SEE PANEL MBP-300 SCHEDULE ON DRAWING E-601 FOR DETAILS.
- OPTIONAL 400A SERVICE ENTRANCE RATED DISCONNECT SWITCH (PROVIDED BY OTHERS).
- CIRCUIT BREAKER WILL BE EQUIPPED WITH A MICROLOGIC 5.3E LSI ELECTRONIC TRIP UNIT AND A SHUNT TRIP UNIT. SHUNT TRIPS ARE TO BE WIRED TO EPO PANEL.
- UTILITY AND GENERATOR MAIN CIRCUIT BREAKERS SHALL BE EQUIPPED WITH MICROLOGIC 5.0 POWER TRIP UNIT AND SHUNT TRIP UNIT. SHUNT TRIPS ARE TO BE WIRED TO EPO PANEL.
- CONTROL WIRING.
- CONDUCTORS FROM UTILITY AND GENERATOR SHOWN AS PER WIRE SCHEDULE SHALL BE RUN IN 3" PVC SCH-80 CONDUITS.

CONSULTANTS:



IT MISSION CRITICAL SERVICES, INC.  
12150 MONUMENT DRIVE SUITE 150 FAIRFAX, VA. 22033  
PH: 703-968-0300 FX: 703-654-3680

Schneider Electric IT  
Mission Critical Services, Inc.  
Proprietary use pursuant to company policy

IT IS A VIOLATION FOR ANY PERSON TO ALTER THIS DOCUMENT THAT BEARS THE SEAL OF A PROFESSIONAL ENGINEER, UNLESS THE PERSON IS ACTING UNDER THE DIRECTION OF A LICENSED PROFESSIONAL ENGINEER IN THE STATE OF WORK. THE ALTERING ENGINEER SHALL AFFIX THEIR SEAL AND THE NOTATION "ALTERED BY" FOLLOWED BY THEIR SIGNATURE AND THE DATE OF SUCH ALTERATION, AND A SPECIFIC DESCRIPTION OF THE ALTERATION TO THE DOCUMENT.

SEAL:

NOT FOR  
CONSTRUCTION

PROJECT INFORMATION:

25KW DATA CENTER  
REFERENCE DESIGN  
PREFAB CONFIGURATION-6

KEYPLAN:

REV.	DATE	DESCRIPTION
0	05/2/2019	CONCEPTUAL DRAWINGS

DRAWN BY: GR

CHECKED BY: MN

PROJECT NUMBER: DMP-XXXXXX

DRAWING SCALE: NONE


SHEET TITLE:  
**ELECTRICAL  
ONE LINE DIAGRAM  
CONFIGURATION-6**

DATE: 05/2/2019

DRAWING NUMBER:

**E400**

ELECTRICAL GROUNDING DIAGRAM:

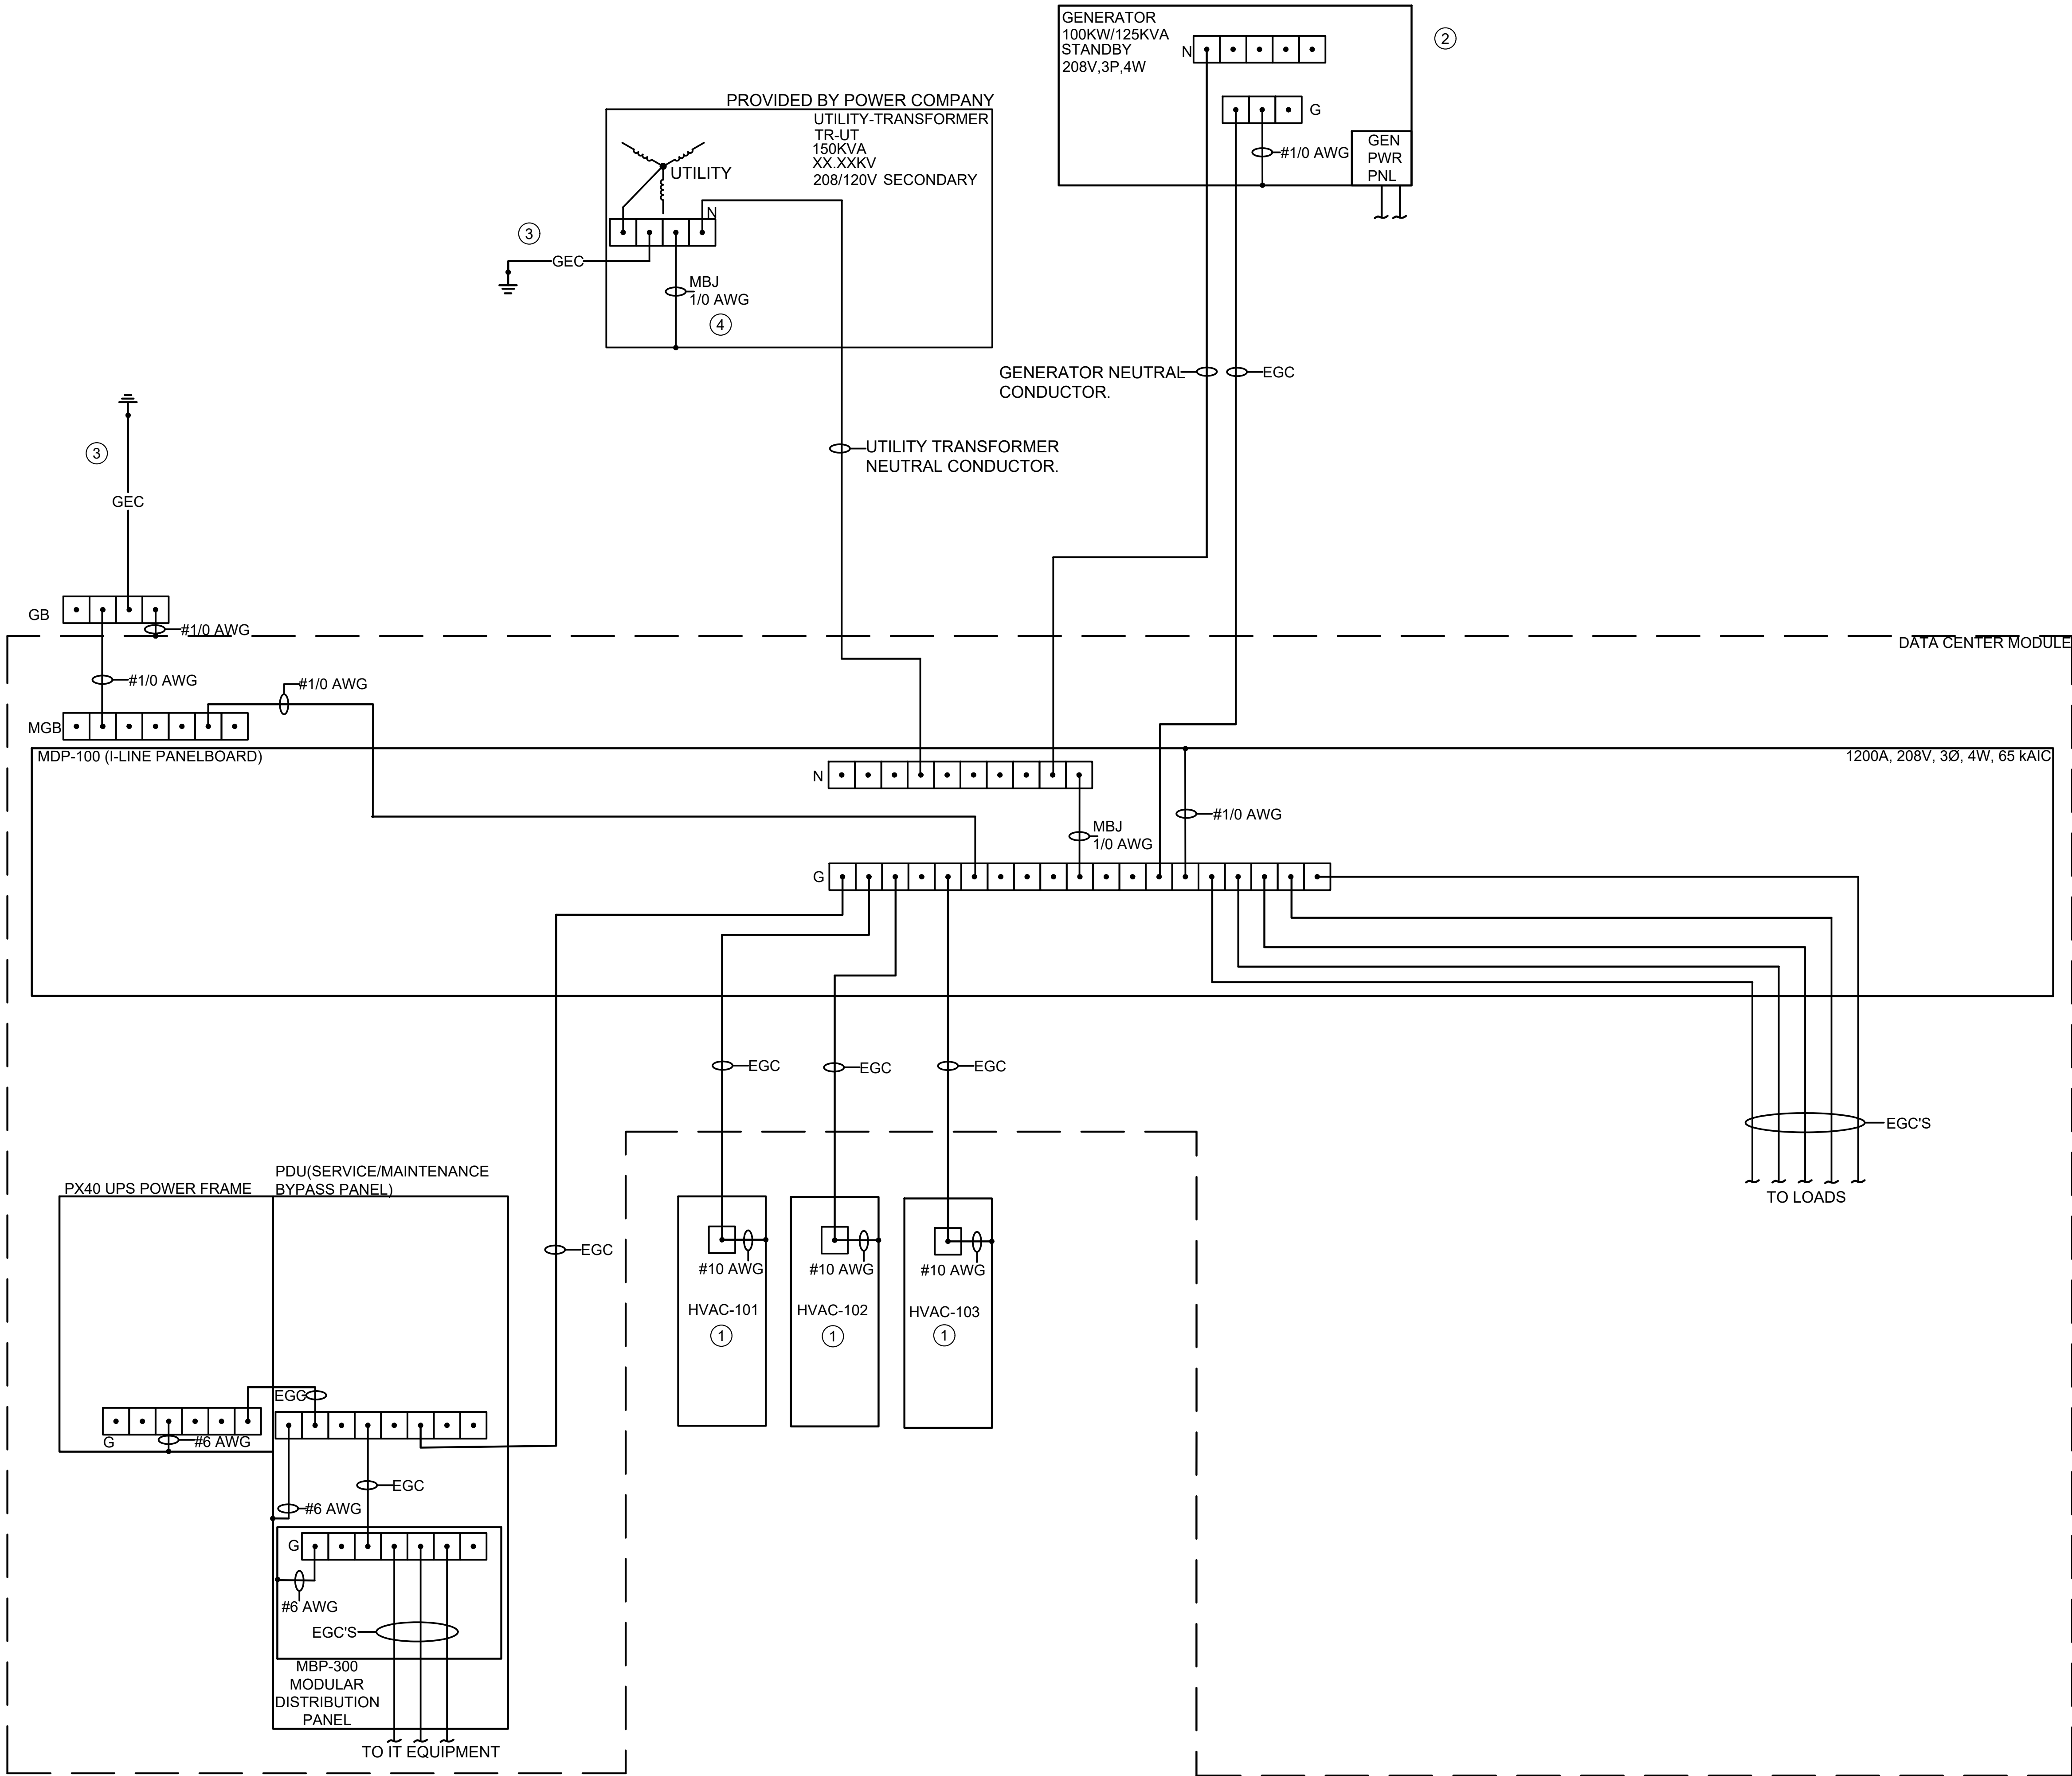

GENERAL NOTES:

- SEE DRAWING E001 FOR ABBREVIATIONS AND SYMBOLS.
- SEE DRAWING E002 AND E003 FOR ELECTRICAL SPECIFICATIONS.
- SEE DRAWING E400 FOR ELECTRICAL ONE LINE DIAGRAM.
- SEE DRAWING E500 FOR ELECTRICAL DETAILS.
- SEE DRAWING E600 AND E601 FOR ELECTRICAL SCHEDULES.
- ALL GROUNDING CONNECTIONS AND BONDINGS SHALL BE BY ARTICLE 250 OF NFPA 70. EGC SIZING IS NORMALLY RUN WITH CIRCUIT CONDUCTORS. SEE DRAWING E400 ONE LINE DIAGRAM AND E600 ELECTRICAL SCHEDULES FOR EGC SIZING DETAILS.
- REFER TO ELECTRICAL GROUNDING AND LIGHTNING PROTECTION DRAWING ON SHEET E103 FOR ADDITIONAL DETAILS.


PLAN NOTES:

- WALL MOUNT COOLING UNIT(TYP.).
- GENERATOR GROUNDING SYSTEM IS BASED ON A NON-SEPERATELY DERIVED SYSTEM.
- SEE DRAWING E103 GROUNDING AND LIGHTNING PROTECTION FOR DETAILS.
- BONDING JUMPER(PROVIDED BY OTHERS) TO BE INSTALLED AS REQUIRED. ALL GROUNDING CONNECTIONS AND BONDINGS SHALL BE AS PER ARTICLE 250 AND 450 OF NFPA 70 AND SHALL MEET ALL STATE AND LOCAL CODE REQUIREMENTS.

LEGEND:

- EGC EQUIPMENT GROUNDING CONDUCTOR NORMALLY RUN IN RACEWAYS WITH CIRCUIT CONDUCTORS. SIZE PER NEC.
- GEC GROUNDING ELECTRODE CONDUCTOR.
- BJ BONDING JUMPER. SIZE PER NEC.
- MBJ MAIN BONDING JUMPER.
- SBJ SYSTEM BONDING JUMPER.
- MGB MAIN GROUNDING BAR.
- N NEUTRAL BAR.
- G GROUND BAR.

CONSULTANTS:

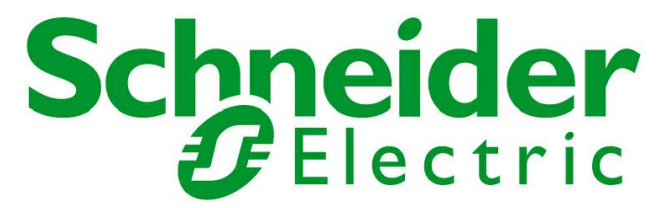

IT MISSION CRITICAL SERVICES, INC.  
12150 MONUMENT DRIVE SUITE 150 FAIRFAX, VA. 22033  
PH: 703-968-0300 FX: 703-654-3680

Schneider Electric IT  
Mission Critical Services, Inc.  
Proprietary use pursuant to company policy

IT IS A VIOLATION FOR ANY PERSON TO ALTER THIS DOCUMENT THAT BEARS THE SEAL OF A PROFESSIONAL ENGINEER, UNLESS THE PERSON IS ACTING UNDER THE DIRECTION OF A LICENSED PROFESSIONAL ENGINEER IN THE STATE OF WORK. THE ALTERING ENGINEER SHALL AFFIX THEIR SEAL AND THE NOTATION "ALTERED BY" FOLLOWED BY THEIR SIGNATURE AND THE DATE OF SUCH ALTERATION, AND A SPECIFIC DESCRIPTION OF THE ALTERATION TO THE DOCUMENT.

SEAL:

NOT FOR  
CONSTRUCTION

PROJECT INFORMATION:

25KW DATA CENTER  
REFERENCE DESIGN  
PREFAB CONFIGURATION-6

KEYPLAN:

REV.	DATE	DESCRIPTION
0	05/2/2019	CONCEPTUAL DRAWINGS

DRAWN BY: GR

CHECKED BY: MN

PROJECT NUMBER: DMP-XXXXXX

DRAWING SCALE: NONE

SHEET TITLE:  
**ELECTRICAL  
GROUNDING DIAGRAM  
CONFIGURATION-6**

DATE: 05/2/2019

DRAWING NUMBER:

**E401**





- BELOW RAISED FLOOR AGB +12" A.F.F.
- PROVIDE INSULATORS 24" ON CENTER ACROSS LENGTH OF GROUND BAR.
- ALL CONNECTIONS SHALL BE MADE WITH STAINLESS STEEL TAMPER PROOF HARDWARE OR EXOTHERMIC WELD.



ALL SAFETY SWITCHES, 60A AND LARGER; ALL STARTERS AND CONTROLLERS, 3 H.P. AND LARGER; ALL SURFACE MOUNTED PANELS AND ALL EQUIPMENT MOUNTED ON OUTSIDE WALLS, SHALL BE MOUNTED IN THIS MANNER.

# E500




DISTRIBUTION PANELBOARD 'MDP-100' SCHEDULE																							
VOLTAGE 120 / 208		PH 3	WIRE 4	MCB (A)		MLO (A) 1200A	AIC 65000	MOUNTING SURFACE		LOCATION MODULE		PANEL CATALOG NUMBER :											
CKT #	ITEM SERVED			CIRCUIT TRIP	BRKR P	WIRE SIZE	COND. SIZE	LOAD (KVA)	PHASE			LOAD (KVA)	COND SIZE	WIRE SIZE	CIRCUIT P	BRKR TRIP	ITEM SERVED	CKT #					
1	UPS			125	3	250	2-1/2"	26.00	A	B	C	0.00	3"		3	240	UTILITY INPUT(1200AF BREAKER)	2					
8.67											4												
									8.67	8.67	6												
5	HVAC-102			50	3	6	3/4"	14.41	4.80			0.00	3"		3	240	GENERATOR(1200AF BREAKER)	8					
									4.80		10												
										4.80	12												
9	HVAC-103(REDUNDANT)			50	3	6	3/4"	0.00	4.80			14.41	3/4"	6	3	50	HVAC-101	14					
									4.80		16												
										4.80	18												
13	ERV & DAMPER SYSTEM			20	1	12	3/4"	0.60	1.20			0.60	3/4"	12	1	20	FIRE SUPPRESSION	20					
21										2.26	1.00							3/4"	12	1	20	EXTERIOR LIGHTING	22
23											1.00							3/4"	12	1	20	CONTROLS POWER	24
25	GENERATOR POWER PANEL			30	2	10	3/4"	5.00	2.50		3.50						SPACE	26					
27	INTERIOR LIGHTING			20	1	12	3/4"	0.50		1.05		1.10	3/4"	12	2	15	HUMIDIFIER(OPTIONAL)	28					
29	SPARE			20	1		0.00			0.55								30					
31	SPARE			20	1		0.00	0.00										32					
33	SPACE																SPACE	34					
35	SPACE																SPACE	36					
37																				SPACE	38		
39																				SPACE	40		
41	SPD BREAKER			60	3	6	3/4"	0.00	0.00								SPACE	42					
43										0.00											44		
45											0.00											46	
									21.97	21.58	22.32												
LOAD TYPE		LOAD (KVA)		SUBLOADS (KVA)										TOTAL (KVA)	DEM FAC	DEM LD	NOTES						
				PNL	PNL	PNL	PNL	PNL	PNL	PNL	PNL	PNL	PNL	PNL									
UPS		26.00		-	-	-	-	-	-	-	-	-	-	-	-	-	26.00	1.00	26.00				
HVAC-101		14.41		-	-	-	-	-	-	-	-	-	-	-	-	-	14.41	1.00	14.41				
HVAC-102		14.41		-	-	-	-	-	-	-	-	-	-	-	-	-	14.41	1.00	14.41				
HVAC-103(REDUNDANT)		0.00		-	-	-	-	-	-	-	-	-	-	-	-	-	0.00	1.00	0.00				
ERV AND DAMPER SYSTEM		0.60		-	-	-	-	-	-	-	-	-	-	-	-	-	0.60	1.00	0.60				
FIRE SUPPRESSION		0.60		-	-	-	-	-	-	-	-	-	-	-	-	-	0.60	1.00	0.60				
RECEPTACLES		1.26		-	-	-	-	-	-	-	-	-	-	-	-	-	1.26	1.00	1.26				
HUMIDIFIER(OPTIONAL)		1.10		-	-	-	-	-	-	-	-	-	-	-	-	-	1.10	1.00	1.10				
GENERATOR POWER PANEL		5.00		-	-	-	-	-	-	-	-	-	-	-	-	-	5.00	1.00	5.00				
CONTROLS POWER		1.00		-	-	-	-	-	-	-	-	-	-	-	-	-	1.00	1.00	1.00				
INTERIOR LIGHTING		0.50		-	-	-	-	-	-	-	-	-	-	-	-	-	0.50	1.00	0.50				
EXTERIOR LIGHTING		1.00		-	-	-	-	-	-	-	-	-	-	-	-	-	1.00	1.00	1.00				
SPARE		0.00		-	-	-	-	-	-	-	-	-	-	-	-	-	0.00		0.00				
SPARE		0.00		-	-	-	-	-	-	-	-	-	-	-	-	-	0.00		0.00				
														65.88		65.88	TOTAL KVA						
25 % OF Largest Motor Load		3.60		-	-	-	-	-	-	-	-	-	-	-	-	-			3.60	1.00	3.60		
25 % OF UPS Continuous Load plus Battery Charging		14.80		-	-	-	-	-	-	-	-	-	-	-	-	-			14.80	1.00	14.80		
25 % OF Auxiliary Continuous Loads		2.03		-	-	-	-	-	-	-	-	-	-	-	-	-			2.03	1.00	2.03		
															86.31	SUM TOTAL KVA(125% CONTINUOUS LOAD+ 100% NON CONTINUOUS LOAD+100% MOTOR LOADS+ 25% LARGEST MOTOR LOAD)							
NOTES: DEMAND FACTOR IN ACCORANCE WITH NEC.															239.57	TOTAL AMPS							

3-WIRE FEEDER SIZING SCHEDULE				
SYMBOL	# OF SETS	CONDUCTORS (COPPER)	GND.	CONDUIT
3W-15	1	3 #12	#12	3/4"
3W-20	1	3 #12	#12	3/4"
3W-25	1	3 #10	#12	3/4"
3W-30	1	3 #10	#10	3/4"
3W-35	1	3 #8	#10	3/4"
3W-40	1	3 #8	#10	3/4"
3W-45	1	3 #8	#10	3/4"
3W-50	1	3 #8	#10	3/4"
3W-60	1	3 #6	#10	3/4"
3W-70	1	3 #4	#8	1"
3W-80	1	3 #4	#8	1"
3W-90	1	3 #3	#8	1-1/4"
3W-100	1	3 #3	#8	1-1/4"
3W-110	1	3 #2	#6	1-1/4"
3W-125	1	3 #1	#6	1-1/4"
3W-150	1	3 1/0	#6	1-1/2"
3W-175	1	3 2/0	#6	2"
3W-200	1	3 3/0	#6	2"
3W-225	1	3 4/0	#4	2"
3W-250	1	3 250 MCM	#4	2-1/2"
3W-300	1	3 350 MCM	#4	2-1/2"
3W-350	1	3 500 MCM	#3	3"
3W-400	2	3 3/0	#3	2"
3W-450	2	3 4/0	#2	2"
3W-500	2	3 250 MCM	#2	2-1/2"
3W-600	2	3 350 MCM	#1	2-1/2"
3W-700	2	3 500 MCM	1/0	3"
3W-800	3	3 300 MCM	1/0	2-1/2"
3W-1000	3	3 400 MCM	2/0	2-1/2"
3W-1200	4	3 350 MCM	3/0	2-1/2"
3W-1600	5	3 400 MCM	4/0	2-1/2"
3W-2000	6	3 400 MCM	250 MCM	2-1/2"
3W-2500	7	3 500 MCM	350 MCM	3"
3W-3000	8	3 500 MCM	400 MCM	3"
3W-4000	11	3 500 MCM	500 MCM	3"
3W-5000	11	3 700 MCM	700 MCM	3-1/2"
3W-6000	13	3 750 MCM	800 MCM	3-1/2"
+ WHERE THE FEEDER SYMBOL IS SHOWN WITH A SUBSCRIPT 'IG', THE FEEDER SHALL BE PROVIDED WITH A SEPERATE ISOLATED GROUND CONDUCTOR SIZED TO MATCH THE EQUIPMENT GROUND.				
-CONDUCTOR SIZING BASED ON NEC TABLE 310.15(B)(16) FOR COPPER CONDUCTORS RATED AT 75°C.				
-EQUIPMENT GROUNDING CONDUCTOR SIZING BASED ON NEC TABLE 250.122 FOR COPPER CONDUCTORS.				
-CONDUIT SIZING BASED ON NEC TABLE C.1 FOR TYPE THHN, THWN, THWN-2 CONDUCTORS IN ELECTRICAL METALLIC TUBING.				

4-WIRE FEEDER SIZING SCHEDULE				
SYMBOL	# OF SETS	CONDUCTORS (COPPER)	GND.	CONDUIT
4W-15	1	4 #12	#12	3/4"
4W-20	1	4 #12	#12	3/4"
4W-25	1	4 #10	#12	3/4"
4W-30	1	4 #10	#10	3/4"
4W-35	1	4 #8	#10	3/4"
4W-40	1	4 #8	#10	3/4"
4W-45	1	4 #8	#10	3/4"
4W-50	1	4 #8	#10	3/4"
4W-60	1	4 #6	#10	1"
4W-70	1	4 #4	#8	1-1/4"
4W-80	1	4 #4	#8	1-1/4"
4W-90	1	4 #3	#8	1-1/4"
4W-100	1	4 #3	#8	1-1/4"
4W-110	1	4 #2	#6	1-1/4"
4W-125	1	4 #1	#6	1-1/2"
4W-150	1	4 1/0	#6	2"
4W-175	1	4 2/0	#6	2"
4W-200	1	4 3/0	#6	2"
4W-225	1	4 4/0	#4	2-1/2"
4W-250	1	4 250 MCM	#4	2-1/2"
4W-300	1	4 350 MCM	#4	3"
4W-350	1	4 500 MCM	#3	3"
4W-400	2	4 3/0	#3	2"
4W-450	2	4 4/0	#2	2-1/2"
4W-500	2	4 250 MCM	#2	2-1/2"
4W-600	2	4 350 MCM	#1	3"
4W-700	2	4 500 MCM	1/0	3"
4W-800	3	4 300 MCM	1/0	2-1/2"
4W-1000	3	4 400 MCM	2/0	3"
4W-1200	4	4 350 MCM	3/0	3"
4W-1600	5	4 400 MCM	4/0	3"
4W-2000	6	4 400 MCM	250 MCM	3"
4W-2500	7	4 500 MCM	350 MCM	3"
4W-3000	8	4 500 MCM	400 MCM	3"
4W-4000	11	4 500 MCM	500 MCM	3"
4W-5000	11	4 700 MCM	700 MCM	4"
4W-6000	13	4 750 MCM	800 MCM	4"
+ WHERE THE FEEDER SYMBOL IS SHOWN WITH A SUBSCRIPT 'IG', THE FEEDER SHALL BE PROVIDED WITH A SEPERATE ISOLATED GROUND CONDUCTOR SIZED TO MATCH THE EQUIPMENT GROUND.				
-CONDUCTOR SIZING BASED ON NEC TABLE 310.15(B)(16) FOR COPPER CONDUCTORS RATED AT 75°C.				
-EQUIPMENT GROUNDING CONDUCTOR SIZING BASED ON NEC TABLE 250.122 FOR COPPER CONDUCTORS.				
-CONDUIT SIZING BASED ON NEC TABLE C.1 FOR TYPE THHN, THWN, THWN-2 CONDUCTORS IN ELECTRICAL METALLIC TUBING.				

## CONSULTANTS

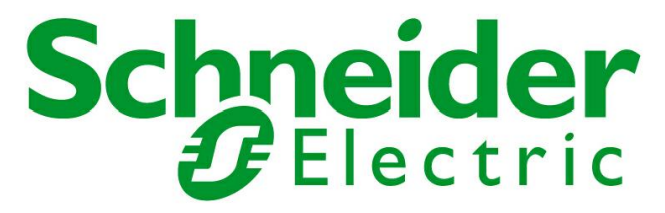

IT MISSION CRITICAL SERVICES, INC.

12150 MONUMENT DRIVE SUITE 150 FAIRFAX, VA. 22033  
PH: 703-968-0300 FX: 703-654-3680

Schneider Electric IT  
Mission Critical Services, Inc.  
Proprietary use pursuant to company policy

IT IS A VIOLATION FOR ANY PERSON TO ALTER THIS DOCUMENT THAT BEARS THE SEAL OF A PROFESSIONAL ENGINEER, UNLESS THE PERSON IS ACTING UNDER THE DIRECTION OF A LICENSED PROFESSIONAL ENGINEER IN THE STATE OF WORK. THE ALTERING ENGINEER SHALL AFFIX THEIR SEAL AND THE NOTATION "ALTERED BY" FOLLOWED BY THEIR SIGNATURE AND THE DATE OF SUCH ALTERATION, AND A SPECIFIC DESCRIPTION OF THE ALTERATION TO THE DOCUMENT.

SEAL:

**NOT FOR  
CONSTRUCTION**

## PROJECT INFORMATION

# 25KW DATA CENTER REFERENCE DESIGN PREFAB CONFIGURATION-6

KEYPLAN:

REV.	DATE	DESCRIPTION
0	05/2/2019	CONCEPTUAL DRAWINGS
DRAWN BY:	GR	
CHECKED BY:	MN	
PROJECT NUMBER:	DMP-XXXXXX	
DRAWING SCALE:	NONE	
SHEET TITLE:		
<b>ELECTRICAL SCHEDULES CONFIGURATION-6</b>		
DATE:		05/2/2019

DRAWING NUMBER:

05/2/2019

DRAWING NUMBER:

# E600




SYSTEM LOAD CALCULATION		
ITEM	LOAD	UNIT
CRITICAL LOAD	26.000	KVA
HVAC 101	14.410	KVA
HVAC 102	14.410	KVA
HVAC 103(REDUNDANT)	0.000	KVA
ERV & DAMPER SYSTEM	0.600	KVA
FIRE SUPPRESSION	0.600	KVA
RECEPTACLES	1.260	KVA
HUMIDIFIER(OPTIONAL)	0.600	KVA
GENERATOR POWER PANEL	5.400	KVA
CONTROLS POWER	1.000	KVA
INTERIOR LIGHTING	0.5	KVA
LOBBY VENTILATION	0.120	KVA
EXTERIOR LIGHTING	1.000	KVA
TOTAL KVA	65.900	KVA

DISTRIBUTION PANELBOARD 'MBP-300' SCHEDULE																			
VOLTAGE	PH	WIRE	MCB (A)		MLO (A)		AIC	MOUNTING	LOCATION	PANEL CATALOG NUMBER									
120/ 208	3	4	150				65,000	SURFACE	MODULE										
CKT #	ITEM SERVED				CKT. TRIP	BRK P	WIRE SIZE	COND. SIZE	LOAD (KVA)	PHASE			LOAD (KVA)	COND. SIZE	WIRE SIZE	CKT. P	BRK TRIP	ITEM SERVED	CKT #
1	RACK#1				30	3	10		5.00	A	B	C	5.00		10	3	30	RACK#4	2
3										3.33	3.33								4
5												3.33							6
7										3.33									8
9	RACK#2				30	3	10		5.00		3.33		5.00		10	3	30	RACK#5	10
11												3.33							12
13										1.67									14
15											1.67								16
17	RACK#3				30	3	10		5.00			1.67						SPACE	18
19										0.00									20
21											0.00								22
23												0.00							24
25	SPACE									0.00								SPACE	26
27											0.00								28
29												0.00							30
31																			32
33	CP-100				15	1	12		1.00	1.00			0.00			1	15	SPARE	34
35	SPARE				15	1			0.00										36
37																			38
39																			40
41																			42
										9.33	8.33	8.33							
NOTES:																			
DEMAND FACTOR IN ACCORANCE WITH NEC.																26.00		TOTAL KVA	
RACKS SHALL HAVE (N) DISTRIBUTION. OPTIONAL UPGRADE TO (2N) DISTRIBUTION SHALL BE AVAILABLE ON REQUEST.																72.17		TOTAL AMPS	

PLAN NOTES:

- 1 POWER SHALL BE DISTRIBUTED TO IT RACKS AND CONTROL PANEL LOAD THROUGH CABLE TRAYS.

CONSULTANTS:

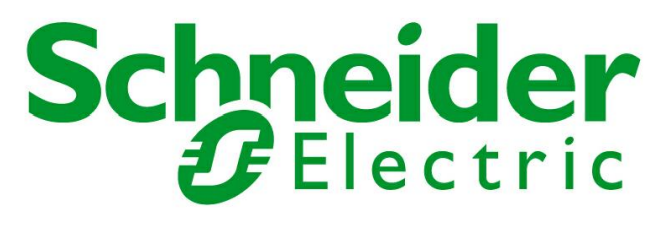

IT MISSION CRITICAL SERVICES, INC.

12150 MONUMENT DRIVE SUITE 150 FAIRFAX, VA. 22033  
PH: 703-968-0300 FX: 703-654-3680

Schneider Electric IT  
Mission Critical Services, Inc.  
Proprietary use pursuant to company policy

IT IS A VIOLATION FOR ANY PERSON TO ALTER THIS DOCUMENT THAT BEARS THE SEAL OF A PROFESSIONAL ENGINEER, UNLESS THE PERSON IS ACTING UNDER THE DIRECTION OF A LICENSED PROFESSIONAL ENGINEER IN THE STATE OF WORK. THE ALTERING ENGINEER SHALL AFFIX THEIR SEAL AND THE NOTATION "ALTERED BY" FOLLOWED BY THEIR SIGNATURE AND THE DATE OF SUCH ALTERATION, AND A SPECIFIC DESCRIPTION OF THE ALTERATION TO THE DOCUMENT.

SEAL:

NOT FOR  
CONSTRUCTION

PROJECT INFORMATION:

25KW DATA CENTER  
REFERENCE DESIGN  
PREFAB CONFIGURATION-6

KEYPLAN:

REV.	DATE	DESCRIPTION
0	05/2/2019	CONCEPTUAL DRAWINGS

DRAWN BY: GR

CHECKED BY: MN

PROJECT NUMBER: DMP-XXXXXX

DRAWING SCALE: NONE

SHEET TITLE:  
ELECTRICAL  
SCHEDULES  
CONFIGURATION-6

DATE: 05/2/2019

DRAWING NUMBER:

E601