






NOTES:

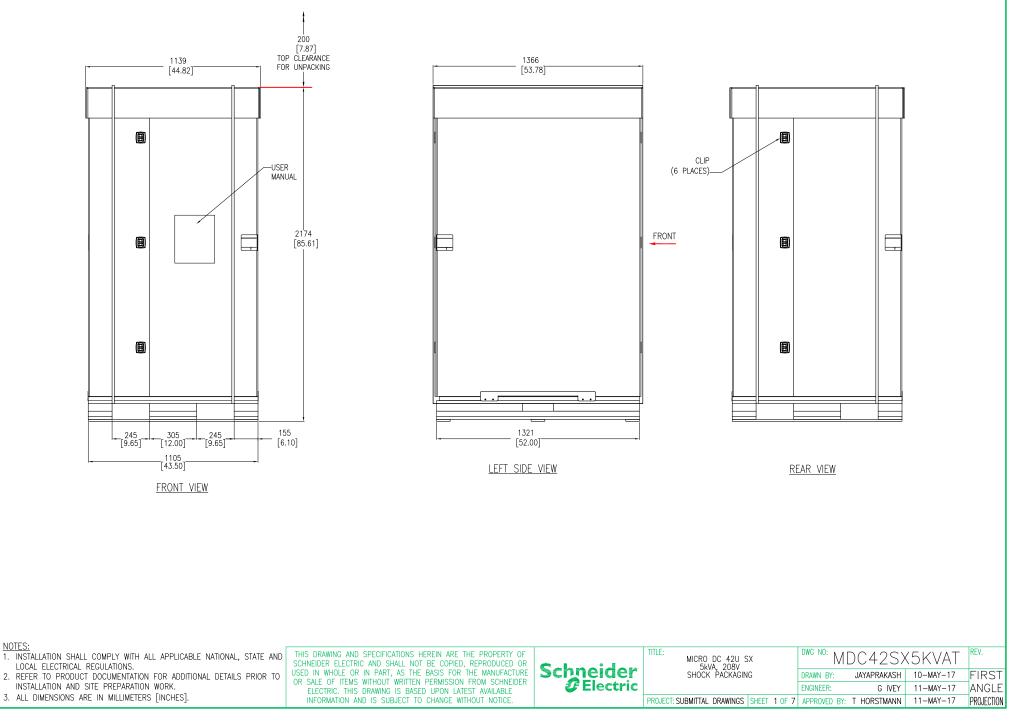


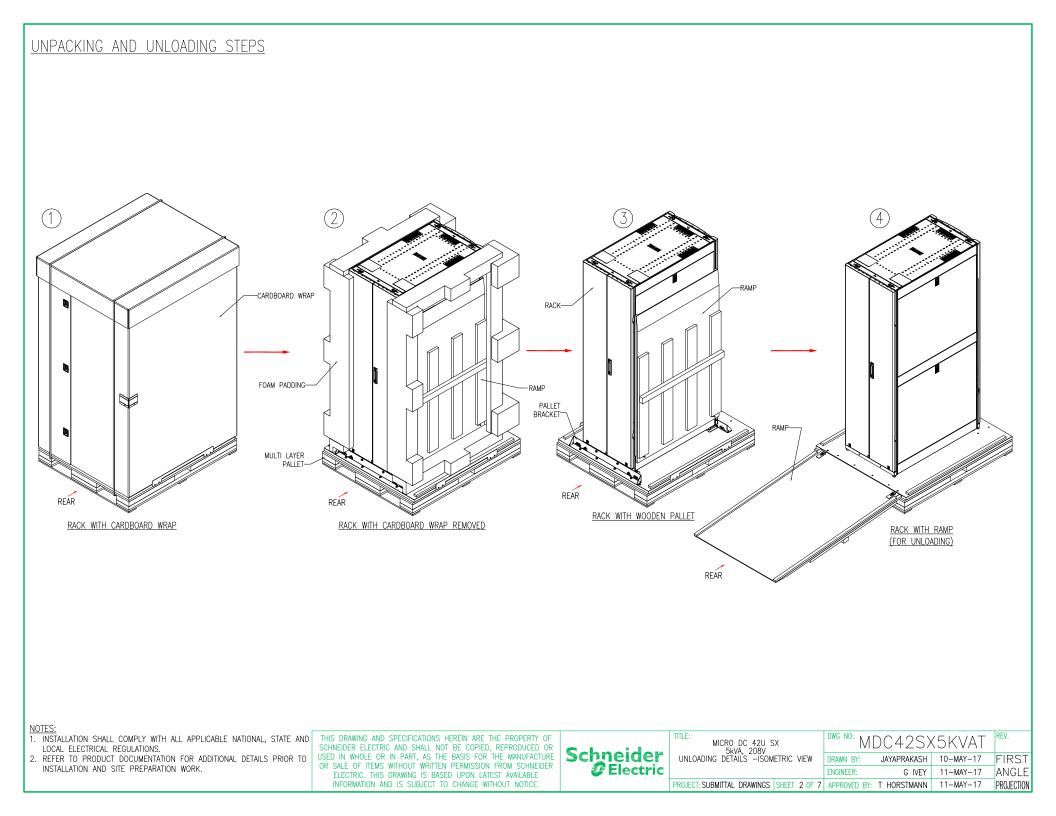

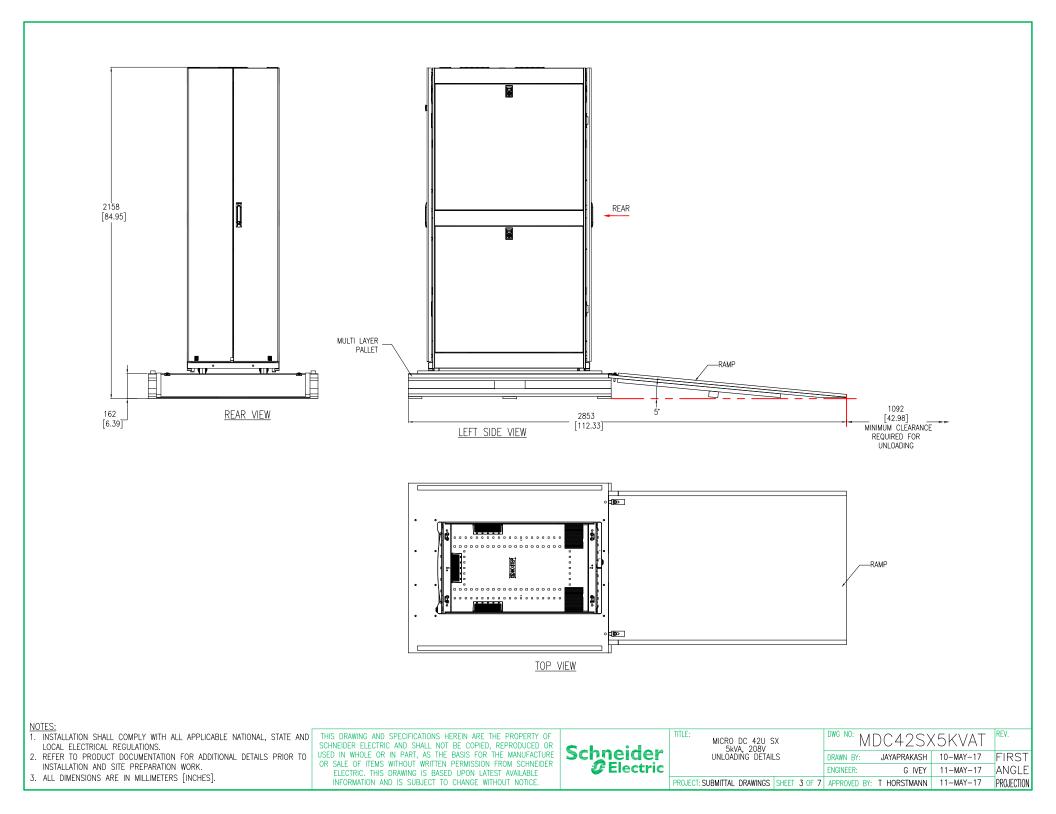

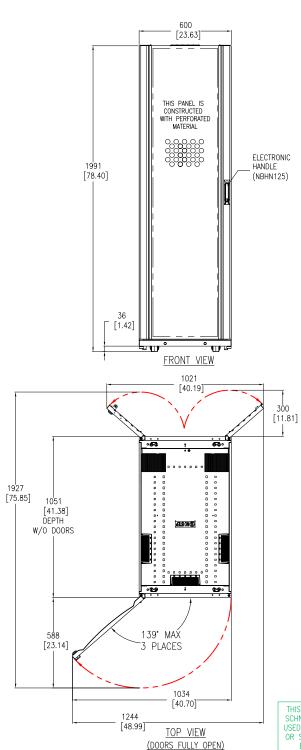

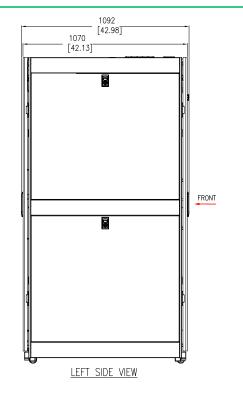

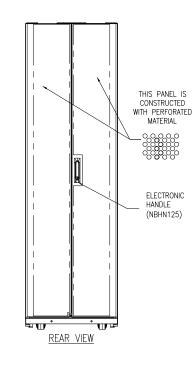

Sl.No	Part Number	Description	Quantity	Configuration
1	NBHN125	NetBotz 125 kHz Handle Kit	1	Installed
2	NBRK0250	NetBotz Rack Monitor 250	1	Installed
3	NBES0303	NetBotz Door Switch Sensors (2) for an APC Rack - 12 ft.	1	Installed
4	AP8706S-NA	Power Cord Kit (6 ea), Locking, C13 to C14, 1.8m, North America	1	Accessory Box
5	AR8136BLK	APC 1U 19" Black Modular Toolless Blanking Panel - Qty 10	2	Accessory Box
6	AR8429	Horizontal Cable Organizer 1U w/brush strip	2	Accessory Box/Installed
7	AP8941	Rack PDU 2G, Switched, ZeroU, 30A, 200/208V, (21) C13 & (3) C19	2	Installed
8	SRT5KRMXLT	APC Smart-UPS SRT 5000VA RM 208V	2	Installed
9	AR3100SP	NetShelter SX 42U 600mm Wide x 1070mm Deep Enclosure with Sides Black -2000 lbs. Shock Packaging	1	Installed

NOTES: 1. INSTALLATION SHALL COMPLY WITH ALL APPLICABLE NATIONAL, STATE AND LOCAL ELECTRICAL REGULATIONS. 2. REFER TO PRODUCT DOCUMENTATION FOR ADDITIONAL DETAILS PRIOR TO INSTALLATION AND SITE PREPARATION WORK. 3. ALL DIMENSIONS ARE IN MILLIMETERS [INCHES]. 4. NET WEIGHT OF UNIT WITHOUT UPS AND ACCESSORIES IS 125.09Kg [275.2 Ib]. 5. CABLE ENTRY IS TOP OR BOTTOM OF THE UNIT. 6. FRONT AND REAR SERVICE ACCESS REQUIRED. 7. AIR FLOW AND SERVICE REQUIREMENTS, AS WELL AS MINIMUM CLEARANCE TO FIRE SUPPRESSION SYSTEMS SHOULD BE CONSIDERED WHEN LOCATING THE ENCLOSURE. TITLE: DWG NO: NAD OC ACCESS (2000)

	THIS DRAWING AND SPECIFICATIONS HEREIN ARE THE PROPERTY OF SCHNEIDER ELECTRIC AND SHALL NOT BE COPIED, REPRODUCED OR USED IN WHOLE OR IN PART, AS THE BASIS FOR THE MANUFACTURE	Schneider	5kVA, 208V GENERAL ARRANGEMENT		DWG NO: MDC42SX5KVAT REV.			
<u>1)</u>	USED IN WHOLE OR IN PART, AS THE BASIS FOR THE MANUFACTURE OR SALE OF ITEMS WITHOUT WRITTEN PERMISSION FROM SCHNEIDER				DRAWN BY:	JAYAPRAKASH	10-MAY-17	FIRST
	ELECTRIC. THIS DRAWING IS BASED UPON LATEST AVAILABLE				ENGINEER:	G IVEY	11-MAY-17	ANGLE
	INFORMATION AND IS SUBJECT TO CHANGE WITHOUT NOTICE.		PROJECT: SUBMITTAL DRA	AWINGS SHEET 4 OF 7	APPROVED BY:	T HORSTMANN	11-MAY-17	PROJECTION

