SIEMENS

Data sheet

3RT2037-1KB44-3MA0



power contactor, AC-3e/AC-3, 65 A, 30 kW / 400 V, 3-pole, 24 V DC, 0.8-1.2* Us, with integrated varistor, auxiliary contacts: 2 NO + 2 NC, screw terminal, size: S2, captive auxiliary switch, suitable for PLC outputs

product brand name	SIRIUS
product designation	Coupling contactor
product type designation	3RT2
General technical data	
size of contactor	S2
product extension	
 function module for communication 	No
auxiliary switch	No
power loss [W] for rated value of the current	
 at AC in hot operating state 	11.4 W
 at AC in hot operating state per pole 	3.8 W
 without load current share typical 	1 W
insulation voltage	
 of main circuit with degree of pollution 3 rated value 	690 V
 of auxiliary circuit with degree of pollution 3 rated value 	690 V
surge voltage resistance	
 of main circuit rated value 	6 kV
 of auxiliary circuit rated value 	6 kV
maximum permissible voltage for protective separation between coil and main contacts according to EN 60947-1	400 V
shock resistance at rectangular impulse	
• at DC	6.1g / 5 ms, 3.7g / 10 ms
shock resistance with sine pulse	
• at DC	9.6g / 5 ms, 5.8g / 10 ms
mechanical service life (operating cycles)	
 of contactor typical 	10 000 000
 of the contactor with added electronically optimized auxiliary switch block typical 	5 000 000
 of the contactor with added auxiliary switch block typical 	10 000 000
reference code according to IEC 81346-2	Q
Substance Prohibitance (Date)	10/01/2014
Ambient conditions	
installation altitude at height above sea level maximum	2 000 m
ambient temperature	
during operation	-25 +60 °C
during storage	-55 +80 °C
relative humidity minimum	10 %
relative humidity at 55 °C according to IEC 60068-2-30 maximum	95 %
Main circuit	
number of poles for main current circuit	3


number of NO contacts for main contacts	3
operating voltage	5
• at AC-3 rated value maximum	690 V
at AC-3 rated value maximum at AC-3e rated value maximum	690 V
operational current	
at AC-1 at 400 V at ambient temperature 40 °C rated	80 A
value	
• at AC-1	
— up to 690 V at ambient temperature 40 °C rated	80 A
value	
— up to 690 V at ambient temperature 60 °C rated value	70 A
• at AC-3	
— at 400 V rated value	65 A
— at 500 V rated value	65 A
— at 690 V rated value	47 A
• at AC-3e	
— at 400 V rated value	65 A
— at 500 V rated value	65 A
— at 690 V rated value	47 A
at AC-4 at 400 V rated value	55 A
• at AC-5a up to 690 V rated value	70.4 A
• at AC-5b up to 400 V rated value	53.9 A
● at AC-6a	
— up to 230 V for current peak value n=20 rated value	56.9 A
— up to 400 V for current peak value n=20 rated value	56.9 A
— up to 500 V for current peak value n=20 rated value	56.9 A
— up to 690 V for current peak value n=20 rated value	47 A
● at AC-6a	
 — up to 230 V for current peak value n=30 rated value 	38 A
 — up to 400 V for current peak value n=30 rated value 	38 A
 — up to 500 V for current peak value n=30 rated value 	38 A
 — up to 690 V for current peak value n=30 rated value 	38 A
minimum cross-section in main circuit at maximum AC-1 rated value	25 mm ²
operational current for approx. 200000 operating cycles at AC-4	
• at 400 V rated value	28 A
• at 690 V rated value	22 A
operational current	
 at 1 current path at DC-1 	
— at 24 V rated value	55 A
— at 60 V rated value	23 A
— at 110 V rated value	4.5 A
— at 220 V rated value	1 A
— at 440 V rated value	0.4 A
— at 600 V rated value	0.25 A
 with 2 current paths in series at DC-1 	
— at 24 V rated value	55 A
— at 60 V rated value	45 A
— at 110 V rated value	45 A
— at 220 V rated value	5 A
— at 440 V rated value	1 A
— at 600 V rated value	0.8 A
with 3 current paths in series at DC-1	
— at 24 V rated value	55 A
— at 60 V rated value	55 A
- at 110 V rated value	55 A
- at 220 V rated value	45 A
— at 440 V rated value	2.9 A
— at 600 V rated value	1.4 A
 at 1 current path at DC-3 at DC-5 	


— at 24 V rated value	35 A
— at 60 V rated value	6 A
— at 220 V rated value	1 A
— at 440 V rated value	0.1 A
— at 600 V rated value	0.06 A
 with 2 current paths in series at DC-3 at DC-5 	
— at 24 V rated value	55 A
— at 60 V rated value	45 A
— at 110 V rated value	25 A
— at 220 V rated value	5 A
— at 440 V rated value	0.27 A
— at 600 V rated value	0.16 A
 with 3 current paths in series at DC-3 at DC-5 	
— at 24 V rated value	55 A
— at 60 V rated value	55 A
— at 110 V rated value	55 A
— at 220 V rated value	25 A
— at 440 V rated value	0.6 A
— at 600 V rated value	0.35 A
operating power	
• at AC-2 at 400 V rated value	30 kW
• at AC-3	
— at 230 V rated value	18.5 kW
— at 400 V rated value	30 kW
— at 500 V rated value	37 kW
— at 690 V rated value	37 kW
• at AC-3e	
— at 230 V rated value	18.5 kW
— at 400 V rated value	30 kW
— at 500 V rated value	37 kW
— at 690 V rated value	37 kW
operating power for approx. 200000 operating cycles at AC-	57 KW
4	
 at 400 V rated value 	14.7 kW
 at 690 V rated value 	20 kW
operating apparent power at AC-6a	
	22.6 kVA
operating apparent power at AC-6a• up to 230 V for current peak value n=20 rated value	22.6 kVA 39.4 kVA
 operating apparent power at AC-6a up to 230 V for current peak value n=20 rated value up to 400 V for current peak value n=20 rated value 	
operating apparent power at AC-6a• up to 230 V for current peak value n=20 rated value	39.4 kVA
 operating apparent power at AC-6a up to 230 V for current peak value n=20 rated value up to 400 V for current peak value n=20 rated value up to 500 V for current peak value n=20 rated value up to 690 V for current peak value n=20 rated value 	39.4 kVA 49.2 kVA
 operating apparent power at AC-6a up to 230 V for current peak value n=20 rated value up to 400 V for current peak value n=20 rated value up to 500 V for current peak value n=20 rated value up to 690 V for current peak value n=20 rated value operating apparent power at AC-6a 	39.4 kVA 49.2 kVA
 operating apparent power at AC-6a up to 230 V for current peak value n=20 rated value up to 400 V for current peak value n=20 rated value up to 500 V for current peak value n=20 rated value up to 690 V for current peak value n=20 rated value operating apparent power at AC-6a up to 230 V for current peak value n=30 rated value 	39.4 kVA 49.2 kVA 56.1 kVA 15.1 kVA
 operating apparent power at AC-6a up to 230 V for current peak value n=20 rated value up to 400 V for current peak value n=20 rated value up to 500 V for current peak value n=20 rated value up to 690 V for current peak value n=20 rated value operating apparent power at AC-6a up to 230 V for current peak value n=30 rated value up to 400 V for current peak value n=30 rated value 	39.4 kVA 49.2 kVA 56.1 kVA 15.1 kVA 26.2 kVA
 operating apparent power at AC-6a up to 230 V for current peak value n=20 rated value up to 400 V for current peak value n=20 rated value up to 500 V for current peak value n=20 rated value up to 690 V for current peak value n=20 rated value operating apparent power at AC-6a up to 230 V for current peak value n=30 rated value up to 400 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value 	39.4 kVA 49.2 kVA 56.1 kVA 15.1 kVA 26.2 kVA 32.8 kVA
 operating apparent power at AC-6a up to 230 V for current peak value n=20 rated value up to 400 V for current peak value n=20 rated value up to 500 V for current peak value n=20 rated value up to 690 V for current peak value n=20 rated value operating apparent power at AC-6a up to 230 V for current peak value n=30 rated value up to 400 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value 	39.4 kVA 49.2 kVA 56.1 kVA 15.1 kVA 26.2 kVA
 operating apparent power at AC-6a up to 230 V for current peak value n=20 rated value up to 400 V for current peak value n=20 rated value up to 500 V for current peak value n=20 rated value up to 690 V for current peak value n=20 rated value operating apparent power at AC-6a up to 230 V for current peak value n=30 rated value up to 400 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value 	39.4 kVA 49.2 kVA 56.1 kVA 15.1 kVA 26.2 kVA 32.8 kVA
 operating apparent power at AC-6a up to 230 V for current peak value n=20 rated value up to 400 V for current peak value n=20 rated value up to 500 V for current peak value n=20 rated value up to 690 V for current peak value n=20 rated value operating apparent power at AC-6a up to 230 V for current peak value n=30 rated value up to 400 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value 	39.4 kVA 49.2 kVA 56.1 kVA 15.1 kVA 26.2 kVA 32.8 kVA
 operating apparent power at AC-6a up to 230 V for current peak value n=20 rated value up to 400 V for current peak value n=20 rated value up to 500 V for current peak value n=20 rated value up to 690 V for current peak value n=20 rated value operating apparent power at AC-6a up to 230 V for current peak value n=30 rated value up to 400 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value 	39.4 kVA 49.2 kVA 56.1 kVA 15.1 kVA 26.2 kVA 32.8 kVA 45.3 kVA
 operating apparent power at AC-6a up to 230 V for current peak value n=20 rated value up to 400 V for current peak value n=20 rated value up to 500 V for current peak value n=20 rated value up to 690 V for current peak value n=20 rated value operating apparent power at AC-6a up to 230 V for current peak value n=30 rated value up to 400 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value 	39.4 kVA 49.2 kVA 56.1 kVA 15.1 kVA 26.2 kVA 32.8 kVA 45.3 kVA 1 055 A; Use minimum cross-section acc. to AC-1 rated value
 operating apparent power at AC-6a up to 230 V for current peak value n=20 rated value up to 400 V for current peak value n=20 rated value up to 500 V for current peak value n=20 rated value up to 690 V for current peak value n=20 rated value operating apparent power at AC-6a up to 230 V for current peak value n=30 rated value up to 400 V for current peak value n=30 rated value up to 400 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value 	39.4 kVA 49.2 kVA 56.1 kVA 15.1 kVA 26.2 kVA 32.8 kVA 45.3 kVA 1 055 A; Use minimum cross-section acc. to AC-1 rated value 730 A; Use minimum cross-section acc. to AC-1 rated value
 operating apparent power at AC-6a up to 230 V for current peak value n=20 rated value up to 400 V for current peak value n=20 rated value up to 500 V for current peak value n=20 rated value up to 690 V for current peak value n=20 rated value operating apparent power at AC-6a up to 230 V for current peak value n=30 rated value up to 400 V for current peak value n=30 rated value up to 400 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value 	39.4 kVA 49.2 kVA 56.1 kVA 15.1 kVA 26.2 kVA 32.8 kVA 45.3 kVA 1 055 A; Use minimum cross-section acc. to AC-1 rated value 730 A; Use minimum cross-section acc. to AC-1 rated value 520 A; Use minimum cross-section acc. to AC-1 rated value
 operating apparent power at AC-6a up to 230 V for current peak value n=20 rated value up to 400 V for current peak value n=20 rated value up to 500 V for current peak value n=20 rated value up to 690 V for current peak value n=20 rated value operating apparent power at AC-6a up to 230 V for current peak value n=30 rated value up to 400 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value short-time withstand current in cold operating state up to 40 °C limited to 1 s switching at zero current maximum limited to 10 s switching at zero current maximum limited to 30 s switching at zero current maximum 	39.4 kVA 49.2 kVA 56.1 kVA 15.1 kVA 26.2 kVA 32.8 kVA 45.3 kVA 1 055 A; Use minimum cross-section acc. to AC-1 rated value 730 A; Use minimum cross-section acc. to AC-1 rated value 520 A; Use minimum cross-section acc. to AC-1 rated value 336 A; Use minimum cross-section acc. to AC-1 rated value
 operating apparent power at AC-6a up to 230 V for current peak value n=20 rated value up to 400 V for current peak value n=20 rated value up to 500 V for current peak value n=20 rated value up to 690 V for current peak value n=20 rated value operating apparent power at AC-6a up to 230 V for current peak value n=30 rated value up to 400 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current in cold operating state up to 40 °C limited to 1 s switching at zero current maximum limited to 10 s switching at zero current maximum limited to 30 s switching at zero current maximum limited to 60 s switching at zero current maximum 	39.4 kVA 49.2 kVA 56.1 kVA 15.1 kVA 26.2 kVA 32.8 kVA 45.3 kVA 1 055 A; Use minimum cross-section acc. to AC-1 rated value 730 A; Use minimum cross-section acc. to AC-1 rated value 520 A; Use minimum cross-section acc. to AC-1 rated value 336 A; Use minimum cross-section acc. to AC-1 rated value
 operating apparent power at AC-6a up to 230 V for current peak value n=20 rated value up to 400 V for current peak value n=20 rated value up to 500 V for current peak value n=20 rated value up to 690 V for current peak value n=20 rated value operating apparent power at AC-6a up to 230 V for current peak value n=30 rated value up to 230 V for current peak value n=30 rated value up to 400 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for surrent peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for surrent peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value 	39.4 kVA 49.2 kVA 56.1 kVA 15.1 kVA 26.2 kVA 32.8 kVA 45.3 kVA 1 055 A; Use minimum cross-section acc. to AC-1 rated value 730 A; Use minimum cross-section acc. to AC-1 rated value 520 A; Use minimum cross-section acc. to AC-1 rated value 336 A; Use minimum cross-section acc. to AC-1 rated value 272 A; Use minimum cross-section acc. to AC-1 rated value
 operating apparent power at AC-6a up to 230 V for current peak value n=20 rated value up to 400 V for current peak value n=20 rated value up to 500 V for current peak value n=20 rated value up to 690 V for current peak value n=20 rated value operating apparent power at AC-6a up to 230 V for current peak value n=30 rated value up to 230 V for current peak value n=30 rated value up to 400 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value binited to 1 s switching at zero current maximum limited to 1 s switching at zero current maximum limited to 30 s switching at zero current maximum limited to 60 s switching at zero current maximum limited to 60 s switching at zero current maximum 	39.4 kVA 49.2 kVA 56.1 kVA 15.1 kVA 26.2 kVA 32.8 kVA 45.3 kVA 1 055 A; Use minimum cross-section acc. to AC-1 rated value 730 A; Use minimum cross-section acc. to AC-1 rated value 520 A; Use minimum cross-section acc. to AC-1 rated value 336 A; Use minimum cross-section acc. to AC-1 rated value 272 A; Use minimum cross-section acc. to AC-1 rated value
 operating apparent power at AC-6a up to 230 V for current peak value n=20 rated value up to 400 V for current peak value n=20 rated value up to 500 V for current peak value n=20 rated value up to 690 V for current peak value n=20 rated value operating apparent power at AC-6a up to 230 V for current peak value n=30 rated value up to 400 V for current peak value n=30 rated value up to 400 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value binited to 1 s switching at zero current maximum limited to 1 s switching at zero current maximum limited to 30 s switching at zero current maximum limited to 60 s switching at zero current maximum limited to 60 s switching at zero current maximum limited to 60 s switching at zero current maximum binited to 10 s switching at zero current maximum limited to 60 s switching at zero current maximum limited to 60 s switching at zero current maximum	39.4 kVA 49.2 kVA 56.1 kVA 15.1 kVA 26.2 kVA 32.8 kVA 45.3 kVA 1 055 A; Use minimum cross-section acc. to AC-1 rated value 730 A; Use minimum cross-section acc. to AC-1 rated value 520 A; Use minimum cross-section acc. to AC-1 rated value 336 A; Use minimum cross-section acc. to AC-1 rated value 272 A; Use minimum cross-section acc. to AC-1 rated value 1 500 1/h
 operating apparent power at AC-6a up to 230 V for current peak value n=20 rated value up to 400 V for current peak value n=20 rated value up to 500 V for current peak value n=20 rated value up to 690 V for current peak value n=20 rated value operating apparent power at AC-6a up to 230 V for current peak value n=30 rated value up to 230 V for current peak value n=30 rated value up to 400 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value short-time withstand current in cold operating state up to 40 °C limited to 1 s switching at zero current maximum limited to 10 s switching at zero current maximum limited to 30 s switching at zero current maximum limited to 60 s switching at zero current maximum limited to 60 s switching at zero current maximum limited to 60 s switching at zero current maximum limited to 60 s switching at zero current maximum at DC operating frequency at AC-1 maximum at AC-2 maximum 	 39.4 kVA 49.2 kVA 56.1 kVA 15.1 kVA 26.2 kVA 32.8 kVA 45.3 kVA 1 055 A; Use minimum cross-section acc. to AC-1 rated value 730 A; Use minimum cross-section acc. to AC-1 rated value 520 A; Use minimum cross-section acc. to AC-1 rated value 336 A; Use minimum cross-section acc. to AC-1 rated value 272 A; Use minimum cross-section acc. to AC-1 rated value 1 500 1/h 800 1/h
 operating apparent power at AC-6a up to 230 V for current peak value n=20 rated value up to 400 V for current peak value n=20 rated value up to 500 V for current peak value n=20 rated value up to 690 V for current peak value n=20 rated value up to 230 V for current peak value n=30 rated value up to 230 V for current peak value n=30 rated value up to 400 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value to 500 V for current peak value n=30 rated value to 690 V for current peak value n=30 rated value to 600 V for current peak value n=30 rated value to 600 V for current peak value n=30 rated value<td> 39.4 kVA 49.2 kVA 56.1 kVA 15.1 kVA 26.2 kVA 32.8 kVA 45.3 kVA 45.3 kVA 1 055 A; Use minimum cross-section acc. to AC-1 rated value 730 A; Use minimum cross-section acc. to AC-1 rated value 520 A; Use minimum cross-section acc. to AC-1 rated value 336 A; Use minimum cross-section acc. to AC-1 rated value 272 A; Use minimum cross-section acc. to AC-1 rated value 1 500 1/h 800 1/h 400 1/h 700 1/h </td>	 39.4 kVA 49.2 kVA 56.1 kVA 15.1 kVA 26.2 kVA 32.8 kVA 45.3 kVA 45.3 kVA 1 055 A; Use minimum cross-section acc. to AC-1 rated value 730 A; Use minimum cross-section acc. to AC-1 rated value 520 A; Use minimum cross-section acc. to AC-1 rated value 336 A; Use minimum cross-section acc. to AC-1 rated value 272 A; Use minimum cross-section acc. to AC-1 rated value 1 500 1/h 800 1/h 400 1/h 700 1/h
 operating apparent power at AC-6a up to 230 V for current peak value n=20 rated value up to 400 V for current peak value n=20 rated value up to 500 V for current peak value n=20 rated value up to 690 V for current peak value n=20 rated value operating apparent power at AC-6a up to 230 V for current peak value n=30 rated value up to 230 V for current peak value n=30 rated value up to 400 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value short-time withstand current in cold operating state up to 40 °C limited to 1 s switching at zero current maximum limited to 10 s switching at zero current maximum limited to 30 s switching at zero current maximum limited to 60 s switching at zero current maximum limited to 60 s switching at zero current maximum at DC operating frequency at AC-1 maximum at AC-3 maximum at AC-3 maximum at AC-3 maximum at AC-3 maximum 	 39.4 kVA 49.2 kVA 56.1 kVA 15.1 kVA 26.2 kVA 32.8 kVA 45.3 kVA 45.3 kVA 1 055 A; Use minimum cross-section acc. to AC-1 rated value 730 A; Use minimum cross-section acc. to AC-1 rated value 520 A; Use minimum cross-section acc. to AC-1 rated value 336 A; Use minimum cross-section acc. to AC-1 rated value 272 A; Use minimum cross-section acc. to AC-1 rated value 1 500 1/h 800 1/h 400 1/h 700 1/h 700 1/h
 operating apparent power at AC-6a up to 230 V for current peak value n=20 rated value up to 400 V for current peak value n=20 rated value up to 500 V for current peak value n=20 rated value up to 690 V for current peak value n=20 rated value up to 230 V for current peak value n=30 rated value up to 230 V for current peak value n=30 rated value up to 400 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value to 500 V for current peak value n=30 rated value to 690 V for current peak value n=30 rated value to 600 V for current peak value n=30 rated value to 600 V for current peak value n=30 rated value<td> 39.4 kVA 49.2 kVA 56.1 kVA 15.1 kVA 26.2 kVA 32.8 kVA 45.3 kVA 45.3 kVA 1 055 A; Use minimum cross-section acc. to AC-1 rated value 730 A; Use minimum cross-section acc. to AC-1 rated value 520 A; Use minimum cross-section acc. to AC-1 rated value 336 A; Use minimum cross-section acc. to AC-1 rated value 272 A; Use minimum cross-section acc. to AC-1 rated value 1 500 1/h 800 1/h 400 1/h 700 1/h </td>	 39.4 kVA 49.2 kVA 56.1 kVA 15.1 kVA 26.2 kVA 32.8 kVA 45.3 kVA 45.3 kVA 1 055 A; Use minimum cross-section acc. to AC-1 rated value 730 A; Use minimum cross-section acc. to AC-1 rated value 520 A; Use minimum cross-section acc. to AC-1 rated value 336 A; Use minimum cross-section acc. to AC-1 rated value 272 A; Use minimum cross-section acc. to AC-1 rated value 1 500 1/h 800 1/h 400 1/h 700 1/h

type of voltage of the control supply voltage	DC
control supply voltage at DC	
rated value	24 V
operating range factor control supply voltage rated value of magnet coil at DC	
• initial value	0.8
• full-scale value	1.2
design of the surge suppressor	with varistor
inrush current peak	2.6 A
duration of inrush current peak	50 µs
locked-rotor current mean value	0.9 A
locked-rotor current peak	2.1 A
duration of locked-rotor current	230 ms
holding current mean value	40 mA
closing power of magnet coil at DC	21.5 W
holding power of magnet coil at DC	1 W
closing delay	
• at DC	35 80 ms
opening delay	
• at DC	30 55 ms
arcing time	10 20 ms
control version of the switch operating mechanism	Standard A1 - A2
Auxiliary circuit	
number of NC contacts for auxiliary contacts instantaneous contact	2
number of NO contacts for auxiliary contacts instantaneous contact	2
operational current at AC-12 maximum	10 A
operational current at AC-15	
• at 230 V rated value	6 A
• at 400 V rated value	3 A
• at 500 V rated value	2 A
• at 690 V rated value	1 A
operational current at DC-12	
at 24 V rated value	10 A
• at 48 V rated value	6 A
• at 60 V rated value	6 A
• at 110 V rated value	3 A
 at 125 V rated value 	2 A
at 220 V rated value	1A
at 600 V rated value	0.15 A
operational current at DC-13	
• at 24 V rated value	6 A
at 48 V rated value	2 A
at 60 V rated value	2 A
at 110 V rated value	1A
at 125 V rated value	0.9 A
at 125 V rated value	0.3 A
at 220 V rated value at 600 V rated value	0.5 A 0.1 A
contact reliability of auxiliary contacts	1 faulty switching per 100 million (17 V, 1 mA)
UL/CSA ratings	
full-load current (FLA) for 3-phase AC motor	65 A
at 480 V rated value	65 A
at 600 V rated value	52 A
yielded mechanical performance [hp]	
for single-phase AC motor	
— at 110/120 V rated value	5 hp
— at 230 V rated value	10 hp
• for 3-phase AC motor	
— at 200/208 V rated value	20 hp
— at 220/230 V rated value	20 hp

at 460/400 V/ rated value	50 hr
- at 460/480 V rated value	50 hp
- at 575/600 V rated value	50 hp
contact rating of auxiliary contacts according to UL	A600 / Q600
Short-circuit protection	
design of the fuse link	
 for short-circuit protection of the main circuit — with type of coordination 1 required 	gG: 250 A (690 V, 100 kA), aM: 160 A (690 V, 100 kA), BS88: 200 A (415 V, 80
	(415 V, 80 KA), ANI 100 KA), ANI 100 K (690 V, 100 KA), BS66. 200 K (415 V, 80 KA)
 — with type of assignment 2 required 	gG: 125A (690V,100kA), aM: 63A (690V,100kA), BS88: 100A (415V,80kA)
 for short-circuit protection of the auxiliary switch required 	gG: 10 A (500 V, 1 kA)
Installation/ mounting/ dimensions	
mounting position	+/-180° rotation possible on vertical mounting surface; can be tilted forward and
	backward by +/- 22.5° on vertical mounting surface
fastening method	screw and snap-on mounting onto 35 mm DIN rail according to DIN EN 60715
side-by-side mounting	Yes
height	114 mm
width	55 mm
depth	174 mm
required spacing	
with side-by-side mounting	40
— forwards	10 mm
— upwards	10 mm
— downwards	10 mm
— at the side	0 mm
 for grounded parts 	
— forwards	10 mm
— upwards	10 mm
— at the side	6 mm
— downwards	10 mm
 for live parts 	
— forwards	10 mm
— upwards	10 mm
— downwards	10 mm
— at the side	6 mm
Connections/ Terminals	
type of electrical connection	
 for main current circuit 	screw-type terminals
 for auxiliary and control circuit 	screw-type terminals
 at contactor for auxiliary contacts 	Screw-type terminals
of magnet coil	Screw-type terminals
type of connectable conductor cross-sections for main contacts	
 solid or stranded 	2x (1 35 mm²), 1x (1 50 mm²)
 finely stranded with core end processing 	2x (1 25 mm²), 1x (1 35 mm²)
connectable conductor cross-section for main contacts	
 finely stranded with core end processing 	1 35 mm²
connectable conductor cross-section for auxiliary contacts	
solid or stranded	0.5 2.5 mm²
 finely stranded with core end processing 	0.5 2.5 mm²
type of connectable conductor cross-sections	
 for auxiliary contacts 	
— solid or stranded	2x (0.5 1.5 mm²), 2x (0.75 2.5 mm²)
 finely stranded with core end processing 	2x (0.5 1.5 mm²), 2x (0.75 2.5 mm²)
 for AWG cables for auxiliary contacts 	2x (20 16), 2x (18 14)
AWG number as coded connectable conductor cross section	
for main contacts	18 1
 for auxiliary contacts 	20 14
Safety related data	
product function	
 mirror contact according to IEC 60947-4-1 	Yes
 positively driven operation according to IEC 60947-5-1 	No

D10 value with high d						
B to value with high d	emand rate according to S	N 31920 1 000	000			
proportion of dange	rous failures					
 with low deman 	nd rate according to SN 31	920 40 %				
 with high dema 	nd rate according to SN 3	1920 73 %				
failure rate [FIT] with I	ow demand rate according	to SN 31920 100 F	100 FIT			
T1 value for proof test 61508	t interval or service life acc	ording to IEC 20 a	20 a IP20			
protection class IP o	on the front according to	IEC 60529 IP20				
touch protection on	the front according to IE	C 60529 finge	r-safe, for vertical contact	from the front		
suitability for use						
 safety-related s 	witching OFF	Yes				
ertificates/ approvals	S					
General Product Ap	proval					
SP.	<u>Confirmation</u>			KC	EHC	
EMC	Functional Safety/Safety of Ma- chinery	Declaration of Confor	mity	Test Certificates		
RCM	<u>Type Examination Cer-</u> tificate	UK CA	CE EG-Konf.	<u>Special Test Certific-</u> <u>ate</u>	Type Test Certific- ates/Test Report	
Marine / Shipping						
ABS	BUREAU VERITAS		Lloyd's Register Lirs	PRS	RINA	
Marine / Shipping	other	Railway	Environment			
		Vibration and Shock	Environmental Con-			
KMRS RMRS	<u>Confirmation</u>		<u>firmations</u>			
RMRS	Confirmation		tirmations			
			tirmations			
https://press.siemens. Siemens is working Please contact your lo EAC relevant market Information on the p https://support.industr Information- and Do	d to exit the Russian mar com/global/en/pressreleas on the renewal of the cu ocal Siemens office on the (other than the sanctioned ackaging y.siemens.com/cs/ww/en/v wnloadcenter (Catalogs,	e/siemens-wind-down-rus rrent EAC certificates. status of validity of the EA EAEU member states Rus riew/109813875	<u>sian-business</u> C certification if you inten	d to import or offer to suppl	ly these products to a	
Siemens has decide https://press.siemens. Siemens is working Please contact your lo EAC relevant market (nformation on the p https://support.industr nformation- and Do https://www.siemens.o ndustry Mall (Online	d to exit the Russian mai .com/global/en/pressreleas on the renewal of the cur cal Siemens office on the (other than the sanctioned packaging y.siemens.com/cs/ww/en/v wnloadcenter (Catalogs, com/ic10 e ordering system)	e/siemens-wind-down-rus rrent EAC certificates. status of validity of the EA EAEU member states Rus riew/109813875 Brochures,)	<u>sian-business</u> C certification if you inten ssia or Belarus).	d to import or offer to suppl	ly these products to a	
Siemens has decide https://press.siemens. Siemens is working Please contact your lo EAC relevant market of information on the p https://support.industry ittps://www.siemens.or industry Mall (Online https://mall.industry.si Cax online generato	d to exit the Russian mai .com/global/en/pressreleas on the renewal of the cur ocal Siemens office on the (other than the sanctioned packaging y.siemens.com/cs/ww/en/v wnloadcenter (Catalogs, com/ic10 e ordering system) iemens.com/mall/en/en/Ca r	e/siemens-wind-down-rus rrent EAC certificates. status of validity of the EA EAEU member states Rus riew/109813875 Brochures,) talog/product?mlfb=3RT20	sian-business C certification if you inten ssia or Belarus). 137-1KB44-3MA0		ly these products to a	
Siemens has decide https://press.siemens. Siemens is working Please contact your lo EAC relevant market nformation on the p https://support.industr nformation- and Do nttps://www.siemens.o. ndustry Mall (Online ttps://mall.industry.si Cax online generato http://support.automat Service&Support (M	d to exit the Russian mai .com/global/en/pressreleas on the renewal of the cur ocal Siemens office on the (other than the sanctioned ackaging y.siemens.com/cs/ww/en/v wnloadcenter (Catalogs, com/ic10 e ordering system) iemens.com/mall/en/en/Ca r tion.siemens.com/WW/CA anuals, Certificates, Cha	e/siemens-wind-down-rus rrent EAC certificates. status of validity of the EA EAEU member states Rus view/109813875 Brochures,) talog/product?mlfb=3RT20 Xorder/default.aspx?lang=/ racteristics, FAQs,)	sian-business C certification if you inten ssia or Belarus). 137-1KB44-3MA0		ly these products to a	
Siemens has decide https://press.siemens. Siemens is working Please contact your lo EAC relevant market information on the p https://support.industr nformation- and Do https://www.siemens.o ndustry Mall (Online https://mall.industry.si Cax online generato Cax online generato Service&Support (M https://support.industr mage database (pro	d to exit the Russian mai .com/global/en/pressreleas on the renewal of the cur ocal Siemens office on the (other than the sanctioned ackaging y.siemens.com/cs/ww/en/r wnloadcenter (Catalogs, com/ic10 e ordering system) iemens.com/mall/en/en/Ca r tion.siemens.com/WW/CA anuals, Certificates, Cha y.siemens.com/cs/ww/en/r	e/siemens-wind-down-rus rrent EAC certificates. status of validity of the EA EAEU member states Rus view/109813875 Brochures,) talog/product?mlfb=3RT20 Xorder/default.aspx?lang=r racteristics, FAQs,) ps/3RT2037-1KB44-3MA0 ion drawings, 3D models	sian-business C certification if you inten ssia or Belarus). 137-1KB44-3MA0 en&mlfb=3RT2037-1KB4 , device circuit diagram	4-3MA0	ly these products to a	
Siemens has decide https://press.siemens. Siemens is working Please contact your lo EAC relevant market nformation on the p https://support.industr nformation- and Do nttps://www.siemens.o ndustry Mall (Online https://mall.industry.si Cax online generato Service&Support.dustr mage database (pro http://www.automatior Characteristic: Tripp	d to exit the Russian mai com/global/en/pressreleas on the renewal of the cu ocal Siemens office on the (other than the sanctioned aackaging y.siemens.com/cs/ww/en/v wnloadcenter (Catalogs, com/ic10 e ordering system) iemens.com/mall/en/en/Ca r tion.siemens.com/WW/CA anuals, Certificates, Cha y.siemens.com/cs/ww/en/p oduct images, 2D dimens n.siemens.com/bilddb/cax. bing characteristics, I²t, L	e/siemens-wind-down-rus rrent EAC certificates. status of validity of the EA EAEU member states Rus view/109813875 Brochures,) talog/product?mlfb=3RT20 Xorder/default.aspx?lang=r racteristics, FAQs,) ps/3RT2037-1KB44-3MA0 ion drawings, 3D models de.aspx?mlfb=3RT2037-1 et-through current	sian-business C certification if you inten ssia or Belarus). 137-1KB44-3MA0 en&mlfb=3RT2037-1KB4 , device circuit diagram KB44-3MA0⟨=en	4-3MA0	ly these products to a	
Siemens has decide https://press.siemens. Siemens is working Please contact your lo EAC relevant market in nformation on the p https://support.industry nformation- and Do https://www.siemens.co ndustry Mall (Online https://mall.industry.si Cax online generato Cax online generato Service&Support (M https://support.industry mage database (pro http://www.automation Characteristic: Tripp https://support.industry	d to exit the Russian mai com/global/en/pressreleas on the renewal of the cu ocal Siemens office on the (other than the sanctioned iackaging y.siemens.com/cs/ww/en/i wnloadcenter (Catalogs, com/ic10 e ordering system) iemens.com/mail/en/en/Cat anuals, Certificates, Cha y.siemens.com/cs/ww/en/i oduct images, 2D dimens n.siemens.com/bilddb/cax. bing characteristics, I²t, L y.siemens.com/cs/ww/en/i	e/siemens-wind-down-rus rrent EAC certificates. status of validity of the EA EAEU member states Rus view/109813875 Brochures,) talog/product?mlfb=3RT20 Xorder/default.aspx?lang=/ racteristics, FAQs,) ps/3RT2037-1KB44-3MA0 ion drawings, 3D models de.aspx?mlfb=3RT2037-1	sian-business C certification if you inten ssia or Belarus). 137-1KB44-3MA0 en&mlfb=3RT2037-1KB4 , device circuit diagram KB44-3MA0⟨=en	4-3MA0	ly these products to a	

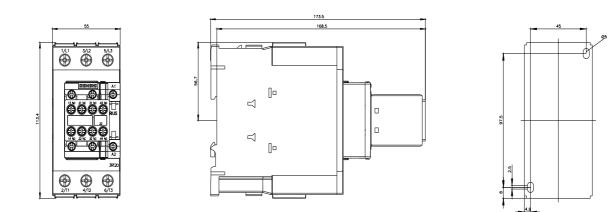

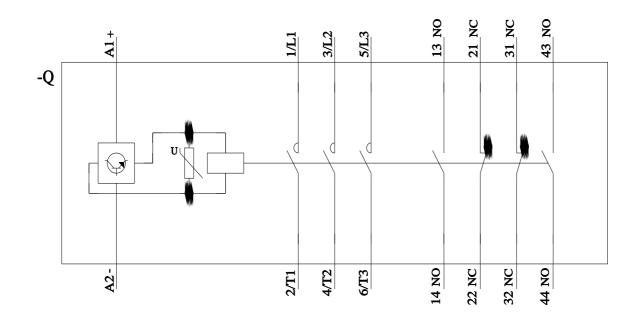

2/10/2023 🖸