SIEMENS

Data sheet

3RP2505-1RW30



Timing relay, Multifunction 2 change-over contacts, 13 functions Positively driven Relay contacts 24...240 V AC/DC at 50/60 Hz AC 7 time ranges (0.05 s...100 h) with LED, Screw terminal

product brand name	SIRIUS
product designation	timing relay
design of the product	13 functions, suitable for railway applications
product type designation	3RP25
General technical data	
product component	
 relay output 	Yes
 semi-conductor output 	No
product extension required remote control	No
product extension optional remote control	No
power loss [W] maximum	2 W
insulation voltage for overvoltage category III according to IEC 60664 with degree of pollution 3 rated value	300 V
test voltage for isolation test	2.5 kV
degree of pollution	3
surge voltage resistance rated value	4 000 V
protection class IP	IP20
shock resistance according to IEC 60068-2-27	11g / 15 ms
vibration resistance according to IEC 60068-2-6	10 55 Hz / 0.35 mm
mechanical service life (operating cycles) typical	10 000 000
electrical endurance (operating cycles) at AC-15 at 230 V typical	100 000
adjustable time	0.05 s 100 h
relative setting accuracy relating to full-scale value	5 %; +/-
thermal current	5 A
minimum ON period	35 ms
recovery time	250 ms
reference code according to IEC 81346-2	К
relative repeat accuracy	1 %; +/-
influence of the surrounding temperature	1% in the whole temperature range to the set runtime
power supply influence	1% in the whole voltage range to the set runtime
Substance Prohibitance (Date)	04/21/2016
Control circuit/ Control	
type of voltage of the control supply voltage	AC/DC
control supply voltage 1 at AC	
• at 50 Hz	24 240 V
• at 60 Hz	24 240 V
control supply voltage frequency 1	50 60 Hz
control supply voltage 1	
• at DC	24 240 V
operating range factor control supply voltage rated value at	

DC	
initial value	0.7
full-scale value	1.1
operating range factor control supply voltage rated value at AC at 50 Hz	
 initial value 	0.7
• full-scale value	1.1
operating range factor control supply voltage rated value at AC at 60 Hz	
initial value	0.7
● full-scale value	1.1
inrush current peak	
• at 24 V	0.5 A
• at 240 V	5 A
duration of inrush current peak	
• at 24 V	0.4 ms
• at 240 V	0.5 ms
Switching Function	
switching function	
ON-delay	Yes
ON-delay/instantaneous contact	No
passing make contact	Yes
passing make contact passing make contact	No
OFF delay	No
switching function	
flashing symmetrically with interval start/instantaneous	No
	Yes
flashing symmetrically with interval start	
flashing symmetrically with pulse start/instantaneous	No
flashing symmetrically with pulse start	Yes
flashing asymmetrically with interval start	No
flashing asymmetrically with pulse start	No
switching function	
star-delta circuit with delay time	No
star-delta circuit	No
switching function with control signal	
 additive ON-delay 	Yes
 passing break contact 	Yes
 passing break contact/instantaneous 	No
 OFF delay 	Yes
 OFF delay/instantaneous 	No
pulse delayed	Yes
 pulse delayed/instantaneous 	No
 pulse-shaping 	Yes
 pulse-shaping/instantaneous 	No
 additive ON-delay/instantaneous 	No
 ON-delay/OFF-delay/instantaneous 	No
 passing make contact 	Yes
 passing make contact/instantaneous contact 	No
switching function of interval relay with control signal	
 retrotriggerable with deactivated control signal/instantaneous contact 	No
 retrotriggerable with switched-on control signal 	Yes
 retrotriggerable with switched-on control 	No
 retriggerable with deactivated control signal 	Yes
design of the control terminal non-floating	Yes
Short-circuit protection	
design of the fuse link for short-circuit protection of the auxiliary switch required	fuse gL/gG: 4 A
Auxiliary circuit	
material of switching contacts	AgSnO2
number of NC contacts	

delayed switching	0
instantaneous contact	0
number of NO contacts	
 delayed switching 	0
instantaneous contact	0
number of CO contacts	
 delayed switching 	2
 instantaneous contact 	0
operational current of auxiliary contacts at AC-15	
• at 24 V	3 A
• at 250 V	3 A
operational current of auxiliary contacts at DC-13	
• at 24 V	1 A
• at 125 V	0.2 A
• at 250 V	0.1 A
operating frequency with 3RT2 contactor maximum	5 000 1/h
contact reliability of auxiliary contacts	one incorrect switching operation of 100 million switching operations (17 V, 5 mA) $$
contact rating of auxiliary contacts according to UL	R300 / B300
switching capacity current with inductive load	0.01 3 A
Inputs/ Outputs	
product function	
 at the relay outputs switchover delayed/without delay 	No
• non-volatile	No
Electromagnetic compatibility	
EMC emitted interference according to IEC 61812-1	ambience A (industrial sector)
EMC immunity according to IEC 61812-1	corresponds to degree of severity 3
conducted interference	
due to burst according to IEC 61000-4-4	2 kV network connection / 1 kV control connection
due to conductor-earth surge according to IEC 61000-4-5	2 kV
due to conductor-conductor surge according to IEC	1 kV
61000-4-5	1 KV
field-based interference according to IEC 61000-4-3	10 V/m
electrostatic discharge according to IEC 61000-4-2	4 kV contact discharge / 8 kV air discharge
Safety related data	
protection class IP on the front according to IEC 60529	IP20
type of insulation	Basic insulation
category according to EN 954-1	none
Connections/ Terminals	
product component removable terminal for auxiliary and control circuit	Yes
type of electrical connection for auxiliary and control circuit	screw-type terminals
type of connectable conductor cross-sections	
• solid	1x (0.5 4.0 mm²), 2x (0.5 2.5 mm²)
 finely stranded with core end processing 	1x (0.5 4 mm²), 2x (0.5 1.5 mm²)
 for AWG cables solid 	1x (20 12), 2x (20 14)
 for AWG cables stranded 	1x (20 12), 2x (20 14)
connectable conductor cross-section	
• solid	0.5 4 mm²
 finely stranded with core end processing 	0.5 4 mm²
AWG number as coded connectable conductor cross section	
• solid	20 12
• stranded	20 14
tightening torque	0.6 0.8 N·m
design of the thread of the connection screw	M3
Installation/ mounting/ dimensions	
mounting position	any
fastening method	screw and snap-on mounting onto 35 mm DIN rail
height	100 mm
width	22.5 mm
an and a second s	
depth	90 mm

required spacing • with side-by-side mounting - forwards 0 mm - backwards 0 mm - upwards 0 mm - downwards 0 mm - at the side • for grounded parts - forwards 0 mm	
forwards 0 mm backwards 0 mm upwards 0 mm downwards 0 mm downwards 0 mm at the side 0 mm • for grounded parts 0 mm	
backwards0 mm upwards0 mm downwards0 mm at the side0 mm• for grounded parts forwards0 mm	
upwards 0 mm downwards 0 mm at the side 0 mm • for grounded parts 0 mm forwards 0 mm	
- downwards 0 mm - at the side 0 mm • for grounded parts - forwards 0 mm 0 mm	
— at the side 0 mm • for grounded parts 0 mm — forwards 0 mm	
for grounded parts — forwards 0 mm	
— forwards 0 mm	
heelswards 0 mm	
— backwards 0 mm	
— upwards 0 mm	
— at the side 0 mm	
— downwards 0 mm	
• for live parts	
— forwards 0 mm	
— backwards 0 mm	
— upwards 0 mm	
- downwards 0 mm	
— at the side 0 mm	
Ambient conditions	
installation altitude at height above sea level maximum 2 000 m	
ambient temperature	
• during operation -25 +60 °C	
• during storage -40 +85 °C	
• during storage -40 +85 °C	
relative humidity during operation 10 95 %	
Certificates/ approvals	
General Product Approval	
	EMC
Ster Confirmation (Confirmation EAL)	EMC
Confirmation Confirmation Confirmation Confirmation Confirmation Declaration of Conformity Test Certificates Marine / Shipping	
Confirmation Confirmation Confirmation Confirmation Confirmation Declaration of Conformity Test Certificates Marine / Shipping	
Confirmation Image: Confirmation Image: Confirmation Image: Confirmation Image: Confirmation Declaration of Conformity Test Certificates Marine / Shipping Image: Confirmation of Conformity Special Test Certificates Type Test Certificates Image: Confirmation of Conformity Special Test Certificates Type Test Certificates	EMC RCM
Confirmation Image: Confirmation of Conformity Image: Confirmation of Conf	
$\begin{array}{c c c c c c c c c c c c c c c c c c c $	RCM RCM
Confirmation Confirmation <th< td=""><td>RCM RCM</td></th<>	RCM RCM
$\begin{array}{c c c c c c c c c c c c c c c c c c c $	RCM RCM
Confirmation Confirmation Confirmation Confirmation Confirmation Confirmation Confirmation Confirmation Confirmation Confirmation Confirmation Confirmation Confirmation Confirmation <td>RCM RCM</td>	RCM RCM
Confirmation Confirmation <td>RCM RCM</td>	RCM RCM
Confirmation Confirmation Confirmation Confirmation Confirmation Declaration of Conformity Test Certificates Marine / Shipping Confirmation Marine / Shipping Marine / Shipping Confirmation	RCM RCM
Confirmation Image: Confirmation	RCM RCM
Confirmation Confirmation Cocc Declaration of Conformity Test Certificates Cocc Marine / Shipping Marine / Shipping Marine / Shipping Marine / Shipping Confirmation Confirmation	RCM RCM
Confirmation Confirmation Cocc Declaration of Conformity Test Certificates CCC Marine / Shipping Marine / Shipping Marine / Shipping Marine / Shipping Confirmation Confirmation	RCM RCM
Confirmation $\widehat{\mathbb{CCC}}$ $\mathbb{CCC$	RCM RCM
Confirmation $\widehat{\mathbb{Confirmation}}$ $\widehat{\mathbb{Confirmation}}$ $\widehat{\mathbb{Confirmation}}$ $\widehat{\mathbb{Confirmation}}$ $\widehat{\mathbb{Confirmation}}$ Declaration of ConformityTest CertificatesMarine / Shipping $\widehat{\mathbb{CE}}$ $\widehat{\mathbb{CE}}$ $\widehat{\mathbb{Special Test Certificates}}$ $\widehat{\mathbb{Special Test Certificates}}$ $\widehat{\mathbb{CE}}$ $\widehat{\mathbb{CE}}$ $\widehat{\mathbb{CE}}$ $\widehat{\mathbb{Special Test Certificates}}$ $\widehat{\mathbb{Special Test Certificates}}$ Marine / Shipping $\widehat{\mathbb{Confirmation}}$ $\widehat{\mathbb{Confirmation}}$ $\widehat{\mathbb{Confirmation}}$ $\widehat{\mathbb{Confirmation}}$ $\widehat{\mathbb{Confirmation}}$ $\widehat{\mathbb{Confirmation}}$ $\widehat{\mathbb{Confirmation}}$ $\widehat{\mathbb{Confirmation}}$ $\widehat{\mathbb{Cunfirmation}}$	RCM RCM
Confirmation Confirmation Confirmation Confirmation Confirmation Confirmation Declaration of Conformity Test Certificates Marine / Shipping Confirmation	RCM RCM
Confirmation Confirmation Confirmation Confirmation Confirmation Declaration of Conformity Test Certificates Marine / Shipping Confirmation Confirmation Marine / Shipping Marine / Shipping Marine / Shipping Confirmation Confirmation Marine / Shipping Confirmation Confirmation Confirmation	RCM RCM
$\begin{array}{c} \label{eq:cc} \\ \hline \begin{tabular}{ c c c c } \hline \begin{tabular}{ c c c c } \hline \begin{tabular}{ c c c c c } \hline \begin{tabular}{ c c c c c c c c c c c c c c c c c c c$	LIS
Confirmation \overbrace{CCC} \overbrace{OOO} \fbox{OOO} \fbox{OOOO} \blacksquare Declaration of ConformityTest CertificatesMarine / Shipping \overbrace{CCC} \overbrace{OOOO} $Special Test Certific-ateType Test Certific-ates/Test Report\overbrace{OOOOOOOOOOOOOOOOOOOOOOOOOOOOOOOOOOOO$	LIS

https://support.industry.siemens.com/cs/ww/en/view/109813875 Information- and Downloadcenter (Catalogs, Brochures,...)

https://www.siemens.com/ic10

Industry Mall (Online ordering system) https://mall.industry.siemens.com/mall/en/en/Catalog/product?mlfb=3RP2505-1RW30


Cax online generator


http://support.automation.siemens.com/WW/CAXorder/default.aspx?lang=en&mlfb=3RP2505-1RW30

Service&Support (Manuals, Certificates, Characteristics, FAQs,...)

https://support.industry.siemens.com/cs/ww/en/ps/3RP2505-1RW30

Image database (product images, 2D dimension drawings, 3D models, device circuit diagrams, EPLAN macros, ...) http://www.automation.siemens.com/bilddb/cax_de.aspx?mlfb=3RP2505-1RW30&lang=en Characteristic: Derating https://support.industry.siemens.com/cs/ww/en/ps/3RP2505-1RW30/manual

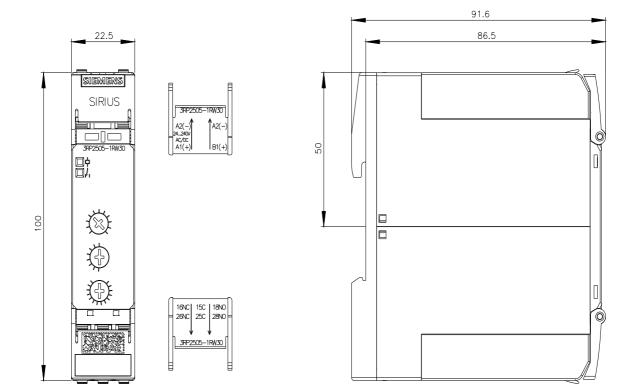

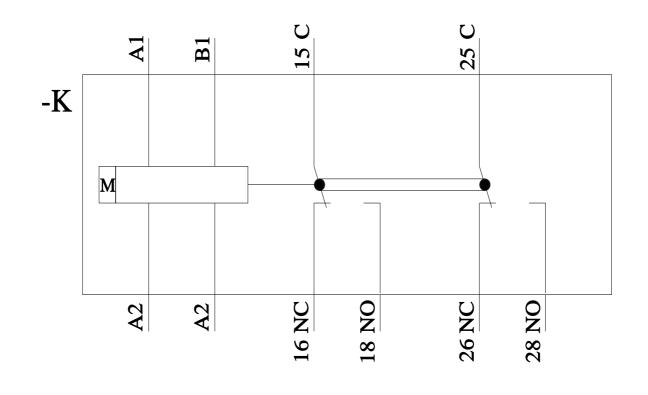

last modified:

11/21/2022 🖸