SIEMENS

Data sheet

3RN2010-1BA30



Thermistor motor protection relay Standard evaluation unit 22.5 mm enclosure screw terminal 2 change-over contacts US = 24 V AC/DC Auto-reset suitable for bimetallic switch 2 LEDs (READY/TRIPPED) galvanic isolation

| product brand name | SIRIUS | | |
|---|--|--|--|
| product brand hame | SIRIUS 3RN2 thermistor motor protection | | |
| product designation | Thermistor motor protection relay | | |
| design of the product | Standard evaluation unit, suitable for bimetallic switch | | |
| product type designation | 3RN2 | | |
| General technical data | | | |
| product function | thermistor motor protection | | |
| display version LED | Yes | | |
| insulation voltage for overvoltage category III according to IEC 60664 with degree of pollution 3 rated value | 300 V | | |
| degree of pollution | 3 | | |
| surge voltage resistance rated value | 4 kV | | |
| protection class IP | IP20 | | |
| shock resistance according to IEC 60068-2-27 | 11g / 15 ms | | |
| vibration resistance according to IEC 60068-2-6 | 10 55 Hz: 0.35 mm | | |
| mechanical service life (operating cycles) typical | 10 000 000 | | |
| electrical endurance (operating cycles) at AC-15 at 230 V typical | 100 000 | | |
| thermal current of the switching element with contacts maximum | 5 A | | |
| reference code according to IEC 81346-2 | К | | |
| Substance Prohibitance (Date) | 05/28/2009 | | |
| Product Function | | | |
| product function | | | |
| error memory | No | | |
| dynamic open-circuit detection | No | | |
| external reset | No | | |
| auto-RESET | Yes | | |
| manual RESET | No | | |
| Control circuit/ Control | | | |
| type of voltage of the control supply voltage | AC/DC | | |
| control supply voltage at AC | | | |
| • at 50 Hz rated value | 24 24 V | | |
| • at 60 Hz rated value | 24 24 V | | |
| control supply voltage at DC | | | |
| rated value | 24 24 V | | |
| operating range factor control supply voltage rated value at DC | | | |
| initial value | 0.85 | | |
| full-scale value | 1.1 | | |
| operating range factor control supply voltage rated value at AC at 50 Hz | | | |

| initial value | 0.85 |
|---|---|
| full-scale value | 1.1 |
| operating range factor control supply voltage rated value at AC at 60 Hz | |
| • initial value | 0.85 |
| • full-scale value | 1.1 |
| inrush current peak | 1.1 |
| • at 24 V | 1.8 A |
| duration of inrush current peak | 1.0 A |
| • at 24 V | 2 ms |
| Measuring circuit | 2 1115 |
| buffering time in the event of power failure minimum | 40 ms |
| Precision | 40 1115 |
| | 9 % |
| relative metering precision | 9 76 |
| Auxiliary circuit | 4=0=00 |
| material of switching contacts | AgSnO2 |
| number of NC contacts for auxiliary contacts | 0 |
| number of NO contacts for auxiliary contacts | 0 |
| number of CO contacts for auxiliary contacts | 2 |
| operational current of auxiliary contacts at DC-13 | 1.0 |
| • at 24 V | 1A |
| • at 125 V | 0.2 A |
| • at 250 V | 0.1 A |
| Main circuit | |
| operating frequency rated value | 50 60 Hz |
| ampacity of the output relay at AC-15 at 250 V at 50/60 Hz | 3 A |
| ampacity of the output relay at DC-13 | |
| • at 24 V | 1A |
| • at 125 V | 0.2 A |
| continuous current of the DIAZED fuse link of the output relay | 6 A |
| Electromagnetic compatibility | |
| | |
| conducted interference | |
| conducted interference • due to burst according to IEC 61000-4-4 | 2 kV (power ports) / 1 kV (signal ports) |
| • due to burst according to IEC 61000-4-4 | 2 kV (power ports) / 1 kV (signal ports) 2 kV (line to ground) |
| due to burst according to IEC 61000-4-4 due to conductor-earth surge according to IEC 61000-4-5 | 2 kV (line to ground) |
| • due to burst according to IEC 61000-4-4 | |
| due to burst according to IEC 61000-4-4 due to conductor-earth surge according to IEC 61000-4-5 due to conductor-conductor surge according to IEC | 2 kV (line to ground) |
| due to burst according to IEC 61000-4-4 due to conductor-earth surge according to IEC 61000-4-5 due to conductor-conductor surge according to IEC 61000-4-5 | 2 kV (line to ground) 1 kV (line to line) |
| due to burst according to IEC 61000-4-4 due to conductor-earth surge according to IEC 61000-4-5 due to conductor-conductor surge according to IEC 61000-4-5 electrostatic discharge according to IEC 61000-4-2 | 2 kV (line to ground) 1 kV (line to line) |
| • due to burst according to IEC 61000-4-4 • due to conductor-earth surge according to IEC 61000-4-5 • due to conductor-conductor surge according to IEC 61000-4-5 electrostatic discharge according to IEC 61000-4-2 Galvanic isolation | 2 kV (line to ground) 1 kV (line to line) 6 kV contact discharge / 8 kV air discharge |
| • due to burst according to IEC 61000-4-4 • due to conductor-earth surge according to IEC 61000-4-5 • due to conductor-conductor surge according to IEC 61000-4-5 electrostatic discharge according to IEC 61000-4-2 Galvanic isolation design of the electrical isolation | 2 kV (line to ground) 1 kV (line to line) 6 kV contact discharge / 8 kV air discharge |
| • due to burst according to IEC 61000-4-4 • due to conductor-earth surge according to IEC 61000-4-5 • due to conductor-conductor surge according to IEC 61000-4-5 electrostatic discharge according to IEC 61000-4-2 Galvanic isolation design of the electrical isolation galvanic isolation | 2 kV (line to ground) 1 kV (line to line) 6 kV contact discharge / 8 kV air discharge galvanic isolation |
| • due to burst according to IEC 61000-4-4 • due to conductor-earth surge according to IEC 61000-4-5 • due to conductor-conductor surge according to IEC 61000-4-5 electrostatic discharge according to IEC 61000-4-2 Galvanic isolation design of the electrical isolation ølvanic isolation • between input and output | 2 kV (line to ground) 1 kV (line to line) 6 kV contact discharge / 8 kV air discharge galvanic isolation Yes |
| • due to burst according to IEC 61000-4-4 • due to conductor-earth surge according to IEC 61000-4-5 • due to conductor-conductor surge according to IEC 61000-4-5 electrostatic discharge according to IEC 61000-4-2 Galvanic isolation design of the electrical isolation e between input and output • between the outputs | 2 kV (line to ground) 1 kV (line to line) 6 kV contact discharge / 8 kV air discharge galvanic isolation Yes Yes |
| due to burst according to IEC 61000-4-4 due to conductor-earth surge according to IEC 61000-4-5 due to conductor-conductor surge according to IEC 61000-4-5 electrostatic discharge according to IEC 61000-4-2 Galvanic isolation design of the electrical isolation galvanic isolation between input and output between the outputs between the voltage supply and other circuits | 2 kV (line to ground) 1 kV (line to line) 6 kV contact discharge / 8 kV air discharge galvanic isolation Yes Yes |
| due to burst according to IEC 61000-4-4 due to conductor-earth surge according to IEC 61000-4-5 due to conductor-conductor surge according to IEC 61000-4-5 electrostatic discharge according to IEC 61000-4-2 Galvanic isolation design of the electrical isolation galvanic isolation between input and output between the outputs between the voltage supply and other circuits Connections/ Terminals product component removable terminal for auxiliary and | 2 kV (line to ground) 1 kV (line to line) 6 kV contact discharge / 8 kV air discharge galvanic isolation Yes Yes No |
| due to burst according to IEC 61000-4-4 due to conductor-earth surge according to IEC 61000-4-5 due to conductor-conductor surge according to IEC 61000-4-5 electrostatic discharge according to IEC 61000-4-2 Galvanic isolation design of the electrical isolation galvanic isolation between input and output between the outputs between the voltage supply and other circuits Connections/ Terminals product component removable terminal for auxiliary and control circuit | 2 kV (line to ground) 1 kV (line to line) 6 kV contact discharge / 8 kV air discharge galvanic isolation Yes Yes No Yes |
| due to burst according to IEC 61000-4-4 due to conductor-earth surge according to IEC 61000-4-5 due to conductor-conductor surge according to IEC 61000-4-5 electrostatic discharge according to IEC 61000-4-2 Galvanic isolation design of the electrical isolation galvanic isolation between input and output between the outputs between the voltage supply and other circuits Connections/ Terminals product component removable terminal for auxiliary and control circuit type of electrical connection | 2 kV (line to ground) 1 kV (line to line) 6 kV contact discharge / 8 kV air discharge galvanic isolation Yes Yes No Yes Screw-type terminals |
| due to burst according to IEC 61000-4-4 due to conductor-earth surge according to IEC 61000-4-5 due to conductor-conductor surge according to IEC 61000-4-5 electrostatic discharge according to IEC 61000-4-2 Galvanic isolation design of the electrical isolation galvanic isolation between input and output between the outputs between the voltage supply and other circuits Connections/ Terminals product component removable terminal for auxiliary and control circuit for auxiliary and control circuit | 2 kV (line to ground) 1 kV (line to line) 6 kV contact discharge / 8 kV air discharge galvanic isolation Yes Yes No Yes Screw-type terminals |
| due to burst according to IEC 61000-4-4 due to conductor-earth surge according to IEC 61000-4-5 due to conductor-conductor surge according to IEC 61000-4-5 electrostatic discharge according to IEC 61000-4-2 Galvanic isolation design of the electrical isolation galvanic isolation between input and output between the outputs between the voltage supply and other circuits Connections/ Terminals product component removable terminal for auxiliary and control circuit type of electrical connection for auxiliary and control circuit type of connectable conductor cross-sections | 2 kV (line to ground) 1 kV (line to line) 6 kV contact discharge / 8 kV air discharge galvanic isolation Yes Yes No Yes Screw-type terminals screw-type terminals |
| due to burst according to IEC 61000-4-4 due to conductor-earth surge according to IEC 61000-4-5 due to conductor-conductor surge according to IEC 61000-4-5 electrostatic discharge according to IEC 61000-4-2 Galvanic isolation design of the electrical isolation galvanic isolation between input and output between the outputs between the voltage supply and other circuits Connections/ Terminals product component removable terminal for auxiliary and control circuit type of electrical connection for auxiliary and control circuit type of connectable conductor cross-sections solid | 2 kV (line to ground) 1 kV (line to line) 6 kV contact discharge / 8 kV air discharge galvanic isolation Yes Yes No Yes Screw-type terminals screw-type terminals 1x (0.5 4.0 mm ²), 2x (0.5 2.5 mm ²) |
| due to burst according to IEC 61000-4-4 due to conductor-earth surge according to IEC 61000-4-5 due to conductor-conductor surge according to IEC 61000-4-5 electrostatic discharge according to IEC 61000-4-2 Galvanic isolation design of the electrical isolation galvanic isolation between input and output between the outputs between the voltage supply and other circuits Connections/ Terminals product component removable terminal for auxiliary and control circuit type of electrical connection for auxiliary and control circuit type of connectable conductor cross-sections solid finely stranded with core end processing | 2 kV (line to ground) 1 kV (line to line) 6 kV contact discharge / 8 kV air discharge galvanic isolation Yes Yes No Yes Screw-type terminals screw-type terminals 1x (0.5 4.0 mm ²), 2x (0.5 2.5 mm ²) 1x (0.5 4 mm ²), 2x (0.5 1.5 mm ²) |
| due to burst according to IEC 61000-4-4 due to conductor-earth surge according to IEC 61000-4-5 due to conductor-conductor surge according to IEC 61000-4-5 electrostatic discharge according to IEC 61000-4-2 Galvanic isolation design of the electrical isolation galvanic isolation between input and output between the outputs between the voltage supply and other circuits Connections/ Terminals product component removable terminal for auxiliary and control circuit type of electrical connection for auxiliary and control circuit type of connectable conductor cross-sections solid finely stranded with core end processing for AWG cables solid | 2 kV (line to ground) 1 kV (line to line) 6 kV contact discharge / 8 kV air discharge galvanic isolation Yes Yes No Yes Screw-type terminals screw-type terminals 1x (0.5 4.0 mm ²), 2x (0.5 2.5 mm ²) 1x (0.5 4 mm ²), 2x (0.5 1.5 mm ²) |
| due to burst according to IEC 61000-4-4 due to conductor-earth surge according to IEC 61000-4-5 due to conductor-conductor surge according to IEC 61000-4-5 electrostatic discharge according to IEC 61000-4-2 Galvanic isolation design of the electrical isolation galvanic isolation between input and output between the outputs between the voltage supply and other circuits Connections/ Terminals product component removable terminal for auxiliary and control circuit type of electrical connection for auxiliary and control circuit type of connectable conductor cross-sections solid finely stranded with core end processing for AWG cables solid | 2 kV (line to ground) 1 kV (line to line) 6 kV contact discharge / 8 kV air discharge galvanic isolation Yes Yes No Yes Screw-type terminals screw-type terminals $1x (0.5 4.0 mm^2), 2x (0.5 2.5 mm^2)$ $1x (0.5 4 mm^2), 2x (0.5 1.5 mm^2)$ 1x (20 12), 2x (20 14) |
| due to burst according to IEC 61000-4-4 due to conductor-earth surge according to IEC 61000-4-5 due to conductor-conductor surge according to IEC 61000-4-5 electrostatic discharge according to IEC 61000-4-2 Galvanic isolation design of the electrical isolation galvanic isolation between input and output between the outputs between the voltage supply and other circuits Connections/ Terminals product component removable terminal for auxiliary and control circuit type of electrical connection for auxiliary and control circuit type of connectable conductor cross-sections solid finely stranded with core end processing for AWG cables solid | 2 kV (line to ground) 1 kV (line to line) 6 kV contact discharge / 8 kV air discharge galvanic isolation Yes Yes No Yes Screw-type terminals screw-type terminals $1x (0.5 4.0 \text{ mm}^2), 2x (0.5 2.5 \text{ mm}^2)$ 1x (20 12), 2x (20 14) $0.5 4 \text{ mm}^2$ |
| due to burst according to IEC 61000-4-4 due to conductor-earth surge according to IEC 61000-4-5 due to conductor-conductor surge according to IEC 61000-4-5 electrostatic discharge according to IEC 61000-4-2 Galvanic isolation design of the electrical isolation galvanic isolation between input and output between the outputs between the voltage supply and other circuits Connections/ Terminals product component removable terminal for auxiliary and control circuit type of electrical connection for auxiliary and control circuit type of connectable conductor cross-sections solid finely stranded with core end processing for AWG cables solid AWG number as coded connectable conductor cross | 2 kV (line to ground) 1 kV (line to line) 6 kV contact discharge / 8 kV air discharge galvanic isolation Yes Yes No Yes Screw-type terminals screw-type terminals $1x (0.5 4.0 \text{ mm}^2), 2x (0.5 2.5 \text{ mm}^2)$ 1x (20 12), 2x (20 14) $0.5 4 \text{ mm}^2$ |
| due to burst according to IEC 61000-4-4 due to conductor-earth surge according to IEC 61000-4-5 due to conductor-conductor surge according to IEC 61000-4-5 electrostatic discharge according to IEC 61000-4-2 Galvanic isolation design of the electrical isolation galvanic isolation between input and output between the outputs between the voltage supply and other circuits Connections/ Terminals product component removable terminal for auxiliary and control circuit type of electrical connection for auxiliary and control circuit type of connectable conductor cross-sections solid finely stranded with core end processing for AWG cables solid AWG number as coded connectable conductor cross section | 2 kV (line to ground) 1 kV (line to line) 6 kV contact discharge / 8 kV air discharge galvanic isolation Yes Yes No Yes Screw-type terminals screw-type terminals $1x (0.5 4.0 \text{ mm}^2), 2x (0.5 2.5 \text{ mm}^2)$ 1x (20 12), 2x (20 14) $0.5 4 \text{ mm}^2$ |
| due to burst according to IEC 61000-4-4 due to conductor-earth surge according to IEC 61000-4-5 due to conductor-conductor surge according to IEC 61000-4-5 electrostatic discharge according to IEC 61000-4-2 Galvanic isolation design of the electrical isolation galvanic isolation between input and output between the outputs between the voltage supply and other circuits Connections/ Terminals product component removable terminal for auxiliary and control circuit type of electrical connection for auxiliary and control circuit type of connectable conductor cross-sections solid finely stranded with core end processing for AWG cables solid AWG number as coded connectable conductor cross section solid solid | 2 kV (line to ground) 1 kV (line to line) 6 kV contact discharge / 8 kV air discharge galvanic isolation Yes Yes No Yes Screw-type terminals screw-type terminals 1x (0.5 4.0 mm ²), 2x (0.5 2.5 mm ²) 1x (0.5 4 mm ²), 2x (0.5 1.5 mm ²) 1x (20 12), 2x (20 14) 0.5 4 mm ² 20 12 |
| due to burst according to IEC 61000-4-4 due to conductor-earth surge according to IEC 61000-4-5 due to conductor-conductor surge according to IEC 61000-4-5 electrostatic discharge according to IEC 61000-4-2 Galvanic isolation design of the electrical isolation galvanic isolation between input and output between the outputs between the voltage supply and other circuits Connections/ Terminals product component removable terminal for auxiliary and control circuit type of electrical connection for auxiliary and control circuit type of connectable conductor cross-sections solid finely stranded with core end processing finely stranded with core end processing finely stranded with core end processing solid finely stranded with core end processing solid stranded | 2 kV (line to ground) 1 kV (line to line) 6 kV contact discharge / 8 kV air discharge galvanic isolation Yes Yes No Yes Screw-type terminals screw-type terminals 1x (0.5 4.0 mm ²), 2x (0.5 2.5 mm ²) 1x (0.5 4 mm ²), 2x (0.5 1.5 mm ²) 1x (20 12), 2x (20 14) 0.5 4 mm ² 20 12 20 12 |

| mounting position | | any | | | |
|---|---|--|---|---|--|
| fastening method | | screw and snap-on mounting onto 35 mm DIN rail | | | |
| height | | 100 mm | | | |
| width | | 22.5 mm | | | |
| depth | | 90 mm | | | |
| required spacing | | | | | |
| with side-by-side mounting | | | | | |
| — forwards | | 0 mm | | | |
| — backwards | | 0 mm | | | |
| — upwards | | 0 mm | | | |
| — downwards | | 0 mm | | | |
| — at the side | | 0 mm | | | |
| for grounded parts | | | | | |
| — forwards | | 0 mm | | | |
| — backwards | | 0 mm | | | |
| — upwards | | 0 mm | | | |
| — at the side | | 0 mm | | | |
| — downwards | | 0 mm | | | |
| for live parts | | | | | |
| — forwards | | 0 mm | | | |
| — backwards | | 0 mm | | | |
| — upwards | | 0 mm | | | |
| — downwards | | 0 mm | | | |
| — at the side | | 0 mm | | | |
| mbient conditions | | | | | |
| installation altitude at height above sea level maxim | านm | 2 000 m | | | |
| ambient temperature | | | | | |
| during operation | | -25 +60 °C | | | |
| during storage | | -40 +85 °C | | | |
| during transport | | -40 +85 °C | | | |
| | | | | | |
| relative humidity during operation | | 70 % | | | |
| ertificates/ approvals | | 70 % | _ | | |
| | | 70 % | _ | EMC | |
| ertificates/ approvals | Confirmatio | | | EMC | |
| ertificates/ approvals | Confirmatio | | cor | EMC | |
| ertificates/ approvals | Confirmatio | | EAC | Ø | |
| ertificates/ approvals | <u>Confirmatio</u> | | EAC | EMC RCM | |
| ertificates/ approvals General Product Approval | <u>Confirmatio</u> | | EAC | Ø | |
| ertificates/ approvals General Product Approval | Confirmatio | | EAC | Ø | |
| ertificates/ approvals General Product Approval Image: Constraint of Conformity | Test Certificate | n Que un of the set of | EAC | Ø | |
| ertificates/ approvals General Product Approval Image: Constraint of Conformity | | n UL UL es Marine / Shipping | EAC | Ø | |
| ertificates/ approvals General Product Approval Image: Constraint of Conformity | Test Certificate | n UL UL es Marine / Shipping | EAC | Ø | |
| ertificates/ approvals General Product Approval | Test Certificate | n UL UL es Marine / Shipping | EAC | Ò | |
| ertificates/ approvals General Product Approval Image: Constraint of Conformity | Test Certificate | n Que ve | EAC | Ø | |
| ertificates/ approvals General Product Approval Image: Constraint of Conformity | Test Certificate | n Que ve | EAC | Ø | |
| General Product Approvals General Product Approval CCC Declaration of Conformity UKA General Conformity General Con | Test Certificate | n Que ve | EAC <i>V</i> | Ô | |
| General Product Approvals General Product Approval CCC CCC Declaration of Conformity UKA CCC General Product Approval CCC | Test Certificate | n Que ve | EAC EES | Ø | |
| General Product Approvals General Product Approval CCC Declaration of Conformity UKA General Conformity General Con | Test Certificate | n Que ve | EAC | Ø | |
| General Product Approvals General Product Approval CCC Declaration of Conformity UKA General Conformity General Con | Test Certificate | n Que ve | EAC <i>V</i> | Ò | |
| General Product Approvals General Product Approval CCC Declaration of Conformity UKA General Conformity General Con | Test Certificate | n Que ve | EAC <i>V</i> | Ô | |
| General Product Approvals General Product Approval CCC Declaration of Conformity UKA General Conformity General Con | Test Certificate | n Que ve | EAC <i>V</i> | Ô | |
| General Product Approvals General Product Approval CCC Declaration of Conformity UKA General Conformity General Con | Test Certificate | n Que ve | EAC | Ô | |
| ertificates/ approvals General Product Approval General Product Approval CCC Declaration of Conformity UK CCC Declaration of Conformity CCC CCC Declaration of Conformity CCC CCC CCC CCC CCC CCC CCC C | Test Certificate <u>Type Test Cer</u> <u>ates/Test Rep</u> | n Que Service Shipping | EAC <i>V</i> | Ô | |
| ertificates/ approvals General Product Approval General Product Approval CCC Declaration of Conformity UK CCC Declaration of Conformity CCC CCC Declaration of Conformity CCC CCC CCC Declaration of Conformity CCC CCC CCC CCC Declaration of Conformity CCC CCC CCC CCC CCC CCC CCC C | Test Certificate <u>Type Test Cer</u> <u>ates/Test Rep</u> <u>ates/Test Rep</u> <u>t (see here).</u> | n Que Service | EAC <i>V</i> | Ô | |
| ertificates/ approvals General Product Approval General Product Approval CCC Declaration of Conformity UKS EG-Konf. other Confirmation Siemens has decided to exit the Russian market | Test Certificate Type Test Cer ates/Test Rep t (see here). siemens-wind-do nt EAC certificate tus of validity of | n Image: Content of the second se | ERF EFRE end to import or offer to su | Image: Constraint of the constraint | |
| ertificates/ approvals General Product Approval Declaration of Conformity UKS General Product Approval Declaration of Conformity General Product Approval Other Confirmation Silemens has decided to exit the Russian market https://press.siemens.com/global/en/pressrelease/s Silemens is working on the renewal of the currer Please contact your local Siemens office on the sta | Test Certificato Type Test Cerr ates/Test Rep t (see here). siemens-wind-do nt EAC certificato tus of validity of VEU member sta | n Image: Content of the second se | ERF EFFE PRS | Image: Constraint of the constraint | |

Information- and Downloadcenter (Catalogs, Brochures,...)

https://www.siemens.com/ic10

Industry Mall (Online ordering system) https://mall.industry.siemens.com/mall/en/en/Catalog/product?mlfb=3RN2010-1BA30

Cax online generator

http://support.automation.siemens.com/WW/CAXorder/default.aspx?lang=en&mlfb=3RN2010-1BA30


Service&Support (Manuals, Certificates, Characteristics, FAQs,...)


https://support.industry.siemens.com/cs/ww/en/ps/3RN2010-1BA30

Image database (product images, 2D dimension drawings, 3D models, device circuit diagrams, EPLAN macros, ...) http://www.automation.siemens.com/bilddb/cax_de.aspx?mlfb=3RN2010-1BA30&lang=en

Characteristic: Derating

https://support.industry.siemens.com/cs/ww/en/ps/3RN2010-1BA30/manual

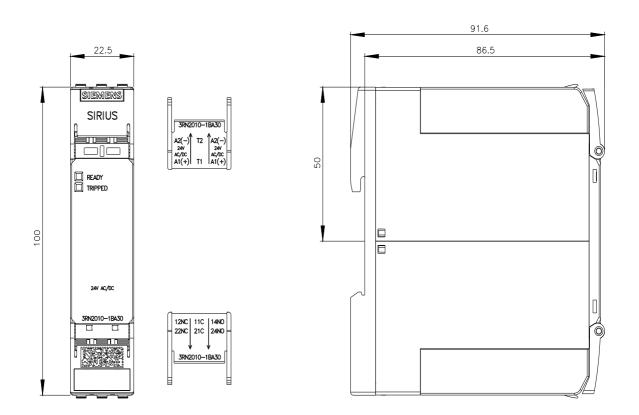

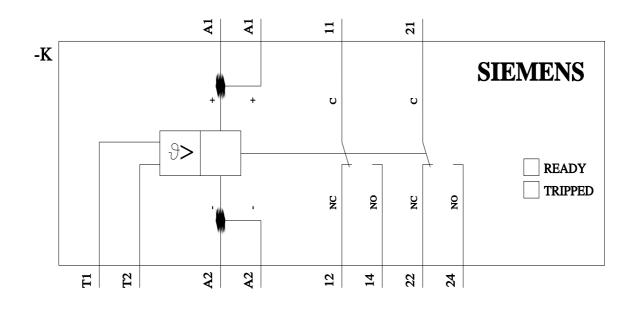

last modified:

11/21/2022 🖸